

TUSCARORA TOWNSHIP

SEWER EXTENSION PHASE I - GRAVITY

CONTRACT DOCUMENTS & SPECIFICATIONS

Contract Number 22-5797-A

PREPARATION DATE: December 2023

PROJECT ENGINEER:

PERFORMANCE ENGINEERS, INC.
406 PETOSKEY AVENUE
CHARELEVOIX, MICHIGAN 49720
Ph. (231)547-2121 Fax (231)547-0084
WWW.PERFORMANCEENG.COM

PART 1
TUSCARORA TOWNSHIP

SEWER EXTENSION PHASE I – GRAVITY

BIDDING DOCUMENTS, CONTRACT DOCUMENTS AND USDA CERTIFICATIONS

TABLE OF CONTENTS

ITEM 1	C-111, ADVERTISEMENT FOR BIDS	1
ITEM 2	C-200, INSTRUCTIONS TO BIDDERS FOR CONSTRUCTION CONTRACT.....	3
ITEM 3	C-410, BID FORM FOR CONSTRUCTION CONTRACT.....	13
ITEM 4	C-430, BID BOND (PENAL SUM FORM)	20
ITEM 5	C-451, QUALIFICATIONS STATEMENT	22
ITEM 6	C-510, NOTICE OF AWARD	27
ITEM 7	C-520, AGREEMENT BETWEEN OWNER AND CONTRACTOR FOR CONSTRUCTION CONTRACT	29
ITEM 8	C-550, NOTICE TO PROCEED.....	38
ITEM 9	C-610, PERFORMANCE BOND.....	39
ITEM 10	C-615, PAYMENT BOND.....	43
ITEM 11	C-620, APPLICATION FOR PAYMENT	48
ITEM 12	C-625, CERTIFICATE OF SUBSTANTIAL COMPLETION.....	53
ITEM 13	C-626, NOTICE OF ACCEPTABILITY OF WORK.....	54
ITEM 14	C-700, STANDARD GENERAL CONDITIONS OF THE CONSTRUCTION CONTRACT	58
ITEM 15	C-800, SUPPLEMENTARY CONDITIONS OF THE CONSTRUCTION CONTRACT	135
ITEM 16	C-940, WORK CHANGE DIRECTIVE	179
ITEM 17	C-941, CHANGE ORDER	180
ITEM 18	C-942, FIELD ORDER	181
ITEM 19	RUS BULLETIN 1780-26, EXHIBIT A, ATTACHMENT 1, CERTIFICATE OF OWNER'S ATTORNEY AND AGENCY CONCURRENCE	182
ITEM 20	RD-400-6, COMPLIANCE STATEMENT	183
ITEM 21	AD-1048, CERTIFICATION REGARDING DEBARMENT, SUSPENSION, INELIGIBILITY AND VOLUNTARY EXCLUSION LOWER TIER COVERED TRANSACTIONS.....	184
ITEM 22	RD INSTRUCTION 1940-Q, EXHIBIT A-1, CERTIFICATION FOR CONTRACTS, GRANTS AND LOANS	186
ITEM 23	RUS BULLETIN 1780-26, EXHIBIT A, ATTACHMENT 3, SAMPLE LANGUAGE FOR CONTRACTOR'S CERTIFICATION OF COMPLIANCE.....	187
ITEM 24	RUS BULLETIN 1780-26, EXHIBIT A, ATTACHMENT 4, SAMPLE LANGUAGE FOR MANUFACTURER'S CERTIFICATION OF COMPLIANCE.....	188
ITEM 25	PROJECT SIGN, (TEMPORARY CONSTRUCTION SIGN)	189

ADVERTISEMENT FOR BIDS
TUSCARORA TOWNSHIP
INDIAN RIVER, MICHIGAN
SEWER EXTENSION PHASE I - GRAVITY

General Notice

Tuscarora Township (Owner) is requesting Bids for the construction of the following Project:

Sewer Extension Phase I - Gravity
22-5797-A

Bids for the construction of the Project will be received at the **Tuscarora Township Offices** located at **3546 S Straits Highway, Indian River, MI, 49749**, until **[day], [date]** at **[time for receipt of Bids]** local time. At that time the Bids received will be **publicly** opened and read.

The Project includes the following Work:

The Project generally consists of constructing gravity sanitary sewer piping, manholes, cleanouts, pumping stations, and appurtenances within public road rights-of-way. The construction requires demolition and removal of surface structures, excavation, dewatering, construction, and restoration activities. Bids are requested for the following Contract: **Tuscarora Township Sewer Extension Phase I - Gravity, Contract Number 22-5797-A.**

Owner anticipates that the Project's total bid price will be approximately **\$[insert amount]**. The Project has an expected duration of **[insert number]** days.

Obtaining the Bidding Documents

The Issuing Office for the Bidding Documents is:

PERFORMANCE ENGINEERS, INC.

406 Petoskey Avenue, Charlevoix, Michigan 49720 (231)547-2121, Attn. Mr. Aaron Nordman,
aaronn@performanceeng.com.

Prospective Bidders may obtain or examine the Bidding Documents at the Issuing Office on Monday through Friday between the hours of **8 am and 5 pm**, and may obtain copies of the Bidding Documents from the Issuing Office as described below. Partial sets of Bidding Documents will not be available from the Issuing Office. Neither Owner nor Engineer will be responsible for full or partial sets of Bidding Documents, including addenda, if any, obtained from sources other than the Issuing Office.

Bidding Documents may also be available for review at the Builder's Exchange plan room, Traverse City & Lansing, the McGraw-Hill Dodge plan room, Lansing, and the Construction Association of Michigan, 43636 Woodward Ave., Bloomfield Hills, MI 48302.

Printed copies of the Bidding Documents may be obtained from the Issuing Office by paying a deposit of **\$50.00** for each set. Bidders who return full sets of the Bidding Documents in good condition within 10 days after receipt of Bids will receive a full refund. Make deposit checks for Bidding Documents payable to **Performance Engineers, Inc.**

Bidding Documents may be purchased from the Issuing Office during the hours indicated above. Cost does not include shipping charges. Upon Issuing Office's receipt of payment, printed Bidding Documents or electronic documents on compact disk will be sent via the prospective Bidder's delivery service. The

shipping charge amount will depend on the shipping method chosen. Bidding Documents are available **Pre-bid Conference**

A mandatory pre-bid conference for the Project will be held on **[day, date]** at **[time]** at **the Tuscarora Township Offices, 3546 S Straits Highway, Indian River, Michigan, 49749 followed by a visit to the site of construction..** Bids will not be accepted from Bidders that do not attend the mandatory pre-bid conference.

Instructions to Bidders.

For all further requirements regarding bid submittal, qualifications, procedures, and contract award, refer to the Instructions to Bidders that are included in the Bidding Documents.

Domestic Preference

This project is subject to the Build America, Buy America Act (BABAA) requirements under Title IX of the Infrastructure Investment and Jobs Act (IIJA), Pub. L. 117-58, §§ 70901-70953. Absent an approved waiver, all iron, steel, manufactured products, and construction materials used in this project must be produced in the United States.

The following waivers apply to this Contract:

BABAA De Minimis, Small Grants, and Minor Components

This Advertisement is issued by:

Owner: **Tuscarora Township**

By: **Bob Kramer**

Title: **Township Supervisor**

Date: **[Date of initial publication of advertisement]**

INSTRUCTIONS TO BIDDERS FOR CONSTRUCTION CONTRACT

TABLE OF CONTENTS

	Page
Article 1— Defined Terms.....	1
Article 2— Bidding Documents.....	1
Article 3— Pre-Bid Conference	2
Article 4— Site and Other Areas; Existing Site Conditions; Examination of Site; Owner's Safety Program; Other Work at the Site	2
Article 5— Bidder's Representations and Certifications.....	4
Article 6— Interpretations and Addenda	5
Article 7— Bid Security	5
Article 8— Contract Times	6
Article 9— Substitute and "Or Equal" Items.....	6
Article 10— Subcontractors, Suppliers, and Others	7
Article 11— Preparation of Bid.....	7
Article 12— Basis of Bid	8
Article 13— Submittal of Bid.....	9
Article 14— Modification and Withdrawal of Bid.....	9
Article 15— Opening of Bids	10
Article 16— Bids to Remain Subject to Acceptance	10
Article 17— Evaluation of Bids and Award of Contract	10
Article 18— Bonds and Insurance.....	11
Article 19— Signing of Agreement.....	11
Article 20— Federal Requirements.....	11

BID FORM FOR CONSTRUCTION CONTRACT

The terms used in this Bid with initial capital letters have the meanings stated in the Instructions to Bidders, the General Conditions, and the Supplementary Conditions.

ARTICLE 1—OWNER AND BIDDER

1.01 This Bid is submitted to: **Tuscarora Township**
3546 S Straits Highway
Indian River, Michigan, 49749.

1.02 The undersigned Bidder proposes and agrees, if this Bid is accepted, to enter into an Agreement with Owner in the form included in the Bidding Documents to perform all Work as specified or indicated in the Bidding Documents for the prices and within the times indicated in this Bid and in accordance with the other terms and conditions of the Bidding Documents.

ARTICLE 2—ATTACHMENTS TO THIS BID

2.01 The following documents are submitted with and made a condition of this Bid:

- A. Required Bid security;
- B. List of Proposed Subcontractors;
- C. List of Proposed Suppliers;
- D. Evidence of authority to do business in the state of the Project; or a written covenant to obtain such authority within the time for acceptance of Bids;
- E. Contractor's license number as evidence of Bidder's State Contractor's License or a covenant by Bidder to obtain said license within the time for acceptance of Bids;
- F. Required Bidder Qualification Statement with supporting data;
- G. **If Bid amount exceeds \$10,000, signed Compliance Statement (RD 400-6). Refer to specific equal opportunity requirements set forth in the Supplementary Conditions of the Construction Contract (EJCDC C-800);**
- H. **If Bid amount exceeds \$25,000, signed Certification Regarding Debarment, Suspension, Ineligibility and Voluntary Exclusion - Lower Tier Covered Transactions (AD-1048);**
- I. **If Bid amount exceeds \$100,000, signed RD Instruction 1940-Q Exhibit A-1, Certification for Contracts, Grants, and Loans.**

ARTICLE 3—BASIS OF BID—LUMP SUM BID AND UNIT PRICES

3.01 *Unit Price Bids*

- A. Bidder will perform the following Work at the indicated unit prices:

Item No.	Description	Unit	Estimated Quantity	Bid Unit Price	Bid Amount
1	MOBILIZATION, MAX. ____	LS	1.0	\$	\$
2	TRAFFIC CONTROL	LS	1.0	\$	\$
3	CONSTRUCTION STAKING SP	LS	1.0	\$	\$
4	MACHINE GRADING, MOD	STA	6.8	\$	\$
5	CULV, REM, LESS THAN 24 INCH	FT	300.0	\$	\$
6	CURB AND GUTTER, REM	FT	200.0	\$	\$
7	HMA, SURFACE, REM	SYD	2,200.0	\$	\$
8	HMA, SURFACE, PULVERIZE	SYD	16,750.0	\$	\$
9	PAVT, REM	SYD	600.0	\$	\$
10	SIGN, TYPE III, ERECT, SALV	EA	30.0	\$	\$
11	AGGREGATE BASE, REPLACE ONSITE MATERIALS, 6 INCH	SYD	12,000.0	\$	\$
12	AGGREGATE BASE, 6 INCH	SYD	5,000.0	\$	\$
13	SHOULDER CL II, 4 INCH	SYD	500.0	\$	\$
14	SUBGRADE UNDERCUTTING, TYPE II	CYD	500.0	\$	\$
15	CULV, CL B, 12 INCH	FT	850.0	\$	\$
16	DEWATERING SYSTEM, TRENCH, WELL POINTS	FT	1,880.0	\$	\$
17	DEWATERING SYSTEM, TRENCH, OTHER	FT	4,600.0	\$	\$
18	SEWER, PVC (SDR-21), 3 INCH	FT	550.0	\$	\$
19	SEWER, PVC (SDR-21), 4 INCH	FT	3,920.0	\$	\$
20	SEWER SERVICE, PVC (SDR-26), 6 INCH	FT	7,000.0	\$	\$
21	SEWER, PVC (SDR-26), 8 INCH	FT	9,550.0	\$	\$
22	SAN STRUCTURE, 48 INCH DIA.	EA	38.0	\$	\$
23	LIFT STATION - A	EA	1.0	\$	\$
24	LIFT STATION - B	EA	4.0	\$	\$
25	SAN TIE INTO EX. STRUCTURE, COMPLETE	EA	3.0	\$	\$

EJCD® C-410, Bid Form for Construction Contract.

Copyright® 2018 National Society of Professional Engineers, American Council of Engineering Companies, and American Society of Civil Engineers. All rights reserved.

Modified to include RD edits from RUS Bulletin 1780-26 (5/24/2023).

26	LIFT STATION, UPGRADES, COMPLETE	EA	1.0	\$	\$
27	TREATMENT PLANT	LS	1.0	\$	\$
28	CURB AND GUTTER, CONC, DET C4	FT	200.0	\$	\$
29	DRIVEWAY, NONREINF CONC, 6 INCH	SYD	600.0	\$	\$
30	HMA, 4E1, MOD, TOP	TON	3,015.0	\$	\$
31	SITE RESTORATION	LS	1.0	\$	\$
					\$
Total of All Unit Price Bid Items					\$

B. Bidder acknowledges that:

1. each Bid Unit Price includes an amount considered by Bidder to be adequate to cover Contractor's overhead and profit for each separately identified item, and
2. estimated quantities are not guaranteed, and are solely for the purpose of comparison of Bids, and final payment for all Unit Price Work will be based on actual quantities, determined as provided in the Contract Documents.

3.02 Total Bid Price (Lump Sum and Unit Prices)

Total Bid Price (Total of all Lump Sum and Unit Price Bids)	\$
---	----

ARTICLE 4—DELETED

ARTICLE 5—DELETED

ARTICLE 6—TIME OF COMPLETION

- 6.01 Bidder agrees that the Work will be substantially complete and will be completed and ready for final payment in accordance with Paragraph 15.06 of the General Conditions on or before the dates or within the number of calendar days indicated in the Agreement.
- 6.02 **Deleted**
- 6.03 **Deleted**
- 6.04 Bidder accepts the provisions of the Agreement as to liquidated damages.

ARTICLE 7—BIDDER'S ACKNOWLEDGEMENTS: ACCEPTANCE PERIOD, INSTRUCTIONS, AND RECEIPT OF ADDENDA

1.

7.01 Bid Acceptance Period

- A. This Bid will remain subject to acceptance for 60 days after the Bid opening, or for such longer period of time that Bidder may agree to in writing upon request of Owner.

7.02 *Instructions to Bidders*

A. Bidder accepts all of the terms and conditions of the Instructions to Bidders, including without limitation those dealing with the disposition of Bid security.

7.03 *Receipt of Addenda*

A. Bidder hereby acknowledges receipt of the following Addenda: **[Add rows as needed. Bidder is to complete table.]**

Addendum Number	Addendum Date

ARTICLE 8—BIDDER'S REPRESENTATIONS AND CERTIFICATIONS

8.01 *Bidder's Representations*

A. In submitting this Bid, Bidder represents the following:

1. Bidder has examined and carefully studied the Bidding Documents, including Addenda.
2. Bidder has visited the Site, conducted a thorough visual examination of the Site and adjacent areas, and become familiar with the general, local, and Site conditions that may affect cost, progress, and performance of the Work.
3. Bidder is familiar with all Laws and Regulations that may affect cost, progress, and performance of the Work, **including all Domestic Preference requirements**.
4. Bidder has carefully studied the reports of explorations and tests of subsurface conditions at or adjacent to the Site and the drawings of physical conditions relating to existing surface or subsurface structures at the Site that have been identified in the Supplementary Conditions, with respect to the Technical Data in such reports and drawings.
5. Bidder has carefully studied the reports and drawings relating to Hazardous Environmental Conditions, if any, at or adjacent to the Site that have been identified in the Supplementary Conditions, with respect to Technical Data in such reports and drawings.
6. Bidder has considered the information known to Bidder itself; information commonly known to contractors doing business in the locality of the Site; information and observations obtained from visits to the Site; the Bidding Documents; and the Technical Data identified in the Supplementary Conditions or by definition, with respect to the effect of such information, observations, and Technical Data on (a) the cost, progress, and performance of the Work; (b) the means, methods, techniques, sequences, and procedures of construction to be employed by Bidder, if selected as Contractor; and (c) Bidder's (Contractor's) safety precautions and programs.
7. Based on the information and observations referred to in the preceding paragraph, Bidder agrees that no further examinations, investigations, explorations, tests, studies, or data

are necessary for the performance of the Work at the Contract Price, within the Contract Times, and in accordance with the other terms and conditions of the Contract.

8. Bidder is aware of the general nature of work to be performed by Owner and others at the Site that relates to the Work as indicated in the Bidding Documents.
9. Bidder has given Engineer written notice of all conflicts, errors, ambiguities, or discrepancies that Bidder has discovered in the Bidding Documents, and of discrepancies between Site conditions and the Contract Documents, and the written resolution thereof by Engineer is acceptable to Contractor.
10. The Bidding Documents are generally sufficient to indicate and convey understanding of all terms and conditions for performance and furnishing of the Work.
11. The submission of this Bid constitutes an incontrovertible representation by Bidder that without exception the Bid and all prices in the Bid are premised upon performing and furnishing the Work required by the Bidding Documents.

8.02 *Bidder's Certifications*

A. The Bidder certifies the following:

1. This Bid is genuine and not made in the interest of or on behalf of any undisclosed individual or entity and is not submitted in conformity with any collusive agreement or rules of any group, association, organization, or corporation.
2. Bidder has not directly or indirectly induced or solicited any other Bidder to submit a false or sham Bid.
3. Bidder has not solicited or induced any individual or entity to refrain from bidding.
4. Bidder has not engaged in corrupt, fraudulent, collusive, or coercive practices in competing for the Contract. For the purposes of this Paragraph 8.02.A:
 - a. Corrupt practice means the offering, giving, receiving, or soliciting of anything of value likely to influence the action of a public official in the bidding process.
 - b. Fraudulent practice means an intentional misrepresentation of facts made (a) to influence the bidding process to the detriment of Owner, (b) to establish bid prices at artificial non-competitive levels, or (c) to deprive Owner of the benefits of free and open competition.
 - c. Collusive practice means a scheme or arrangement between two or more Bidders, with or without the knowledge of Owner, a purpose of which is to establish bid prices at artificial, non-competitive levels.
 - d. Coercive practice means harming or threatening to harm, directly or indirectly, persons or their property to influence their participation in the bidding process or affect the execution of the Contract.

BIDDER hereby submits this Bid as set forth above:

Bidder:

(typed or printed name of organization)

By:

(individual's signature)

Name:

(typed or printed)

Title:

(typed or printed)

Date:

(typed or printed)

If Bidder is a corporation, a partnership, or a joint venture, attach evidence of authority to sign.

Attest:

(individual's signature)

Name:

(typed or printed)

Title:

(typed or printed)

Date:

(typed or printed)

Address for giving notices:

Bidder's Contact:

Name:

(typed or printed)

Title:

(typed or printed)

Phone:

Email:

Address:

Bidder's Contractor License No.: (if applicable)

BID BOND (PENAL SUM FORM)

Bidder Name: [Full formal name of Bidder] Address (<i>principal place of business</i>): [Address of Bidder's principal place of business]	Surety Name: [Full formal name of Surety] Address (<i>principal place of business</i>): [Address of Surety's principal place of business]
Owner Name: Tuscarora Township Address (<i>principal place of business</i>): 3546 S Straits Highway Indian River, MI 49749	Bid Project (<i>name and location</i>): Tuscarora Township Sewer Extension Phase I - Gravity Bid Due Date: [Enter date bid is due]
Bond Penal Sum: [Amount] Date of Bond: [Date]	
Surety and Bidder, intending to be legally bound hereby, subject to the terms set forth in this Bid Bond, do each cause this Bid Bond to be duly executed by an authorized officer, agent, or representative.	
Bidder _____ <i>(Full formal name of Bidder)</i>	Surety _____ <i>(Full formal name of Surety) (corporate seal)</i>
By: _____ <i>(Signature)</i>	By: _____ <i>(Signature) (Attach Power of Attorney)</i>
Name: _____ <i>(Printed or typed)</i>	Name: _____ <i>(Printed or typed)</i>
Title: _____	Title: _____
Attest: _____ <i>(Signature)</i>	Attest: _____ <i>(Signature)</i>
Name: _____ <i>(Printed or typed)</i>	Name: _____ <i>(Printed or typed)</i>
Title: _____	Title: _____
<i>Notes: (1) Note: Addresses are to be used for giving any required notice. (2) Provide execution by any additional parties, such as joint venturers, if necessary.</i>	

1. Bidder and Surety, jointly and severally, bind themselves, their heirs, executors, administrators, successors, and assigns to pay to Owner upon default of Bidder the penal sum set forth on the face of this Bond. Payment of the penal sum is the extent of Bidder's and Surety's liability. Recovery of such penal sum under the terms of this Bond will be Owner's sole and exclusive remedy upon default of Bidder.
2. Default of Bidder occurs upon the failure of Bidder to deliver within the time required by the Bidding Documents (or any extension thereof agreed to in writing by Owner) the executed Agreement required by the Bidding Documents and any performance and payment bonds required by the Bidding Documents.
3. This obligation will be null and void if:
 - 3.1. Owner accepts Bidder's Bid and Bidder delivers within the time required by the Bidding Documents (or any extension thereof agreed to in writing by Owner) the executed Agreement required by the Bidding Documents and any performance and payment bonds required by the Bidding Documents, or
 - 3.2. All Bids are rejected by Owner, or
 - 3.3. Owner fails to issue a Notice of Award to Bidder within the time specified in the Bidding Documents (or any extension thereof agreed to in writing by Bidder and, if applicable, consented to by Surety when required by Paragraph 5 hereof).
4. Payment under this Bond will be due and payable upon default of Bidder and within 30 calendar days after receipt by Bidder and Surety of written notice of default from Owner, which notice will be given with reasonable promptness, identifying this Bond and the Project and including a statement of the amount due.
5. Surety waives notice of any and all defenses based on or arising out of any time extension to issue Notice of Award agreed to in writing by Owner and Bidder, provided that the total time for issuing Notice of Award including extensions does not in the aggregate exceed 120 days from the Bid due date without Surety's written consent.
6. No suit or action will be commenced under this Bond prior to 30 calendar days after the notice of default required in Paragraph 4 above is received by Bidder and Surety, and in no case later than one year after the Bid due date.
7. Any suit or action under this Bond will be commenced only in a court of competent jurisdiction located in the state in which the Project is located.
8. Notices required hereunder must be in writing and sent to Bidder and Surety at their respective addresses shown on the face of this Bond. Such notices may be sent by personal delivery, commercial courier, or by United States Postal Service registered or certified mail, return receipt requested, postage pre-paid, and will be deemed to be effective upon receipt by the party concerned.
9. Surety shall cause to be attached to this Bond a current and effective Power of Attorney evidencing the authority of the officer, agent, or representative who executed this Bond on behalf of Surety to execute, seal, and deliver such Bond and bind the Surety thereby.
10. This Bond is intended to conform to all applicable statutory requirements. Any applicable requirement of any applicable statute that has been omitted from this Bond will be deemed to be included herein as if set forth at length. If any provision of this Bond conflicts with any applicable statute, then the provision of said statute governs and the remainder of this Bond that is not in conflict therewith continues in full force and effect.
11. The term "Bid" as used herein includes a Bid, offer, or proposal as applicable.

ARTICLE 1—GENERAL INFORMATION

1.01 Provide contact information for the Business:

Legal Name of Business:			
Corporate Office			
Name:		Phone number:	
Title:		Email address:	
Business address of corporate office:			
Local Office			
Name:		Phone number:	
Title:		Email address:	
Business address of local office:			

1.02 Provide information on the Business's organizational structure:

Form of Business:	<input type="checkbox"/> Sole Proprietorship <input type="checkbox"/> Partnership <input type="checkbox"/> Corporation		
<input type="checkbox"/> Limited Liability Company <input type="checkbox"/> Joint Venture comprised of the following companies:			
1.			
2.			
3.			
Provide a separate Qualification Statement for each Joint Venturer.			
Date Business was formed:		State in which Business was formed:	
Is this Business authorized to operate in the Project location?		<input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> Pending	

1.03 Identify all businesses that own Business in whole or in part (25% or greater), or that are wholly or partly (25% or greater) owned by Business:

Name of business:		Affiliation:	
Address:			
Name of business:		Affiliation:	
Address:			
Name of business:		Affiliation:	
Address:			

1.04 Provide information regarding the Business's officers, partners, and limits of authority.

Name:	Title:	
Authorized to sign contracts: <input type="checkbox"/> Yes <input type="checkbox"/> No	Limit of Authority:	\$
Name:	Title:	
Authorized to sign contracts: <input type="checkbox"/> Yes <input type="checkbox"/> No	Limit of Authority:	\$
Name:	Title:	
Authorized to sign contracts: <input type="checkbox"/> Yes <input type="checkbox"/> No	Limit of Authority:	\$
Name:	Title:	

ARTICLE 2—LICENSING

2.01 Provide information regarding licensure for Business:

Name of License:			
Licensing Agency:			
License No:		Expiration Date:	
Name of License:			
Licensing Agency:			
License No:		Expiration Date:	

ARTICLE 3—DIVERSE BUSINESS CERTIFICATIONS

3.01 Provide information regarding Business's Diverse Business Certification, if any. Provide evidence of current certification.

Certification	Certifying Agency	Certification Date
<input type="checkbox"/> Disadvantaged Business Enterprise		
<input type="checkbox"/> Minority Business Enterprise		
<input type="checkbox"/> Woman-Owned Business Enterprise		
<input type="checkbox"/> Small Business Enterprise		
<input type="checkbox"/> Disabled Business Enterprise		
<input type="checkbox"/> Veteran-Owned Business Enterprise		
<input type="checkbox"/> Service-Disabled Veteran-Owned Business		
<input type="checkbox"/> HUBZone Business (Historically Underutilized) Business		
<input type="checkbox"/> Other		
<input type="checkbox"/> None		

ARTICLE 4—SAFETY

4.01 Provide information regarding Business's safety organization and safety performance.

Name of Business's Safety Officer:		
Safety Certifications		
Certification Name	Issuing Agency	Expiration

4.02 Provide Worker's Compensation Insurance Experience Modification Rate (EMR), Total Recordable Frequency Rate (TRFR) for incidents, and Total Number of Recorded Manhours (MH) for the last 3 years and the EMR, TRFR, and MH history for the last 3 years of any proposed Subcontractor(s) that will provide Work valued at 10% or more of the Contract Price. Provide documentation of the EMR history for Business and Subcontractor(s).

Year									
Company	EMR	TRFR	MH	EMR	TRFR	MH	EMR	TRFR	MH

ARTICLE 5—FINANCIAL

5.01 Provide information regarding the Business's financial stability. Provide the most recent audited financial statement, and if such audited financial statement is not current, also provide the most current financial statement.

Financial Institution:			
Business address:			
Date of Business's most recent financial statement:		<input type="checkbox"/> Attached	
Date of Business's most recent audited financial statement:		<input type="checkbox"/> Attached	
Financial indicators from the most recent financial statement			
Contractor's Current Ratio (Current Assets ÷ Current Liabilities)			
Contractor's Quick Ratio ((Cash and Cash Equivalents + Accounts Receivable + Short Term Investments) ÷ Current Liabilities)			

ARTICLE 6—SURETY INFORMATION

6.01 Provide information regarding the surety company that will issue required bonds on behalf of the Business, including but not limited to performance and payment bonds.

Surety Name:			
Surety is a corporation organized and existing under the laws of the state of:			
Is surety authorized to provide surety bonds in the Project location?		<input type="checkbox"/> Yes <input type="checkbox"/> No	
Is surety listed in “Companies Holding Certificates of Authority as Acceptable Sureties on Federal Bonds and as Acceptable Reinsuring Companies” published in Department Circular 570 (as amended) by the Bureau of the Fiscal Service, U.S. Department of the Treasury?			
<input type="checkbox"/> Yes <input type="checkbox"/> No			
Mailing Address (principal place of business):			
Physical Address (principal place of business):			
Phone (main):		Phone (claims):	

ARTICLE 7—INSURANCE

7.01 Provide information regarding Business's insurance company(s), including but not limited to its Commercial General Liability carrier. Provide information for each provider.

Name of insurance provider, and type of policy (CLE, auto, etc.):		
Insurance Provider	Type of Policy (Coverage Provided)	
Are providers licensed or authorized to issue policies in the Project location?		<input type="checkbox"/> Yes <input type="checkbox"/> No
Does provider have an A.M. Best Rating of A-VII or better?		<input type="checkbox"/> Yes <input type="checkbox"/> No
Mailing Address (principal place of business):		
Physical Address (principal place of business):		
Phone (main):		Phone (claims):

ARTICLE 8—CONSTRUCTION EXPERIENCE

8.01 Provide information that will identify the overall size and capacity of the Business.

Average number of current full-time employees:	
Estimate of revenue for the current year:	
Estimate of revenue for the previous year:	

8.02 Provide information regarding the Business's previous contracting experience.

Years of experience with projects like the proposed project:	
As a general contractor:	As a joint venturer:
Has Business, or a predecessor in interest, or an affiliate identified in Paragraph 1.03:	
Been disqualified as a bidder by any local, state, or federal agency within the last 5 years? <input type="checkbox"/> Yes <input type="checkbox"/> No	
Been barred from contracting by any local, state, or federal agency within the last 5 years? <input type="checkbox"/> Yes <input type="checkbox"/> No	
Been released from a bid in the past 5 years? <input type="checkbox"/> Yes <input type="checkbox"/> No	
Defaulted on a project or failed to complete any contract awarded to it? <input type="checkbox"/> Yes <input type="checkbox"/> No	
Refused to construct or refused to provide materials defined in the contract documents or in a change order? <input type="checkbox"/> Yes <input type="checkbox"/> No	
Been a party to any currently pending litigation or arbitration? <input type="checkbox"/> Yes <input type="checkbox"/> No	
Provide full details in a separate attachment if the response to any of these questions is Yes.	

8.03 List all projects currently under contract in Schedule A and provide indicated information.

8.04 List a minimum of three and a maximum of six projects completed in the last 5 years in Schedule B and provide indicated information to demonstrate the Business's experience with projects similar in type and cost of construction.

8.05 In Schedule C, provide information on key individuals whom Business intends to assign to the Project. Provide resumes for those individuals included in Schedule C. Key individuals include the Project Manager, Project Superintendent, Quality Manager, and Safety Manager. Resumes may be provided for Business's key leaders as well.

ARTICLE 9—REQUIRED ATTACHMENTS

9.01 Provide the following information with the Statement of Qualifications:

- If Business is a Joint Venture, separate Qualifications Statements for each Joint Venturer, as required in Paragraph 1.02.
- Diverse Business Certifications if required by Paragraph 3.01.
- Certification of Business's safety performance if required by Paragraph 4.02.
- Financial statements as required by Paragraph 5.01.

- E. Attachments providing additional information as required by Paragraph 8.02.
- F. Schedule A (Current Projects) as required by Paragraph 8.03.
- G. Schedule B (Previous Experience with Similar Projects) as required by Paragraph 8.04.
- H. Schedule C (Key Individuals) and resumes for the key individuals listed, as required by Paragraph 8.05.
- I. Additional items as pertinent.

This Statement of Qualifications is offered by:

Business: _____

(typed or printed name of organization)

By: _____

(individual's signature)

Name: _____

(typed or printed)

Title: _____

(typed or printed)

Date: _____

(date signed)

(If Business is a corporation, a partnership, or a joint venture, attach evidence of authority to sign.)

Attest: _____

(individual's signature)

Name: _____

(typed or printed)

Title: _____

(typed or printed)

Address for giving notices:

Designated Representative:

Name: _____

(typed or printed)

Title: _____

(typed or printed)

Address:

Phone:

Email:

Schedule A—Current Projects

Name of Organization					
Project Owner			Project Name		
General Description of Project					
Project Cost			Date Project		
Key Project Personnel	Project Manager	Project Superintendent	Safety Manager	Quality Control Manager	
Name					
Reference Contact Information (listing names indicates approval to contacting the names individuals as a reference)					
	Name	Title/Position	Organization	Telephone	Email
Owner					
Designer					
Construction Manager					
Project Owner			Project Name		
General Description of Project					
Project Cost			Date Project		
Key Project Personnel	Project Manager	Project Superintendent	Safety Manager	Quality Control Manager	
Name					
Reference Contact Information (listing names indicates approval to contacting the names individuals as a reference)					
	Name	Title/Position	Organization	Telephone	Email
Owner					
Designer					
Construction Manager					
Project Owner			Project Name		
General Description of Project					
Project Cost			Date Project		
Key Project Personnel	Project Manager	Project Superintendent	Safety Manager	Quality Control Manager	
Name					
Reference Contact Information (listing names indicates approval to contacting the names individuals as a reference)					
	Name	Title/Position	Organization	Telephone	Email
Owner					
Designer					
Construction Manager					

Schedule B—Previous Experience with Similar Projects

Name of Organization					
Project Owner			Project Name		
General Description of Project					
Project Cost			Date Project		
Key Project Personnel	Project Manager	Project Superintendent	Safety Manager	Quality Control Manager	
Name					
Reference Contact Information (listing names indicates approval to contacting the names individuals as a reference)					
	Name	Title/Position	Organization	Telephone	Email
Owner					
Designer					
Construction Manager					
Project Owner			Project Name		
General Description of Project					
Project Cost			Date Project		
Key Project Personnel	Project Manager	Project Superintendent	Safety Manager	Quality Control Manager	
Name					
Reference Contact Information (listing names indicates approval to contacting the names individuals as a reference)					
	Name	Title/Position	Organization	Telephone	Email
Owner					
Designer					
Construction Manager					
Project Owner			Project Name		
General Description of Project					
Project Cost			Date Project		
Key Project Personnel	Project Manager	Project Superintendent	Safety Manager	Quality Control Manager	
Name					
Reference Contact Information (listing names indicates approval to contacting the names individuals as a reference)					
	Name	Title/Position	Organization	Telephone	Email
Owner					
Designer					
Construction Manager					

Schedule B—Previous Experience with Similar Projects

Name of Organization					
Project Owner			Project Name		
General Description of Project					
Project Cost			Date Project		
Key Project Personnel	Project Manager	Project Superintendent	Safety Manager	Quality Control Manager	
Name					
Reference Contact Information (listing names indicates approval to contacting the names individuals as a reference)					
	Name	Title/Position	Organization	Telephone	Email
Owner					
Designer					
Construction Manager					
Project Owner			Project Name		
General Description of Project					
Project Cost			Date Project		
Key Project Personnel	Project Manager	Project Superintendent	Safety Manager	Quality Control Manager	
Name					
Reference Contact Information (listing names indicates approval to contacting the names individuals as a reference)					
	Name	Title/Position	Organization	Telephone	Email
Owner					
Designer					
Construction Manager					
Project Owner			Project Name		
General Description of Project					
Project Cost			Date Project		
Key Project Personnel	Project Manager	Project Superintendent	Safety Manager	Quality Control Manager	
Name					
Reference Contact Information (listing names indicates approval to contacting the names individuals as a reference)					
	Name	Title/Position	Organization	Telephone	Email
Owner					
Designer					
Construction Manager					

Schedule C—Key Individuals

Project Manager			
Name of individual			
Years of experience as project manager			
Years of experience with this organization			
Number of similar projects as project manager			
Number of similar projects in other positions			
Current Project Assignments			
Name of assignment	Percent of time used for this project	Estimated project completion date	
Reference Contact Information (listing names indicates approval to contact named individuals as a reference)			
Name	Name		
Title/Position	Title/Position		
Organization	Organization		
Telephone	Telephone		
Email	Email		
Project	Project		
Candidate's role on project	Candidate's role on project		
Project Superintendent			
Name of individual			
Years of experience as project superintendent			
Years of experience with this organization			
Number of similar projects as project superintendent			
Number of similar projects in other positions			
Current Project Assignments			
Name of assignment	Percent of time used for this project	Estimated project completion date	
Reference Contact Information (listing names indicates approval to contact named individuals as a reference)			
Name	Name		
Title/Position	Title/Position		
Organization	Organization		
Telephone	Telephone		
Email	Email		
Project	Project		
Candidate's role on project	Candidate's role on project		

Safety Manager			
Name of individual			
Years of experience as project manager			
Years of experience with this organization			
Number of similar projects as project manager			
Number of similar projects in other positions			
Current Project Assignments			
Name of assignment	Percent of time used for this project	Estimated project completion date	
Reference Contact Information (listing names indicates approval to contact named individuals as a reference)			
Name	Name		
Title/Position	Title/Position		
Organization	Organization		
Telephone	Telephone		
Email	Email		
Project	Project		
Candidate's role on project	Candidate's role on project		
Quality Control Manager			
Name of individual			
Years of experience as project superintendent			
Years of experience with this organization			
Number of similar projects as project superintendent			
Number of similar projects in other positions			
Current Project Assignments			
Name of assignment	Percent of time used for this project	Estimated project completion date	
Reference Contact Information (listing names indicates approval to contact named individuals as a reference)			
Name	Name		
Title/Position	Title/Position		
Organization	Organization		
Telephone	Telephone		
Email	Email		
Project	Project		
Candidate's role on project	Candidate's role on project		

NOTICE OF AWARD

Date of Issuance:

Owner: Tuscarora Township Owner's Project No.:
Engineer: Performance Engineers, Inc. Engineer's Project No.: 22-5797-A
Project: Tuscarora Township Sewer Extension Phase I - Gravity
Contract Name: Tuscarora Township Sewer Extension Phase I - Gravity
Bidder:
Bidder's Address:

You are notified that Owner has accepted your Bid dated **[date]** for the above Contract, and that you are the Successful Bidder and are awarded a Contract for:

The Project generally consists of constructing gravity sanitary sewer piping, manholes, cleanouts, pumping stations, and appurtenances within public road rights-of-way. The construction requires demolition and removal of surface structures, excavation, dewatering, construction, and restoration activities. **[Describe Work, alternates, or sections of Work awarded]**

The Contract Price of the awarded Contract is \$**[Contract Price]**. Contract Price is subject to adjustment based on the provisions of the Contract, including but not limited to those governing changes, Unit Price Work, and Work performed on a cost-plus-fee basis, as applicable.

[Number of copies sent] unexecuted counterparts of the Agreement accompany this Notice of Award, and one copy of the Contract Documents accompanies this Notice of Award, or has been transmitted or made available to Bidder electronically.

Drawings will be delivered separately from the other Contract Documents.

You must comply with the following conditions precedent within 15 days of the date of receipt of this Notice of Award:

1. Deliver to Owner **[number of copies sent]** counterparts of the Agreement, signed by Bidder (as Contractor).
2. Deliver with the signed Agreement(s) the Contract security (such as required performance and payment bonds) and insurance documentation, as specified in the Instructions to Bidders and in the General Conditions, Articles 2 and 6.
3. Other conditions precedent (if any): **[Describe other conditions that require Successful Bidder's compliance]**

Failure to comply with these conditions within the time specified will entitle Owner to consider you in default, annul this Notice of Award, and declare your Bid security forfeited.

Within 10 days after you comply with the above conditions, Owner will return to you one fully signed counterpart of the Agreement, together with any additional copies of the Contract Documents as indicated in Paragraph 2.02 of the General Conditions.

Owner: **[Full formal name of Owner]**

By *(signature)*: _____

Name (*printed*): _____

Title: _____

Copy: Engineer

AGREEMENT BETWEEN OWNER AND CONTRACTOR FOR CONSTRUCTION CONTRACT (STIPULATED PRICE)

This Agreement is by and between **Tuscarora Township** ("Owner") and **[name of contracting entity]** ("Contractor").

Terms used in this Agreement have the meanings stated in the General Conditions and the Supplementary Conditions.

Owner and Contractor hereby agree as follows:

ARTICLE 1—WORK

1.01 Contractor shall complete all Work as specified or indicated in the Contract Documents. The Work is generally described as follows: The Project generally consists of constructing gravity sanitary sewer piping, manholes, cleanouts, pumping stations, and appurtenances within public road rights-of-way. The construction requires demolition and removal of surface structures, excavation, dewatering, construction, and restoration activities. **[Brief description of Work]**

ARTICLE 2—THE PROJECT

2.01 The Project, of which the Work under the Contract Documents is a part, is generally described as follows: The Project generally consists of constructing gravity sanitary sewer piping, manholes, cleanouts, pumping stations, and appurtenances within public road rights-of-way. The construction requires demolition and removal of surface structures, excavation, dewatering, construction, and restoration activities. **[Brief description of Project]**

ARTICLE 3—ENGINEER

3.01 The Owner has retained **Performance Engineers, Inc.** to act as Owner's representative, assume all duties and responsibilities of Engineer, and have the rights and authority assigned to Engineer in the Contract.

3.02 The part of the Project that pertains to the Work has been designed by **Performance Engineers, Inc.**

ARTICLE 4—CONTRACT TIMES

4.01 *Time is of the Essence*

A. All time limits for Milestones, if any, Substantial Completion, and completion and readiness for final payment as stated in the Contract Documents are of the essence of the Contract.

4.02 *Contract Times: Dates*

A. The Work will be substantially complete on or before **[date]**, and completed and ready for final payment in accordance with Paragraph 15.06 of the General Conditions on or before **[date]**.

4.04 *Milestones*

A. Parts of the Work must be substantially completed on or before the following Milestone(s):

1. Milestone 1 **[event & date/days]**
2. Milestone 2 **[event & date/days]**
3. Milestone 3 **[event & date/days]**

4.05 *Liquidated Damages*

A. Contractor and Owner recognize that time is of the essence as stated in Paragraph 4.01 above and that Owner will suffer financial and other losses if the Work is not completed and Milestones not achieved within the Contract Times, as duly modified. The parties also recognize the delays, expense, and difficulties involved in proving, in a legal or arbitration proceeding, the actual loss suffered by Owner if the Work is not completed on time. Accordingly, instead of requiring any such proof, Owner and Contractor agree that as liquidated damages for delay (but not as a penalty):

1. *Substantial Completion*: Contractor shall pay Owner **\$100** for each day that expires after the time (as duly adjusted pursuant to the Contract) specified above for Substantial Completion, until the Work is substantially complete.
2. *Completion of Remaining Work*: After Substantial Completion, if Contractor shall neglect, refuse, or fail to complete the remaining Work within the Contract Times (as duly adjusted pursuant to the Contract) for completion and readiness for final payment, Contractor shall pay Owner **\$100** for each day that expires after such time until the Work is completed and ready for final payment.
3. *Milestones*: Contractor shall pay Owner **\$100** for each day that expires after the time (as duly adjusted pursuant to the Contract) specified above for achievement of Milestone 1, until Milestone 1 is achieved, or until the time specified for Substantial Completion is reached, at which time the rate indicated in Paragraph 4.05.A.1 will apply, rather than the Milestone rate.
4. Liquidated damages for failing to timely attain Milestones, Substantial Completion, and final completion are not additive, and will not be imposed concurrently.

B. If Owner recovers liquidated damages for a delay in completion by Contractor, then such liquidated damages are Owner's sole and exclusive remedy for such delay, and Owner is precluded from recovering any other damages, whether actual, direct, excess, or consequential, for such delay, except for special damages (if any) specified in this Agreement.

C. **Deleted**

4.06 *Special Damages*

A. Contractor shall reimburse Owner (1) for any fines or penalties imposed on Owner as a direct result of the Contractor's failure to attain Substantial Completion according to the Contract Times, and (2) for the actual costs reasonably incurred by Owner for engineering, construction observation, inspection, and administrative services needed after the time specified in

Paragraph 4.02 for Substantial Completion (as duly adjusted pursuant to the Contract), until the Work is substantially complete.

- B. After Contractor achieves Substantial Completion, if Contractor shall neglect, refuse, or fail to complete the remaining Work within the Contract Times, Contractor shall reimburse Owner for the actual costs reasonably incurred by Owner for engineering, construction observation, inspection, and administrative services needed after the time specified in Paragraph 4.02 for Work to be completed and ready for final payment (as duly adjusted pursuant to the Contract), until the Work is completed and ready for final payment.
- C. The special damages imposed in this paragraph are supplemental to any liquidated damages for delayed completion established in this Agreement.

ARTICLE 5—CONTRACT PRICE

5.01 Owner shall pay Contractor for completion of the Work in accordance with the Contract Documents, the amounts that follow, subject to adjustment under the Contract:

- A. For all Work other than Unit Price Work, a lump sum of \$[number].
All specific cash allowances are included in the above price in accordance with Paragraph 13.02 of the General Conditions.
- B. For all Unit Price Work, an amount equal to the sum of the extended prices (established for each separately identified item of Unit Price Work by multiplying the unit price times the actual quantity of that item).

Unit Price Work					
Item No.	Description	Unit	Estimated Quantity	Unit Price	Extended Price
				\$	\$
				\$	\$
				\$	\$
				\$	\$
				\$	\$
Total of all Extended Prices for Unit Price Work (subject to final adjustment based on actual quantities)					\$

The extended prices for Unit Price Work set forth as of the Effective Date of the Contract are based on estimated quantities. As provided in Paragraph 13.03 of the General Conditions, estimated quantities are not guaranteed, and determinations of actual quantities and classifications are to be made by Engineer.

- C. Total of Lump Sum Amount and Unit Price Work (subject to final Unit Price adjustment) \$[number].
- D. For all Work, at the prices stated in Contractor's Bid, attached hereto as an exhibit.

ARTICLE 6—PAYMENT PROCEDURES

6.01 *Submittal and Processing of Payments*

- A. Contractor shall submit Applications for Payment in accordance with Article 15 of the General Conditions. Applications for Payment will be processed by Engineer as provided in the General Conditions.

6.02 *Progress Payments; Retainage*

- A. Owner shall make progress payments on the basis of Contractor's Applications for Payment on or about the **[ordinal number, such as 5th]** day of each month during performance of the Work as provided in Paragraph 6.02.A.1 below, provided that such Applications for Payment have been submitted in a timely manner and otherwise meet the requirements of the Contract. All such payments will be measured by the Schedule of Values established as provided in the General Conditions (and in the case of Unit Price Work based on the number of units completed) or, in the event there is no Schedule of Values, as provided elsewhere in the Contract.

1. Prior to Substantial Completion, progress payments will be made in an amount equal to the percentage indicated below but, in each case, less the aggregate of payments previously made and less such amounts as Owner may withhold, including but not limited to liquidated damages, in accordance with the Contract.
 - a. **95** percent of the value of the Work completed (with the balance being retainage).
 - b. **95** percent of cost of materials and equipment not incorporated in the Work (with the balance being retainage).

- B. Upon Substantial Completion **of the entire construction to be provided under the construction Contract Documents**, Owner shall pay an amount sufficient to increase total payments to Contractor to **100** percent of the Work completed, less such amounts set off by Owner pursuant to Paragraph 15.01.E of the General Conditions, and less **200** percent of Engineer's estimate of the value of Work to be completed or corrected as shown on the punch list of items to be completed or corrected prior to final payment.

6.03 *Final Payment*

- A. Upon final completion and acceptance of the Work, Owner shall pay the remainder of the Contract Price in accordance with Paragraph 15.06 of the General Conditions.

6.04 *Consent of Surety*

- A. Owner will not make final payment, or return or release retainage at Substantial Completion or any other time, unless Contractor submits written consent of the surety to such payment, return, or release.

6.05 *Interest*

- A. All amounts not paid when due will bear interest at the rate of **[number]** percent per annum.

ARTICLE 7—CONTRACT DOCUMENTS

7.01 *Contents*

- A. The Contract Documents consist of all of the following:
 1. This Agreement.
 2. Bonds:
 - a. Performance bond (together with power of attorney).
 - b. Payment bond (together with power of attorney).
 3. General Conditions.
 4. Supplementary Conditions.
 5. Specifications as listed in the table of contents of the project manual (copy of list attached).
 6. Drawings (not attached but incorporated by reference) consisting of **[number]** sheets with each sheet bearing the following general title: **Tuscarora Township Sewer Extension Phase I.**
 7. Addenda (numbers **[number]** to **[number]**, inclusive).
 8. Exhibits to this Agreement (enumerated as follows):
 - a. **[list exhibits]**
 9. The following which may be delivered or issued on or after the Effective Date of the Contract and are not attached hereto:
 - a. Notice to Proceed.
 - b. Work Change Directives.
 - c. Change Orders.
 - d. Field Orders.
 - e. Warranty Bond, if any.
 10. The Contract Documents listed in Paragraph 7.01.A are attached to this Agreement (except as expressly noted otherwise above).
 11. There are no Contract Documents other than those listed above in this Article 7.
 12. The Contract Documents may only be amended, modified, or supplemented as provided in the Contract.

ARTICLE 8—REPRESENTATIONS, CERTIFICATIONS, AND STIPULATIONS

8.01 *Contractor's Representations*

- A. In order to induce Owner to enter into this Contract, Contractor makes the following representations:

1. Contractor has examined and carefully studied the Contract Documents, including Addenda.
2. Contractor has visited the Site, conducted a thorough visual examination of the Site and adjacent areas, and become familiar with the general, local, and Site conditions that may affect cost, progress, and performance of the Work.
3. Contractor is familiar with all Laws and Regulations that may affect cost, progress, and performance of the Work.
4. Contractor has carefully studied the reports of explorations and tests of subsurface conditions at or adjacent to the Site and the drawings of physical conditions relating to existing surface or subsurface structures at the Site that have been identified in the Supplementary Conditions, with respect to the Technical Data in such reports and drawings.
5. Contractor has carefully studied the reports and drawings relating to Hazardous Environmental Conditions, if any, at or adjacent to the Site that have been identified in the Supplementary Conditions, with respect to Technical Data in such reports and drawings.
6. Contractor has considered the information known to Contractor itself; information commonly known to contractors doing business in the locality of the Site; information and observations obtained from visits to the Site; the Contract Documents; and the Technical Data identified in the Supplementary Conditions or by definition, with respect to the effect of such information, observations, and Technical Data on (a) the cost, progress, and performance of the Work; (b) the means, methods, techniques, sequences, and procedures of construction to be employed by Contractor; and (c) Contractor's safety precautions and programs.
7. Based on the information and observations referred to in the preceding paragraph, Contractor agrees that no further examinations, investigations, explorations, tests, studies, or data are necessary for the performance of the Work at the Contract Price, within the Contract Times, and in accordance with the other terms and conditions of the Contract.
8. Contractor is aware of the general nature of work to be performed by Owner and others at the Site that relates to the Work as indicated in the Contract Documents.
9. Contractor has given Engineer written notice of all conflicts, errors, ambiguities, or discrepancies that Contractor has discovered in the Contract Documents, and of discrepancies between Site conditions and the Contract Documents, and the written resolution thereof by Engineer is acceptable to Contractor.
10. The Contract Documents are generally sufficient to indicate and convey understanding of all terms and conditions for performance and furnishing of the Work.
11. Contractor's entry into this Contract constitutes an incontrovertible representation by Contractor that without exception all prices in the Agreement are premised upon performing and furnishing the Work required by the Contract Documents.

8.02 *Contractor's Certifications*

A. Contractor certifies that it has not engaged in corrupt, fraudulent, collusive, or coercive practices in competing for or in executing the Contract. For the purposes of this Paragraph 8.02:

1. “corrupt practice” means the offering, giving, receiving, or soliciting of anything of value likely to influence the action of a public official in the bidding process or in the Contract execution;
2. “fraudulent practice” means an intentional misrepresentation of facts made (a) to influence the bidding process or the execution of the Contract to the detriment of Owner, (b) to establish Bid or Contract prices at artificial non-competitive levels, or (c) to deprive Owner of the benefits of free and open competition;
3. “collusive practice” means a scheme or arrangement between two or more Bidders, with or without the knowledge of Owner, a purpose of which is to establish Bid prices at artificial, non-competitive levels; and
4. “coercive practice” means harming or threatening to harm, directly or indirectly, persons or their property to influence their participation in the bidding process or affect the execution of the Contract.

8.03 *Standard General Conditions*

A. Owner stipulates that if the General Conditions that are made a part of this Contract are EJCDC® C-700, Standard General Conditions for the Construction Contract (2018), published by the Engineers Joint Contract Documents Committee, and if Owner is the party that has furnished said General Conditions, then Owner has plainly shown all modifications to the standard wording of such published document to the Contractor, through a process such as highlighting or “track changes” (redline/strikeout), or in the Supplementary Conditions.

IN WITNESS WHEREOF, Owner and Contractor have signed this Agreement.

This Agreement will be effective on [indicate date on which Contract becomes effective] (which is the Effective Date of the Contract).

Owner:

(typed or printed name of organization)

By:

(individual's signature)

Date:

(date signed)

Name:

(typed or printed)

Title:

(typed or printed)

Attest:

(individual's signature)

Title:

(typed or printed)

Address for giving notices:

Designated Representative:

Name: _____
(typed or printed)

Title: _____
(typed or printed)

Address:

Phone: _____

Email: _____

(If [Type of Entity] is a corporation, attach evidence of authority to sign. If [Type of Entity] is a public body, attach evidence of authority to sign and resolution or other documents authorizing execution of this Agreement.)

Contractor:

(typed or printed name of organization)

By:

(individual's signature)

Date:

(date signed)

Name:

(typed or printed)

Title:

(typed or printed)

(If [Type of Entity] is a corporation, a partnership, or a joint venture, attach evidence of authority to sign.)

Attest:

(individual's signature)

Title:

(typed or printed)

Address for giving notices:

Designated Representative:

Name: _____
(typed or printed)

Title: _____
(typed or printed)

Address:

Phone: _____

Email: _____

License No.: _____
(where applicable)

State: _____

NOTICE TO PROCEED

Owner: Tuscarora Township Owner's Project No.: _____
Engineer: Performance Engineers, Inc. Engineer's Project No.: 22-5797-A
Contractor: _____ Contractor's Project No.: _____
Project: Tuscarora Township Sewer Extension Phase I - Gravity
Contract Name: Tuscarora Township Sewer Extension Phase I - Gravity
Effective Date of Contract: _____

Owner hereby notifies Contractor that the Contract Times under the above Contract will commence to run on **[date Contract Times are to start]** pursuant to Paragraph 4.01 of the General Conditions.

On that date, Contractor shall start performing its obligations under the Contract Documents. No Work will be done at the Site prior to such date.

In accordance with the Agreement

The date by which Substantial Completion must be achieved is **[date for Substantial Completion, from Agreement]**, and the date by which readiness for final payment must be achieved is **[date for readiness, from Agreement]**.

Before starting any Work at the Site, Contractor must comply with the following:

[Note any access limitations, security procedures, or other restrictions]

Owner: Tuscarora Township
By *(signature)*: _____
Name *(printed)*: _____
Title: _____
Date Issued: _____
Copy: Engineer

PERFORMANCE BOND

Contractor Name: [Full formal name of Contractor] Address (<i>principal place of business</i>): [Address of Contractor's principal place of business]	Surety Name: [Full formal name of Surety] Address (<i>principal place of business</i>): [Address of Surety's principal place of business]
Owner Name: Tuscarora Township Mailing address (<i>principal place of business</i>): 3546 S Straits Highway Indian River, MI 49749	Contract Description (<i>name and location</i>): Tuscarora Township Sewer Extension Phase I - Gravity Contract Price: [Amount from Contract] Effective Date of Contract: [Date from Contract]
Bond Bond Amount: [Amount] Date of Bond: [Date] <small>(Date of Bond cannot be earlier than Effective Date of Contract)</small> Modifications to this Bond form: <input type="checkbox"/> None <input type="checkbox"/> See Paragraph 16	
Surety and Contractor, intending to be legally bound hereby, subject to the terms set forth in this Performance Bond, do each cause this Performance Bond to be duly executed by an authorized officer, agent, or representative.	
Contractor as Principal	Surety
<small>(Full formal name of Contractor)</small> By: _____ <small>(Signature)</small> Name: _____ <small>(Printed or typed)</small> Title: _____ Attest: _____ <small>(Signature)</small> Name: _____ <small>(Printed or typed)</small> Title: _____	
<small>(Full formal name of Surety) (corporate seal)</small> By: _____ <small>(Signature)(Attach Power of Attorney)</small> Name: _____ <small>(Printed or typed)</small> Title: _____ Attest: _____ <small>(Signature)</small> Name: _____ <small>(Printed or typed)</small> Title: _____	
<small>Notes: (1) Provide supplemental execution by any additional parties, such as joint venturers. (2) Any singular reference to Contractor, Surety, Owner, or other party is considered plural where applicable.</small>	

1. The Contractor and Surety, jointly and severally, bind themselves, their heirs, executors, administrators, successors, and assigns to the Owner for the performance of the Construction Contract, which is incorporated herein by reference.
2. If the Contractor performs the Construction Contract, the Surety and the Contractor shall have no obligation under this Bond, except when applicable to participate in a conference as provided in Paragraph 3.
3. If there is no Owner Default under the Construction Contract, the Surety's obligation under this Bond will arise after:
 - 3.1. The Owner first provides notice to the Contractor and the Surety that the Owner is considering declaring a Contractor Default. Such notice may indicate whether the Owner is requesting a conference among the Owner, Contractor, and Surety to discuss the Contractor's performance. If the Owner does not request a conference, the Surety may, within five (5) business days after receipt of the Owner's notice, request such a conference. If the Surety timely requests a conference, the Owner shall attend. Unless the Owner agrees otherwise, any conference requested under this Paragraph 3.1 will be held within ten (10) business days of the Surety's receipt of the Owner's notice. If the Owner, the Contractor, and the Surety agree, the Contractor shall be allowed a reasonable time to perform the Construction Contract, but such an agreement does not waive the Owner's right, if any, subsequently to declare a Contractor Default;
 - 3.2. The Owner declares a Contractor Default, terminates the Construction Contract and notifies the Surety; and
 - 3.3. The Owner has agreed to pay the Balance of the Contract Price in accordance with the terms of the Construction Contract to the Surety or to a contractor selected to perform the Construction Contract.
4. Failure on the part of the Owner to comply with the notice requirement in Paragraph 3.1 does not constitute a failure to comply with a condition precedent to the Surety's obligations, or release the Surety from its obligations, except to the extent the Surety demonstrates actual prejudice.
5. When the Owner has satisfied the conditions of Paragraph 3, the Surety shall promptly and at the Surety's expense take one of the following actions:
 - 5.1. Arrange for the Contractor, with the consent of the Owner, to perform and complete the Construction Contract;
 - 5.2. Undertake to perform and complete the Construction Contract itself, through its agents or independent contractors;
 - 5.3. Obtain bids or negotiated proposals from qualified contractors acceptable to the Owner for a contract for performance and completion of the Construction Contract, arrange for a contract to be prepared for execution by the Owner and a contractor selected with the Owners concurrence, to be secured with performance and payment bonds executed by a qualified surety equivalent to the bonds issued on the Construction Contract, and pay to the Owner the amount of damages as described in Paragraph 7 in excess of the Balance of the Contract Price incurred by the Owner as a result of the Contractor Default; or
 - 5.4. Waive its right to perform and complete, arrange for completion, or obtain a new contractor, and with reasonable promptness under the circumstances:

- 5.4.1 After investigation, determine the amount for which it may be liable to the Owner and, as soon as practicable after the amount is determined, make payment to the Owner; or
- 5.4.2 Deny liability in whole or in part and notify the Owner, citing the reasons for denial.

6. If the Surety does not proceed as provided in Paragraph 5 with reasonable promptness, the Surety shall be deemed to be in default on this Bond seven days after receipt of an additional written notice from the Owner to the Surety demanding that the Surety perform its obligations under this Bond, and the Owner shall be entitled to enforce any remedy available to the Owner. If the Surety proceeds as provided in Paragraph 5.4, and the Owner refuses the payment, or the Surety has denied liability, in whole or in part, without further notice, the Owner shall be entitled to enforce any remedy available to the Owner.
7. If the Surety elects to act under Paragraph 5.1, 5.2, or 5.3, then the responsibilities of the Surety to the Owner will not be greater than those of the Contractor under the Construction Contract, and the responsibilities of the Owner to the Surety will not be greater than those of the Owner under the Construction Contract. Subject to the commitment by the Owner to pay the Balance of the Contract Price, the Surety is obligated, without duplication for:
 - 7.1. the responsibilities of the Contractor for correction of defective work and completion of the Construction Contract;
 - 7.2. additional legal, design professional, and delay costs resulting from the Contractor's Default, and resulting from the actions or failure to act of the Surety under Paragraph 5; and
 - 7.3. liquidated damages, or if no liquidated damages are specified in the Construction Contract, actual damages caused by delayed performance or non-performance of the Contractor.
8. If the Surety elects to act under Paragraph 5.1, 5.3, or 5.4, the Surety's liability is limited to the amount of this Bond.
9. The Surety shall not be liable to the Owner or others for obligations of the Contractor that are unrelated to the Construction Contract, and the Balance of the Contract Price will not be reduced or set off on account of any such unrelated obligations. No right of action will accrue on this Bond to any person or entity other than the Owner or its heirs, executors, administrators, successors, and assigns.
10. The Surety hereby waives notice of any change, including changes of time, to the Construction Contract or to related subcontracts, purchase orders, and other obligations.
11. Any proceeding, legal or equitable, under this Bond must be instituted in any court of competent jurisdiction in the location in which the work or part of the work is located and must be instituted within two years after a declaration of Contractor Default or within two years after the Contractor ceased working or within two years after the Surety refuses or fails to perform its obligations under this Bond, whichever occurs first. If the provisions of this paragraph are void or prohibited by law, the minimum periods of limitations available to sureties as a defense in the jurisdiction of the suit will be applicable.
12. Notice to the Surety, the Owner, or the Contractor must be mailed or delivered to the address shown on the page on which their signature appears.
13. When this Bond has been furnished to comply with a statutory or other legal requirement in the location where the construction was to be performed, any provision in this Bond conflicting with said statutory or legal requirement will be deemed deleted therefrom and provisions conforming to such

statutory or other legal requirement will be deemed incorporated herein. When so furnished, the intent is that this Bond will be construed as a statutory bond and not as a common law bond.

14. Definitions

- 14.1. *Balance of the Contract Price*—The total amount payable by the Owner to the Contractor under the Construction Contract after all proper adjustments have been made including allowance for the Contractor for any amounts received or to be received by the Owner in settlement of insurance or other claims for damages to which the Contractor is entitled, reduced by all valid and proper payments made to or on behalf of the Contractor under the Construction Contract.
- 14.2. *Construction Contract*—The agreement between the Owner and Contractor identified on the cover page, including all Contract Documents and changes made to the agreement and the Contract Documents.
- 14.3. *Contractor Default*—Failure of the Contractor, which has not been remedied or waived, to perform or otherwise to comply with a material term of the Construction Contract.
- 14.4. *Owner Default*—Failure of the Owner, which has not been remedied or waived, to pay the Contractor as required under the Construction Contract or to perform and complete or comply with the other material terms of the Construction Contract.
- 14.5. *Contract Documents*—All the documents that comprise the agreement between the Owner and Contractor.

15. If this Bond is issued for an agreement between a contractor and subcontractor, the term Contractor in this Bond will be deemed to be Subcontractor and the term Owner will be deemed to be Contractor.

16. Modifications to this Bond are as follows: **[Describe modification or enter “None”]**

PAYMENT BOND

Contractor Name: [Full formal name of Contractor] Address (<i>principal place of business</i>): [Address of Contractor's principal place of business]	Surety Name: [Full formal name of Surety] Address (<i>principal place of business</i>): [Address of Surety's principal place of business]
Owner Name: Tuscarora Township Mailing address (<i>principal place of business</i>): 3546 S Straits Highway Indian River, MI 49749	Contract Description (<i>name and location</i>): Tuscarora Township Sewer Extension Phase I - Gravity Contract Price: [Amount, from Contract] Effective Date of Contract: [Date, from Contract]
Bond Bond Amount: [Amount] Date of Bond: [Date] <i>(Date of Bond cannot be earlier than Effective Date of Contract)</i> Modifications to this Bond form: <input type="checkbox"/> None <input type="checkbox"/> See Paragraph 18	
Surety and Contractor, intending to be legally bound hereby, subject to the terms set forth in this Payment Bond, do each cause this Payment Bond to be duly executed by an authorized officer, agent, or representative.	
Contractor as Principal <i>(Full formal name of Contractor)</i> By: _____ <i>(Signature)</i> Name: _____ <i>(Printed or typed)</i> Title: _____ Attest: _____ <i>(Signature)</i> Name: _____ <i>(Printed or typed)</i> Title: _____	Surety <i>(Full formal name of Surety) (corporate seal)</i> By: _____ <i>(Signature)(Attach Power of Attorney)</i> Name: _____ <i>(Printed or typed)</i> Title: _____ Attest: _____ <i>(Signature)</i> Name: _____ <i>(Printed or typed)</i> Title: _____
<i>Notes: (1) Provide supplemental execution by any additional parties, such as joint venturers. (2) Any singular reference to Contractor, Surety, Owner, or other party is considered plural where applicable.</i>	

1. The Contractor and Surety, jointly and severally, bind themselves, their heirs, executors, administrators, successors, and assigns to the Owner to pay for labor, materials, and equipment furnished for use in the performance of the Construction Contract, which is incorporated herein by reference, subject to the following terms.
2. If the Contractor promptly makes payment of all sums due to Claimants, and defends, indemnifies, and holds harmless the Owner from claims, demands, liens, or suits by any person or entity seeking payment for labor, materials, or equipment furnished for use in the performance of the Construction Contract, then the Surety and the Contractor shall have no obligation under this Bond.
3. If there is no Owner Default under the Construction Contract, the Surety's obligation to the Owner under this Bond will arise after the Owner has promptly notified the Contractor and the Surety (at the address described in Paragraph 13) of claims, demands, liens, or suits against the Owner or the Owner's property by any person or entity seeking payment for labor, materials, or equipment furnished for use in the performance of the Construction Contract, and tendered defense of such claims, demands, liens, or suits to the Contractor and the Surety.
4. When the Owner has satisfied the conditions in Paragraph 3, the Surety shall promptly and at the Surety's expense defend, indemnify, and hold harmless the Owner against a duly tendered claim, demand, lien, or suit.
5. The Surety's obligations to a Claimant under this Bond will arise after the following:
 - 5.1. Claimants who do not have a direct contract with the Contractor
 - 5.1.1. have furnished a written notice of non-payment to the Contractor, stating with substantial accuracy the amount claimed and the name of the party to whom the materials were, or equipment was, furnished or supplied or for whom the labor was done or performed, within ninety (90) days after having last performed labor or last furnished materials or equipment included in the Claim; and
 - 5.1.2. have sent a Claim to the Surety (at the address described in Paragraph 13).
 - 5.2. Claimants who are employed by or have a direct contract with the Contractor have sent a Claim to the Surety (at the address described in Paragraph 13).
6. If a notice of non-payment required by Paragraph 5.1.1 is given by the Owner to the Contractor, that is sufficient to satisfy a Claimant's obligation to furnish a written notice of non-payment under Paragraph 5.1.1.
7. When a Claimant has satisfied the conditions of Paragraph 5.1 or 5.2, whichever is applicable, the Surety shall promptly and at the Surety's expense take the following actions:
 - 7.1. Send an answer to the Claimant, with a copy to the Owner, within sixty (60) days after receipt of the Claim, stating the amounts that are undisputed and the basis for challenging any amounts that are disputed; and
 - 7.2. Pay or arrange for payment of any undisputed amounts.
 - 7.3. The Surety's failure to discharge its obligations under Paragraph 7.1 or 7.2 will not be deemed to constitute a waiver of defenses the Surety or Contractor may have or acquire as to a Claim, except as to undisputed amounts for which the Surety and Claimant have reached agreement. If, however, the Surety fails to discharge its obligations under Paragraph 7.1 or 7.2, the Surety shall indemnify the Claimant for the reasonable attorney's fees the Claimant incurs thereafter to recover any sums found to be due and owing to the Claimant.

8. The Surety's total obligation will not exceed the amount of this Bond, plus the amount of reasonable attorney's fees provided under Paragraph 7.3, and the amount of this Bond will be credited for any payments made in good faith by the Surety.
9. Amounts owed by the Owner to the Contractor under the Construction Contract will be used for the performance of the Construction Contract and to satisfy claims, if any, under any construction performance bond. By the Contractor furnishing and the Owner accepting this Bond, they agree that all funds earned by the Contractor in the performance of the Construction Contract are dedicated to satisfying obligations of the Contractor and Surety under this Bond, subject to the Owner's priority to use the funds for the completion of the work.
10. The Surety shall not be liable to the Owner, Claimants, or others for obligations of the Contractor that are unrelated to the Construction Contract. The Owner shall not be liable for the payment of any costs or expenses of any Claimant under this Bond, and shall have under this Bond no obligation to make payments to or give notice on behalf of Claimants, or otherwise have any obligations to Claimants under this Bond.
11. The Surety hereby waives notice of any change, including changes of time, to the Construction Contract or to related subcontracts, purchase orders, and other obligations.
12. No suit or action will be commenced by a Claimant under this Bond other than in a court of competent jurisdiction in the state in which the project that is the subject of the Construction Contract is located or after the expiration of one year from the date (1) on which the Claimant sent a Claim to the Surety pursuant to Paragraph 5.1.2 or 5.2, or (2) on which the last labor or service was performed by anyone or the last materials or equipment were furnished by anyone under the Construction Contract, whichever of (1) or (2) first occurs. If the provisions of this paragraph are void or prohibited by law, the minimum period of limitation available to sureties as a defense in the jurisdiction of the suit will be applicable.
13. Notice and Claims to the Surety, the Owner, or the Contractor must be mailed or delivered to the address shown on the page on which their signature appears. Actual receipt of notice or Claims, however accomplished, will be sufficient compliance as of the date received.
14. When this Bond has been furnished to comply with a statutory or other legal requirement in the location where the construction was to be performed, any provision in this Bond conflicting with said statutory or legal requirement will be deemed deleted here from and provisions conforming to such statutory or other legal requirement will be deemed incorporated herein. When so furnished, the intent is that this Bond will be construed as a statutory bond and not as a common law bond.
15. Upon requests by any person or entity appearing to be a potential beneficiary of this Bond, the Contractor and Owner shall promptly furnish a copy of this Bond or shall permit a copy to be made.
16. Definitions
 - 16.1. *Claim*—A written statement by the Claimant including at a minimum:
 - 16.1.1. The name of the Claimant;
 - 16.1.2. The name of the person for whom the labor was done, or materials or equipment furnished;
 - 16.1.3. A copy of the agreement or purchase order pursuant to which labor, materials, or equipment was furnished for use in the performance of the Construction Contract;
 - 16.1.4. A brief description of the labor, materials, or equipment furnished;

- 16.1.5. The date on which the Claimant last performed labor or last furnished materials or equipment for use in the performance of the Construction Contract;
- 16.1.6. The total amount earned by the Claimant for labor, materials, or equipment furnished as of the date of the Claim;
- 16.1.7. The total amount of previous payments received by the Claimant; and
- 16.1.8. The total amount due and unpaid to the Claimant for labor, materials, or equipment furnished as of the date of the Claim.

16.2. *Claimant*—An individual or entity having a direct contract with the Contractor or with a subcontractor of the Contractor to furnish labor, materials, or equipment for use in the performance of the Construction Contract. The term Claimant also includes any individual or entity that has rightfully asserted a claim under an applicable mechanic's lien or similar statute against the real property upon which the Project is located. The intent of this Bond is to include without limitation in the terms of "labor, materials, or equipment" that part of the water, gas, power, light, heat, oil, gasoline, telephone service, or rental equipment used in the Construction Contract, architectural and engineering services required for performance of the work of the Contractor and the Contractor's subcontractors, and all other items for which a mechanic's lien may be asserted in the jurisdiction where the labor, materials, or equipment were furnished.

16.3. *Construction Contract*—The agreement between the Owner and Contractor identified on the cover page, including all Contract Documents and all changes made to the agreement and the Contract Documents.

16.4. *Owner Default*—Failure of the Owner, which has not been remedied or waived, to pay the Contractor as required under the Construction Contract or to perform and complete or comply with the other material terms of the Construction Contract.

16.5. *Contract Documents*—All the documents that comprise the agreement between the Owner and Contractor.

17. If this Bond is issued for an agreement between a contractor and subcontractor, the term Contractor in this Bond will be deemed to be Subcontractor and the term Owner will be deemed to be Contractor.

18. Modifications to this Bond are as follows: **[Describe modification or enter "None"]**

Contractor's Application for Payment

Owner: Tuscaroa Township	Owner's Project No.:
Engineer: Performance Engineers, Inc.	Engineer's Project No.: 22-5797-A
Contractor:	Contractor's Project No.:
Project: Tuscaroa Township Sewer Extension Phase I - Gravity	
Contract: 22-5797-A	
Application No.:	Application Date:
Application Period: From _____	to _____
1. Original Contract Price	\$ -
2. Net change by Change Orders	\$ -
3. Current Contract Price (Line 1 + Line 2)	\$ -
4. Total Work completed and materials stored to date (Sum of Column G Lump Sum Total and Column J Unit Price Total)	\$ -
5. Retainage	
a. _____ X \$ -	Work Completed = \$ -
b. _____ X \$ -	Stored Materials = \$ -
c. Total Retainage (Line 5.a + Line 5.b)	\$ -
6. Amount eligible to date (Line 4 - Line 5.c)	\$ -
7. Less previous payments (Line 6 from prior application)	
8. Amount due this application	\$ -
9. Balance to finish, including retainage (Line 3 - Line 4 + Line 5.c)	\$ -
Contractor's Certification	
The undersigned Contractor certifies, to the best of its knowledge, the following:	
(1) All previous progress payments received from Owner on account of Work done under the Contract have been applied on account to discharge Contractor's legitimate obligations incurred in connection with the Work covered by prior Applications for Payment;	
(2) Title to all Work, materials and equipment incorporated in said Work, or otherwise listed in or covered by this Application for Payment, will pass to Owner at time of payment free and clear of all liens, security interests, and encumbrances (except such as are covered by a bond acceptable to Owner indemnifying Owner against any such liens, security interest, or encumbrances); and	
(3) All the Work covered by this Application for Payment is in accordance with the Contract Documents and is not defective.	
Contractor: _____	
Signature: _____	Date: _____
Recommended by Engineer	
By: _____	Approved by Owner
Title: _____	By: _____
Date: _____	Title: _____
Approved by Funding Agency	
By: _____	By: _____
Title: _____	Title: _____
Date: _____	Date: _____

Progress Estimate - Lump Sum Work

Contractor's Application for Payment

Owner: Tuscaroa Township
Engineer: Performance Engineers, Inc.
Contractor:
Project: Tuscarora Township Sewer Extension Phase I - Gravity
Contract: 22-5797-A

Owner's Project No.: _____
Engineer's Project No.: 22-5797-A
Contractor's Project No.: _____

Application No.: _____ **Application Period:** **From** _____ **to** _____ **Application Date:** _____

Progress Estimate - Lump Sum Work

Contractor's Application for Payment

Owner: Tuscaroa Township
Engineer: Performance Engineers, Inc.
Contractor:
Project: Tuscarora Township Sewer Extension Phase I - Gravity
Contract: 22-5797-A

Owner's Project No.: _____
Engineer's Project No.: 22-5797-A
Contractor's Project No.: _____

Application No.: _____ Application Period: From _____ to _____ Application Date: _____

Progress Estimate - Unit Price Work

Owner:	Tuscaroa Township
Engineer:	Performance Engineers, Inc.
Contractor:	
Project:	Tuscarora Township Sewer Extension Phase I - Gravity
Contract:	22-5797-A

Contractor's Application for Payment

Owner's Project No.: _____
Engineer's Project No.: 22-5797-A
Contractor's Project No.: _____

Progress Estimate - Unit Price Work

Owner:	Tuscaroa Township
Engineer:	Performance Engineers, Inc.
Contractor:	
Project:	Tuscarora Township Sewer Extension Phase I - Gravity
Contract:	22-5797-A

Contractor's Application for Payment

Owner's Project No.: _____
Engineer's Project No.: 22-5797-A
Contractor's Project No.: _____

Stored Materials Summary

Contractor's Application for Payment

Owner: Tuscaroa Township
Engineer: Performance Engineers, Inc.
Contractor: _____
Project: Tuscarora Township Sewer Extension Phase I - Gravity
Contract: 22-5797-A

Owner's Project No.: _____
Engineer's Project No.: _____
Contractor's Project No.: _____

CERTIFICATE OF SUBSTANTIAL COMPLETION

Owner: Tuscarora Township Owner's Project No.:
Engineer: Performance Engineers, Inc. Engineer's Project No.: 22-5797-A
Contractor: Contractor's Project No.:
Project: Tuscarora Township Sewer Extension Phase I - Gravity
Contract Name: Tuscarora Township Sewer Extension Phase I - Gravity

This Preliminary Final Certificate of Substantial Completion applies to:

All Work The following specified portions of the Work:

[Describe the portion of the work for which Certificate of Substantial Completion is issued]

Date of Substantial Completion: **[Enter date, as determined by Engineer]**

The Work to which this Certificate applies has been inspected by authorized representatives of Owner, Contractor, and Engineer, and found to be substantially complete. The Date of Substantial Completion of the Work or portion thereof designated above is hereby established, subject to the provisions of the Contract pertaining to Substantial Completion. The date of Substantial Completion in the final Certificate of Substantial Completion marks the commencement of the contractual correction period and applicable warranties required by the Contract.

A punch list of items to be completed or corrected is attached to this Certificate. This list may not be all-inclusive, and the failure to include any items on such list does not alter the responsibility of the Contractor to complete all Work in accordance with the Contract Documents.

Amendments of contractual responsibilities recorded in this Certificate should be the product of mutual agreement of Owner and Contractor; see Paragraph 15.03.D of the General Conditions.

The responsibilities between Owner and Contractor for security, operation, safety, maintenance, heat, utilities, insurance, and warranties upon Owner's use or occupancy of the Work must be as provided in the Contract, except as amended as follows:

Amendments to Owner's Responsibilities: None As follows:

[List amendments to Owner's Responsibilities]

Amendments to Contractor's Responsibilities: None As follows:

[List amendments to Contractor's Responsibilities]

The following documents are attached to and made a part of this Certificate:

[List attachments such as punch list; other documents]

This Certificate does not constitute an acceptance of Work not in accordance with the Contract Documents, nor is it a release of Contractor's obligation to complete the Work in accordance with the Contract Documents.

Engineer

By (signature): _____

Name (printed): _____

Title: _____

NOTICE OF ACCEPTABILITY OF WORK

Owner: Tuscarora Township Owner's Project No.:
Engineer: Performance Engineers, Inc. Engineer's Project No.: 22-5797-A
Contractor: Contractor's Project No.:
Project: Tuscarora Township Sewer Extension Phase I - Gravity
Contract Name: Tuscarora Township Sewer Extension Phase I - Gravity
Notice Date: Effective Date of the Construction Contract:

The Engineer hereby gives notice to the Owner and Contractor that Engineer recommends final payment to Contractor, and that the Work furnished and performed by Contractor under the Construction Contract is acceptable, expressly subject to the provisions of the Construction Contract's Contract Documents ("Contract Documents") and of the Agreement between Owner and Engineer for Professional Services dated **[date of professional services agreement]** ("Owner-Engineer Agreement"). This Notice of Acceptability of Work (Notice) is made expressly subject to the following terms and conditions to which all who receive and rely on said Notice agree:

1. This Notice has been prepared with the skill and care ordinarily used by members of the engineering profession practicing under similar conditions at the same time and in the same locality.
2. This Notice reflects and is an expression of the Engineer's professional opinion.
3. This Notice has been prepared to the best of Engineer's knowledge, information, and belief as of the Notice Date.
4. This Notice is based entirely on and expressly limited by the scope of services Engineer has been employed by Owner to perform or furnish during construction of the Project (including observation of the Contractor's Work) under the Owner-Engineer Agreement, and applies only to facts that are within Engineer's knowledge or could reasonably have been ascertained by Engineer as a result of carrying out the responsibilities specifically assigned to Engineer under such Owner-Engineer Agreement.
5. This Notice is not a guarantee or warranty of Contractor's performance under the Construction Contract, an acceptance of Work that is not in accordance with the Contract Documents, including but not limited to defective Work discovered after final inspection, nor an assumption of responsibility for any failure of Contractor to furnish and perform the Work thereunder in accordance with the Contract Documents, or to otherwise comply with the Contract Documents or the terms of any special guarantees specified therein.
6. This Notice does not relieve Contractor of any surviving obligations under the Construction Contract, and is subject to Owner's reservations of rights with respect to completion and final payment.

Engineer

By (signature):

Name (*printed*):

Title:

STANDARD GENERAL CONDITIONS OF THE CONSTRUCTION CONTRACT

TABLE OF CONTENTS

	Page
Article 1—Definitions and Terminology.....	1
1.01 Defined Terms.....	1
1.02 Terminology	6
Article 2—Preliminary Matters	7
2.01 Delivery of Performance and Payment Bonds; Evidence of Insurance.....	7
2.02 Copies of Documents	8
2.03 Before Starting Construction	8
2.04 Preconstruction Conference; Designation of Authorized Representatives.....	8
2.05 Acceptance of Schedules	8
2.06 Electronic Transmittals	9
Article 3—Contract Documents: Intent, Requirements, Reuse.....	9
3.01 Intent.....	9
3.02 Reference Standards.....	10
3.03 Reporting and Resolving Discrepancies	10
3.04 Requirements of the Contract Documents.....	11
3.05 Reuse of Documents	11
Article 4—Commencement and Progress of the Work	12
4.01 Commencement of Contract Times; Notice to Proceed	12
4.02 Starting the Work.....	12
4.03 Reference Points	12
4.04 Progress Schedule	12
4.05 Delays in Contractor's Progress	13
Article 5—Site; Subsurface and Physical Conditions; Hazardous Environmental Conditions	14
5.01 Availability of Lands	14
5.02 Use of Site and Other Areas.....	14
5.03 Subsurface and Physical Conditions.....	16

5.04	Differing Subsurface or Physical Conditions	16
5.05	Underground Facilities.....	18
5.06	Hazardous Environmental Conditions at Site	20
	Article 6—Bonds and Insurance.....	22
6.01	Performance, Payment, and Other Bonds	22
6.02	Insurance—General Provisions.....	23
6.03	Contractor's Insurance.....	25
6.04	Builder's Risk and Other Property Insurance.....	26
6.05	Property Losses; Subrogation	27
6.06	Receipt and Application of Property Insurance Proceeds	28
	Article 7—Contractor's Responsibilities	28
7.01	Contractor's Means and Methods of Construction	28
7.02	Supervision and Superintendence	29
7.03	Labor; Working Hours	29
7.04	Services, Materials, and Equipment	29
7.05	"Or Equals"	30
7.06	Substitutes	31
7.07	Concerning Subcontractors and Suppliers.....	32
7.08	Patent Fees and Royalties.....	34
7.09	Permits	34
7.10	Taxes	34
7.11	Laws and Regulations.....	35
7.12	Record Documents.....	35
7.13	Safety and Protection	35
7.14	Hazard Communication Programs	37
7.15	Emergencies.....	37
7.16	Submittals	37
7.17	Contractor's General Warranty and Guarantee	40
7.18	Indemnification	41
7.19	Delegation of Professional Design Services	41
	Article 8—Other Work at the Site.....	42
8.01	Other Work	42

8.02	Coordination	43
8.03	Legal Relationships.....	43
Article 9—Owner's Responsibilities.....		44
9.01	Communications to Contractor	44
9.02	Replacement of Engineer.....	44
9.03	Furnish Data	45
9.04	Pay When Due.....	45
9.05	Lands and Easements; Reports, Tests, and Drawings.....	45
9.06	Insurance.....	45
9.07	Change Orders	45
9.08	Inspections, Tests, and Approvals.....	45
9.09	Limitations on Owner's Responsibilities	45
9.10	Undisclosed Hazardous Environmental Condition.....	45
9.11	Evidence of Financial Arrangements.....	45
9.12	Safety Programs	45
Article 10—Engineer's Status During Construction		46
10.01	Owner's Representative.....	46
10.02	Visits to Site.....	46
10.03	Resident Project Representative.....	46
10.04	Engineer's Authority	46
10.05	Determinations for Unit Price Work	47
10.06	Decisions on Requirements of Contract Documents and Acceptability of Work	47
10.07	Limitations on Engineer's Authority and Responsibilities	47
10.08	Compliance with Safety Program.....	48
Article 11—Changes to the Contract		48
11.01	Amending and Supplementing the Contract	48
11.02	Change Orders	48
11.03	Work Change Directives.....	49
11.04	Field Orders.....	49
11.05	Owner-Authorized Changes in the Work	49
11.06	Unauthorized Changes in the Work.....	50
11.07	Change of Contract Price	50

11.08	Change of Contract Times.....	51
11.09	Change Proposals.....	51
11.10	Notification to Surety.....	52
Article 12—Claims.....		53
12.01	Claims.....	53
Article 13—Cost of the Work; Allowances; Unit Price Work		54
13.01	Cost of the Work	54
13.02	Allowances	58
13.03	Unit Price Work	58
Article 14—Tests and Inspections; Correction, Removal, or Acceptance of Defective Work		59
14.01	Access to Work.....	59
14.02	Tests, Inspections, and Approvals.....	59
14.03	Defective Work	60
14.04	Acceptance of Defective Work.....	61
14.05	Uncovering Work	61
14.06	Owner May Stop the Work	62
14.07	Owner May Correct Defective Work.....	62
Article 15—Payments to Contractor; Set-Offs; Completion; Correction Period		62
15.01	Progress Payments.....	62
15.02	Contractor's Warranty of Title	66
15.03	Substantial Completion.....	66
15.04	Partial Use or Occupancy	67
15.05	Final Inspection	67
15.06	Final Payment.....	68
15.07	Waiver of Claims	69
15.08	Correction Period	69
Article 16—Suspension of Work and Termination		70
16.01	Owner May Suspend Work	70
16.02	Owner May Terminate for Cause.....	70
16.03	Owner May Terminate for Convenience.....	72
16.04	Contractor May Stop Work or Terminate	72
Article 17—Final Resolution of Disputes		72

17.01	Methods and Procedures.....	72
Article 18—Miscellaneous		73
18.01	Giving Notice	73
18.02	Computation of Times.....	73
18.03	Cumulative Remedies	73
18.04	Limitation of Damages	73
18.05	No Waiver	74
18.06	Survival of Obligations	74
18.07	Controlling Law	74
18.08	Assignment of Contract.....	74
18.09	Successors and Assigns	74
18.10	Headings.....	74

STANDARD GENERAL CONDITIONS OF THE CONSTRUCTION CONTRACT

ARTICLE 1—DEFINITIONS AND TERMINOLOGY

1.01 *Defined Terms*

- A. Wherever used in the Bidding Requirements or Contract Documents, a term printed with initial capital letters, including the term's singular and plural forms, will have the meaning indicated in the definitions below. In addition to terms specifically defined, terms with initial capital letters in the Contract Documents include references to identified articles and paragraphs, and the titles of other documents or forms.
 1. *Addenda*—Written or graphic instruments issued prior to the opening of Bids which clarify, correct, or change the Bidding Requirements or the proposed Contract Documents.
 2. *Agreement*—The written instrument, executed by Owner and Contractor, that sets forth the Contract Price and Contract Times, identifies the parties and the Engineer, and designates the specific items that are Contract Documents.
 3. *Application for Payment*—The document prepared by Contractor, in a form acceptable to Engineer, to request progress or final payments, and which is to be accompanied by such supporting documentation as is required by the Contract Documents.
 4. *Bid*—The offer of a Bidder submitted on the prescribed form setting forth the prices for the Work to be performed.
 5. *Bidder*—An individual or entity that submits a Bid to Owner.
 6. *Bidding Documents*—The Bidding Requirements, the proposed Contract Documents, and all Addenda.
 7. *Bidding Requirements*—The Advertisement or invitation to bid, Instructions to Bidders, Bid Bond or other Bid security, if any, the Bid Form, and the Bid with any attachments.
 8. *Change Order*—A document which is signed by Contractor and Owner and authorizes an addition, deletion, or revision in the Work or an adjustment in the Contract Price or the Contract Times, or other revision to the Contract, issued on or after the Effective Date of the Contract.
 9. *Change Proposal*—A written request by Contractor, duly submitted in compliance with the procedural requirements set forth herein, seeking an adjustment in Contract Price or Contract Times; contesting an initial decision by Engineer concerning the requirements of the Contract Documents or the acceptability of Work under the Contract Documents; challenging a set-off against payments due; or seeking other relief with respect to the terms of the Contract.

10. *Claim*

- a. A demand or assertion by Owner directly to Contractor, duly submitted in compliance with the procedural requirements set forth herein, seeking an adjustment of Contract Price or Contract Times; contesting an initial decision by Engineer concerning the requirements of the Contract Documents or the acceptability of Work under the Contract Documents; contesting Engineer's decision regarding a Change Proposal; seeking resolution of a contractual issue that Engineer has declined to address; or seeking other relief with respect to the terms of the Contract.
- b. A demand or assertion by Contractor directly to Owner, duly submitted in compliance with the procedural requirements set forth herein, contesting Engineer's decision regarding a Change Proposal, or seeking resolution of a contractual issue that Engineer has declined to address.
- c. A demand or assertion by Owner or Contractor, duly submitted in compliance with the procedural requirements set forth herein, made pursuant to Paragraph 12.01.A.4, concerning disputes arising after Engineer has issued a recommendation of final payment.
- d. A demand for money or services by a third party is not a Claim.

- 11. *Constituent of Concern*—Asbestos, petroleum, radioactive materials, polychlorinated biphenyls (PCBs), lead-based paint (as defined by the HUD/EPA standard), hazardous waste, and any substance, product, waste, or other material of any nature whatsoever that is or becomes listed, regulated, or addressed pursuant to Laws and Regulations regulating, relating to, or imposing liability or standards of conduct concerning, any hazardous, toxic, or dangerous waste, substance, or material.
- 12. *Contract*—The entire and integrated written contract between Owner and Contractor concerning the Work.
- 13. *Contract Documents*—Those items so designated in the Agreement, and which together comprise the Contract.
- 14. *Contract Price*—The money that Owner has agreed to pay Contractor for completion of the Work in accordance with the Contract Documents.
- 15. *Contract Times*—The number of days or the dates by which Contractor shall: (a) achieve Milestones, if any; (b) achieve Substantial Completion; and (c) complete the Work.
- 16. *Contractor*—The individual or entity with which Owner has contracted for performance of the Work.
- 17. *Cost of the Work*—See Paragraph 13.01 for definition.
- 18. *Drawings*—The part of the Contract that graphically shows the scope, extent, and character of the Work to be performed by Contractor.
- 19. *Effective Date of the Contract*—The date, indicated in the Agreement, on which the Contract becomes effective.

20. *Electronic Document*—Any Project-related correspondence, attachments to correspondence, data, documents, drawings, information, or graphics, including but not limited to Shop Drawings and other Submittals, that are in an electronic or digital format.
21. *Electronic Means*—Electronic mail (email), upload/download from a secure Project website, or other communications methods that allow: (a) the transmission or communication of Electronic Documents; (b) the documentation of transmissions, including sending and receipt; (c) printing of the transmitted Electronic Document by the recipient; (d) the storage and archiving of the Electronic Document by sender and recipient; and (e) the use by recipient of the Electronic Document for purposes permitted by this Contract. Electronic Means does not include the use of text messaging, or of Facebook, Twitter, Instagram, or similar social media services for transmission of Electronic Documents.
22. *Engineer*—The individual or entity named as such in the Agreement.
23. *Field Order*—A written order issued by Engineer which requires minor changes in the Work but does not change the Contract Price or the Contract Times.
24. *Hazardous Environmental Condition*—The presence at the Site of Constituents of Concern in such quantities or circumstances that may present a danger to persons or property exposed thereto.
 - a. The presence at the Site of materials that are necessary for the execution of the Work, or that are to be incorporated into the Work, and that are controlled and contained pursuant to industry practices, Laws and Regulations, and the requirements of the Contract, is not a Hazardous Environmental Condition.
 - b. The presence of Constituents of Concern that are to be removed or remediated as part of the Work is not a Hazardous Environmental Condition.
 - c. The presence of Constituents of Concern as part of the routine, anticipated, and obvious working conditions at the Site, is not a Hazardous Environmental Condition.
25. *Laws and Regulations; Laws or Regulations*—Any and all applicable laws, statutes, rules, regulations, ordinances, codes, and binding decrees, resolutions, and orders of any and all governmental bodies, agencies, authorities, and courts having jurisdiction.
26. *Liens*—Charges, security interests, or encumbrances upon Contract-related funds, real property, or personal property.
27. *Milestone*—A principal event in the performance of the Work that the Contract requires Contractor to achieve by an intermediate completion date, or by a time prior to Substantial Completion of all the Work.
28. *Notice of Award*—The written notice by Owner to a Bidder of Owner's acceptance of the Bid.
29. *Notice to Proceed*—A written notice by Owner to Contractor fixing the date on which the Contract Times will commence to run and on which Contractor shall start to perform the Work.

30. *Owner*—The individual or entity with which Contractor has contracted regarding the Work, and which has agreed to pay Contractor for the performance of the Work, pursuant to the terms of the Contract.
31. *Progress Schedule*—A schedule, prepared and maintained by Contractor, describing the sequence and duration of the activities comprising Contractor's plan to accomplish the Work within the Contract Times.
32. *Project*—The total undertaking to be accomplished for Owner by engineers, contractors, and others, including planning, study, design, construction, testing, commissioning, and start-up, and of which the Work to be performed under the Contract Documents is a part.
33. *Resident Project Representative*—The authorized representative of Engineer assigned to assist Engineer at the Site. As used herein, the term Resident Project Representative (RPR) includes any assistants or field staff of Resident Project Representative.
34. *Samples*—Physical examples of materials, equipment, or workmanship that are representative of some portion of the Work and that establish the standards by which such portion of the Work will be judged.
35. *Schedule of Submittals*—A schedule, prepared and maintained by Contractor, of required submittals and the time requirements for Engineer's review of the submittals.
36. *Schedule of Values*—A schedule, prepared and maintained by Contractor, allocating portions of the Contract Price to various portions of the Work and used as the basis for reviewing Contractor's Applications for Payment.
37. *Shop Drawings*—All drawings, diagrams, illustrations, schedules, and other data or information that are specifically prepared or assembled by or for Contractor and submitted by Contractor to illustrate some portion of the Work. Shop Drawings, whether approved or not, are not Drawings and are not Contract Documents.
38. *Site*—Lands or areas indicated in the Contract Documents as being furnished by Owner upon which the Work is to be performed, including rights-of-way and easements, and such other lands or areas furnished by Owner which are designated for the use of Contractor.
39. *Specifications*—The part of the Contract that consists of written requirements for materials, equipment, systems, standards, and workmanship as applied to the Work, and certain administrative requirements and procedural matters applicable to the Work.
40. *Subcontractor*—An individual or entity having a direct contract with Contractor or with any other Subcontractor for the performance of a part of the Work.
41. *Submittal*—A written or graphic document, prepared by or for Contractor, which the Contract Documents require Contractor to submit to Engineer, or that is indicated as a Submittal in the Schedule of Submittals accepted by Engineer. Submittals may include Shop Drawings and Samples; schedules; product data; Owner-delegated designs; sustainable design information; information on special procedures; testing plans; results of tests and evaluations, source quality-control testing and inspections, and field or Site quality-control testing and inspections; warranties and certifications; Suppliers'

instructions and reports; records of delivery of spare parts and tools; operations and maintenance data; Project photographic documentation; record documents; and other such documents required by the Contract Documents. Submittals, whether or not approved or accepted by Engineer, are not Contract Documents. Change Proposals, Change Orders, Claims, notices, Applications for Payment, and requests for interpretation or clarification are not Submittals.

42. *Substantial Completion*—The time at which the Work (or a specified part thereof) has progressed to the point where, in the opinion of Engineer, the Work (or a specified part thereof) is sufficiently complete, in accordance with the Contract Documents, so that the Work (or a specified part thereof) can be utilized for the purposes for which it is intended. The terms “substantially complete” and “substantially completed” as applied to all or part of the Work refer to Substantial Completion of such Work.
43. *Successful Bidder*—The Bidder to which the Owner makes an award of contract.
44. *Supplementary Conditions*—The part of the Contract that amends or supplements these General Conditions.
45. *Supplier*—A manufacturer, fabricator, supplier, distributor, or vendor having a direct contract with Contractor or with any Subcontractor to furnish materials or equipment to be incorporated in the Work by Contractor or a Subcontractor.
46. *Technical Data*
 - a. Those items expressly identified as Technical Data in the Supplementary Conditions, with respect to either (1) existing subsurface conditions at or adjacent to the Site, or existing physical conditions at or adjacent to the Site including existing surface or subsurface structures (except Underground Facilities) or (2) Hazardous Environmental Conditions at the Site.
 - b. If no such express identifications of Technical Data have been made with respect to conditions at the Site, then Technical Data is defined, with respect to conditions at the Site under Paragraphs 5.03, 5.04, and 5.06, as the data contained in boring logs, recorded measurements of subsurface water levels, assessments of the condition of subsurface facilities, laboratory test results, and other factual, objective information regarding conditions at the Site that are set forth in any geotechnical, environmental, or other Site or facilities conditions report prepared for the Project and made available to Contractor.
 - c. Information and data regarding the presence or location of Underground Facilities are not intended to be categorized, identified, or defined as Technical Data, and instead Underground Facilities are shown or indicated on the Drawings.
47. *Underground Facilities*—All active or not-in-service underground lines, pipelines, conduits, ducts, encasements, cables, wires, manholes, vaults, tanks, tunnels, or other such facilities or systems at the Site, including but not limited to those facilities or systems that produce, transmit, distribute, or convey telephone or other communications, cable television, fiber optic transmissions, power, electricity, light, heat, gases, oil, crude oil products, liquid petroleum products, water, steam, waste, wastewater, storm water,

other liquids or chemicals, or traffic or other control systems. An abandoned facility or system is not an Underground Facility.

48. *Unit Price Work*—Work to be paid for on the basis of unit prices.
49. *Work*—The entire construction or the various separately identifiable parts thereof required to be provided under the Contract Documents. Work includes and is the result of performing or providing all labor, services, and documentation necessary to produce such construction; furnishing, installing, and incorporating all materials and equipment into such construction; and may include related services such as testing, start-up, and commissioning, all as required by the Contract Documents.
50. *Work Change Directive*—A written directive to Contractor issued on or after the Effective Date of the Contract, signed by Owner and recommended by Engineer, ordering an addition, deletion, or revision in the Work.

1.02 Terminology

- A. The words and terms discussed in Paragraphs 1.02.B, C, D, and E are not defined terms that require initial capital letters, but, when used in the Bidding Requirements or Contract Documents, have the indicated meaning.
- B. *Intent of Certain Terms or Adjectives*: The Contract Documents include the terms “as allowed,” “as approved,” “as ordered,” “as directed” or terms of like effect or import to authorize an exercise of professional judgment by Engineer. In addition, the adjectives “reasonable,” “suitable,” “acceptable,” “proper,” “satisfactory,” or adjectives of like effect or import are used to describe an action or determination of Engineer as to the Work. It is intended that such exercise of professional judgment, action, or determination will be solely to evaluate, in general, the Work for compliance with the information in the Contract Documents and with the design concept of the Project as a functioning whole as shown or indicated in the Contract Documents (unless there is a specific statement indicating otherwise). The use of any such term or adjective is not intended to and shall not be effective to assign to Engineer any duty or authority to supervise or direct the performance of the Work, or any duty or authority to undertake responsibility contrary to the provisions of Article 10 or any other provision of the Contract Documents.
- C. *Day*: The word “day” means a calendar day of 24 hours measured from midnight to the next midnight.
- D. *Defective*: The word “defective,” when modifying the word “Work,” refers to Work that is unsatisfactory, faulty, or deficient in that it:
 1. does not conform to the Contract Documents;
 2. does not meet the requirements of any applicable inspection, reference standard, test, or approval referred to in the Contract Documents; or
 3. has been damaged prior to Engineer’s recommendation of final payment (unless responsibility for the protection thereof has been assumed by Owner at Substantial Completion in accordance with Paragraph 15.03 or Paragraph 15.04).

E. *Furnish, Install, Perform, Provide*

1. The word "furnish," when used in connection with services, materials, or equipment, means to supply and deliver said services, materials, or equipment to the Site (or some other specified location) ready for use or installation and in usable or operable condition.
2. The word "install," when used in connection with services, materials, or equipment, means to put into use or place in final position said services, materials, or equipment complete and ready for intended use.
3. The words "perform" or "provide," when used in connection with services, materials, or equipment, means to furnish and install said services, materials, or equipment complete and ready for intended use.
4. If the Contract Documents establish an obligation of Contractor with respect to specific services, materials, or equipment, but do not expressly use any of the four words "furnish," "install," "perform," or "provide," then Contractor shall furnish and install said services, materials, or equipment complete and ready for intended use.

F. *Contract Price or Contract Times*: References to a change in "Contract Price or Contract Times" or "Contract Times or Contract Price" or similar, indicate that such change applies to (1) Contract Price, (2) Contract Times, or (3) both Contract Price and Contract Times, as warranted, even if the term "or both" is not expressed.

G. Unless stated otherwise in the Contract Documents, words or phrases that have a well-known technical or construction industry or trade meaning are used in the Contract Documents in accordance with such recognized meaning.

ARTICLE 2—PRELIMINARY MATTERS

2.01 *Delivery of Performance and Payment Bonds; Evidence of Insurance*

- A. *Performance and Payment Bonds*: When Contractor delivers the signed counterparts of the Agreement to Owner, Contractor shall also deliver to Owner the performance bond and payment bond (if the Contract requires Contractor to furnish such bonds).
- B. *Evidence of Contractor's Insurance*: When Contractor delivers the signed counterparts of the Agreement to Owner, Contractor shall also deliver to Owner, with copies to each additional insured (as identified in the Contract), the certificates, endorsements, and other evidence of insurance required to be provided by Contractor in accordance with Article 6, except to the extent the Supplementary Conditions expressly establish other dates for delivery of specific insurance policies.
- C. *Evidence of Owner's Insurance*: After receipt of the signed counterparts of the Agreement and all required bonds and insurance documentation, Owner shall promptly deliver to Contractor, with copies to each additional insured (as identified in the Contract), the certificates and other evidence of insurance required to be provided by Owner under Article 6.

2.02 *Copies of Documents*

- A. Owner shall furnish to Contractor four printed copies of the Contract (including one fully signed counterpart of the Agreement), and one copy in electronic portable document format (PDF). Additional printed copies will be furnished upon request at the cost of reproduction.
- B. Owner shall maintain and safeguard at least one original printed record version of the Contract, including Drawings and Specifications signed and sealed by Engineer and other design professionals. Owner shall make such original printed record version of the Contract available to Contractor for review. Owner may delegate the responsibilities under this provision to Engineer.

2.03 *Before Starting Construction*

- A. *Preliminary Schedules:* Within 10 days after the Effective Date of the Contract (or as otherwise required by the Contract Documents), Contractor shall submit to Engineer for timely review:
 1. a preliminary Progress Schedule indicating the times (numbers of days or dates) for starting and completing the various stages of the Work, including any Milestones specified in the Contract;
 2. a preliminary Schedule of Submittals; and
 3. a preliminary Schedule of Values for all of the Work which includes quantities and prices of items which when added together equal the Contract Price and subdivides the Work into component parts in sufficient detail to serve as the basis for progress payments during performance of the Work. Such prices will include an appropriate amount of overhead and profit applicable to each item of Work.

2.04 *Preconstruction Conference; Designation of Authorized Representatives*

- A. Before any Work at the Site is started, a conference attended by Owner, Contractor, Engineer, and others as appropriate will be held to establish a working understanding among the parties as to the Work, and to discuss the schedules referred to in Paragraph 2.03.A, procedures for handling Shop Drawings, Samples, and other Submittals, processing Applications for Payment, electronic or digital transmittals, and maintaining required records.
- B. At this conference Owner and Contractor each shall designate, in writing, a specific individual to act as its authorized representative with respect to the services and responsibilities under the Contract. Such individuals shall have the authority to transmit and receive information, render decisions relative to the Contract, and otherwise act on behalf of each respective party.

2.05 *Acceptance of Schedules*

- A. At least 10 days before submission of the first Application for Payment a conference, attended by Contractor, Engineer, and others as appropriate, will be held to review the schedules submitted in accordance with Paragraph 2.03.A. No progress payment will be made to Contractor until acceptable schedules are submitted to Engineer.
 1. The Progress Schedule will be acceptable to Engineer if it provides an orderly progression of the Work to completion within the Contract Times. Such acceptance will not impose on Engineer responsibility for the Progress Schedule, for sequencing, scheduling, or

progress of the Work, nor interfere with or relieve Contractor from Contractor's full responsibility therefor.

2. Contractor's Schedule of Submittals will be acceptable to Engineer if it provides a workable arrangement for reviewing and processing the required submittals.
3. Contractor's Schedule of Values will be acceptable to Engineer as to form and substance if it provides a reasonable allocation of the Contract Price to the component parts of the Work.
4. If a schedule is not acceptable, Contractor will have an additional 10 days to revise and resubmit the schedule.

2.06 *Electronic Transmittals*

- A. Except as otherwise stated elsewhere in the Contract, the Owner, Engineer, and Contractor may send, and shall accept, Electronic Documents transmitted by Electronic Means.
- B. If the Contract does not establish protocols for Electronic Means, then Owner, Engineer, and Contractor shall jointly develop such protocols.
- C. Subject to any governing protocols for Electronic Means, when transmitting Electronic Documents by Electronic Means, the transmitting party makes no representations as to long-term compatibility, usability, or readability of the Electronic Documents resulting from the recipient's use of software application packages, operating systems, or computer hardware differing from those used in the drafting or transmittal of the Electronic Documents.

ARTICLE 3—CONTRACT DOCUMENTS: INTENT, REQUIREMENTS, REUSE

3.01 *Intent*

- A. The Contract Documents are complementary; what is required by one Contract Document is as binding as if required by all.
- B. It is the intent of the Contract Documents to describe a functionally complete Project (or part thereof) to be constructed in accordance with the Contract Documents.
- C. Unless otherwise stated in the Contract Documents, if there is a discrepancy between the electronic versions of the Contract Documents (including any printed copies derived from such electronic versions) and the printed record version, the printed record version will govern.
- D. The Contract supersedes prior negotiations, representations, and agreements, whether written or oral.
- E. Engineer will issue clarifications and interpretations of the Contract Documents as provided herein.
- F. Any provision or part of the Contract Documents held to be void or unenforceable under any Law or Regulation will be deemed stricken, and all remaining provisions will continue to be valid and binding upon Owner and Contractor, which agree that the Contract Documents will be reformed to replace such stricken provision or part thereof with a valid and enforceable provision that comes as close as possible to expressing the intention of the stricken provision.

G. Nothing in the Contract Documents creates:

1. any contractual relationship between Owner or Engineer and any Subcontractor, Supplier, or other individual or entity performing or furnishing any of the Work, for the benefit of such Subcontractor, Supplier, or other individual or entity; or
2. any obligation on the part of Owner or Engineer to pay or to see to the payment of any money due any such Subcontractor, Supplier, or other individual or entity, except as may otherwise be required by Laws and Regulations.

3.02 *Reference Standards*

A. *Standards Specifications, Codes, Laws and Regulations*

1. Reference in the Contract Documents to standard specifications, manuals, reference standards, or codes of any technical society, organization, or association, or to Laws or Regulations, whether such reference be specific or by implication, means the standard specification, manual, reference standard, code, or Laws or Regulations in effect at the time of opening of Bids (or on the Effective Date of the Contract if there were no Bids), except as may be otherwise specifically stated in the Contract Documents.
2. No provision of any such standard specification, manual, reference standard, or code, and no instruction of a Supplier, will be effective to change the duties or responsibilities of Owner, Contractor, or Engineer from those set forth in the part of the Contract Documents prepared by or for Engineer. No such provision or instruction shall be effective to assign to Owner or Engineer any duty or authority to supervise or direct the performance of the Work, or any duty or authority to undertake responsibility inconsistent with the provisions of the part of the Contract Documents prepared by or for Engineer.

3.03 *Reporting and Resolving Discrepancies*

A. *Reporting Discrepancies*

1. *Contractor's Verification of Figures and Field Measurements:* Before undertaking each part of the Work, Contractor shall carefully study the Contract Documents, and check and verify pertinent figures and dimensions therein, particularly with respect to applicable field measurements. Contractor shall promptly report in writing to Engineer any conflict, error, ambiguity, or discrepancy that Contractor discovers, or has actual knowledge of, and shall not proceed with any Work affected thereby until the conflict, error, ambiguity, or discrepancy is resolved by a clarification or interpretation by Engineer, or by an amendment or supplement to the Contract issued pursuant to Paragraph 11.01.
2. *Contractor's Review of Contract Documents:* If, before or during the performance of the Work, Contractor discovers any conflict, error, ambiguity, or discrepancy within the Contract Documents, or between the Contract Documents and (a) any applicable Law or Regulation, (b) actual field conditions, (c) any standard specification, manual, reference standard, or code, or (d) any instruction of any Supplier, then Contractor shall promptly report it to Engineer in writing. Contractor shall not proceed with the Work affected thereby (except in an emergency as required by Paragraph 7.15) until the conflict, error,

ambiguity, or discrepancy is resolved, by a clarification or interpretation by Engineer, or by an amendment or supplement to the Contract issued pursuant to Paragraph 11.01.

3. Contractor shall not be liable to Owner or Engineer for failure to report any conflict, error, ambiguity, or discrepancy in the Contract Documents unless Contractor had actual knowledge thereof.

B. *Resolving Discrepancies*

1. Except as may be otherwise specifically stated in the Contract Documents, the provisions of the part of the Contract Documents prepared by or for Engineer take precedence in resolving any conflict, error, ambiguity, or discrepancy between such provisions of the Contract Documents and:
 - a. the provisions of any standard specification, manual, reference standard, or code, or the instruction of any Supplier (whether or not specifically incorporated by reference as a Contract Document); or
 - b. the provisions of any Laws or Regulations applicable to the performance of the Work (unless such an interpretation of the provisions of the Contract Documents would result in violation of such Law or Regulation).

3.04 *Requirements of the Contract Documents*

- A. During the performance of the Work and until final payment, Contractor and Owner shall submit to the Engineer in writing all matters in question concerning the requirements of the Contract Documents (sometimes referred to as requests for information or interpretation—RFIs), or relating to the acceptability of the Work under the Contract Documents, as soon as possible after such matters arise. Engineer will be the initial interpreter of the requirements of the Contract Documents, and judge of the acceptability of the Work.
- B. Engineer will, with reasonable promptness, render a written clarification, interpretation, or decision on the issue submitted, or initiate an amendment or supplement to the Contract Documents. Engineer's written clarification, interpretation, or decision will be final and binding on Contractor, unless it appeals by submitting a Change Proposal, and on Owner, unless it appeals by filing a Claim.
- C. If a submitted matter in question concerns terms and conditions of the Contract Documents that do not involve (1) the performance or acceptability of the Work under the Contract Documents, (2) the design (as set forth in the Drawings, Specifications, or otherwise), or (3) other engineering or technical matters, then Engineer will promptly notify Owner and Contractor in writing that Engineer is unable to provide a decision or interpretation. If Owner and Contractor are unable to agree on resolution of such a matter in question, either party may pursue resolution as provided in Article 12.

3.05 *Reuse of Documents*

- A. Contractor and its Subcontractors and Suppliers shall not:
 1. have or acquire any title to or ownership rights in any of the Drawings, Specifications, or other documents (or copies of any thereof) prepared by or bearing the seal of Engineer or its consultants, including electronic media versions, or reuse any such Drawings,

Specifications, other documents, or copies thereof on extensions of the Project or any other project without written consent of Owner and Engineer and specific written verification or adaptation by Engineer; or

2. have or acquire any title or ownership rights in any other Contract Documents, reuse any such Contract Documents for any purpose without Owner's express written consent, or violate any copyrights pertaining to such Contract Documents.
- B. The prohibitions of this Paragraph 3.05 will survive final payment, or termination of the Contract. Nothing herein precludes Contractor from retaining copies of the Contract Documents for record purposes.

ARTICLE 4—COMMENCEMENT AND PROGRESS OF THE WORK

4.01 *Commencement of Contract Times; Notice to Proceed*

- A. The Contract Times will commence to run on the 30th day after the Effective Date of the Contract or, if a Notice to Proceed is given, on the day indicated in the Notice to Proceed. A Notice to Proceed may be given at any time within 30 days after the Effective Date of the Contract. In no event will the Contract Times commence to run later than the 60th day after the day of Bid opening or the 30th day after the Effective Date of the Contract, whichever date is earlier.

4.02 *Starting the Work*

- A. Contractor shall start to perform the Work on the date when the Contract Times commence to run. No Work may be done at the Site prior to such date.

4.03 *Reference Points*

- A. Owner shall provide engineering surveys to establish reference points for construction which in Engineer's judgment are necessary to enable Contractor to proceed with the Work. Contractor shall be responsible for laying out the Work, shall protect and preserve the established reference points and property monuments, and shall make no changes or relocations without the prior written approval of Owner. Contractor shall report to Engineer whenever any reference point or property monument is lost or destroyed or requires relocation because of necessary changes in grades or locations, and shall be responsible for the accurate replacement or relocation of such reference points or property monuments by professionally qualified personnel.

4.04 *Progress Schedule*

- A. Contractor shall adhere to the Progress Schedule established in accordance with Paragraph 2.05 as it may be adjusted from time to time as provided below.
 1. Contractor shall submit to Engineer for acceptance (to the extent indicated in Paragraph 2.05) proposed adjustments in the Progress Schedule that will not result in changing the Contract Times.
 2. Proposed adjustments in the Progress Schedule that will change the Contract Times must be submitted in accordance with the requirements of Article 11.

B. Contractor shall carry on the Work and adhere to the Progress Schedule during all disputes or disagreements with Owner. No Work will be delayed or postponed pending resolution of any disputes or disagreements, or during any appeal process, except as permitted by Paragraph 16.04, or as Owner and Contractor may otherwise agree in writing.

4.05 *Delays in Contractor's Progress*

A. If Owner, Engineer, or anyone for whom Owner is responsible, delays, disrupts, or interferes with the performance or progress of the Work, then Contractor shall be entitled to an equitable adjustment in Contract Price or Contract Times.

B. Contractor shall not be entitled to an adjustment in Contract Price or Contract Times for delay, disruption, or interference caused by or within the control of Contractor. Delay, disruption, and interference attributable to and within the control of a Subcontractor or Supplier shall be deemed to be within the control of Contractor.

C. If Contractor's performance or progress is delayed, disrupted, or interfered with by unanticipated causes not the fault of and beyond the control of Owner, Contractor, and those for whom they are responsible, then Contractor shall be entitled to an equitable adjustment in Contract Times. Such an adjustment will be Contractor's sole and exclusive remedy for the delays, disruption, and interference described in this paragraph. Causes of delay, disruption, or interference that may give rise to an adjustment in Contract Times under this paragraph include but are not limited to the following:

1. Severe and unavoidable natural catastrophes such as fires, floods, epidemics, and earthquakes;
2. Abnormal weather conditions;
3. Acts or failures to act of third-party utility owners or other third-party entities (other than those third-party utility owners or other third-party entities performing other work at or adjacent to the Site as arranged by or under contract with Owner, as contemplated in Article 8); and
4. Acts of war or terrorism.

D. Contractor's entitlement to an adjustment of Contract Times or Contract Price is limited as follows:

1. Contractor's entitlement to an adjustment of the Contract Times is conditioned on the delay, disruption, or interference adversely affecting an activity on the critical path to completion of the Work, as of the time of the delay, disruption, or interference.
2. Contractor shall not be entitled to an adjustment in Contract Price for any delay, disruption, or interference if such delay is concurrent with a delay, disruption, or interference caused by or within the control of Contractor. Such a concurrent delay by Contractor shall not preclude an adjustment of Contract Times to which Contractor is otherwise entitled.
3. Adjustments of Contract Times or Contract Price are subject to the provisions of Article 11.

E. Each Contractor request or Change Proposal seeking an increase in Contract Times or Contract Price must be supplemented by supporting data that sets forth in detail the following:

1. The circumstances that form the basis for the requested adjustment;
2. The date upon which each cause of delay, disruption, or interference began to affect the progress of the Work;
3. The date upon which each cause of delay, disruption, or interference ceased to affect the progress of the Work;
4. The number of days' increase in Contract Times claimed as a consequence of each such cause of delay, disruption, or interference; and
5. The impact on Contract Price, in accordance with the provisions of Paragraph 11.07.

Contractor shall also furnish such additional supporting documentation as Owner or Engineer may require including, where appropriate, a revised progress schedule indicating all the activities affected by the delay, disruption, or interference, and an explanation of the effect of the delay, disruption, or interference on the critical path to completion of the Work.

F. Delays, disruption, and interference to the performance or progress of the Work resulting from the existence of a differing subsurface or physical condition, an Underground Facility that was not shown or indicated by the Contract Documents, or not shown or indicated with reasonable accuracy, and those resulting from Hazardous Environmental Conditions, are governed by Article 5, together with the provisions of Paragraphs 4.05.D and 4.05.E.

G. Paragraph 8.03 addresses delays, disruption, and interference to the performance or progress of the Work resulting from the performance of certain other work at or adjacent to the Site.

ARTICLE 5—SITE; SUBSURFACE AND PHYSICAL CONDITIONS; HAZARDOUS ENVIRONMENTAL CONDITIONS

5.01 Availability of Lands

- A. Owner shall furnish the Site. Owner shall notify Contractor in writing of any encumbrances or restrictions not of general application but specifically related to use of the Site with which Contractor must comply in performing the Work.
- B. Upon reasonable written request, Owner shall furnish Contractor with a current statement of record legal title and legal description of the lands upon which permanent improvements are to be made and Owner's interest therein as necessary for giving notice of or filing a mechanic's or construction lien against such lands in accordance with applicable Laws and Regulations.
- C. Contractor shall provide for all additional lands and access thereto that may be required for temporary construction facilities or storage of materials and equipment.

5.02 Use of Site and Other Areas

A. Limitation on Use of Site and Other Areas

1. Contractor shall confine construction equipment, temporary construction facilities, the storage of materials and equipment, and the operations of workers to the Site, adjacent

areas that Contractor has arranged to use through construction easements or otherwise, and other adjacent areas permitted by Laws and Regulations, and shall not unreasonably encumber the Site and such other adjacent areas with construction equipment or other materials or equipment. Contractor shall assume full responsibility for (a) damage to the Site; (b) damage to any such other adjacent areas used for Contractor's operations; (c) damage to any other adjacent land or areas, or to improvements, structures, utilities, or similar facilities located at such adjacent lands or areas; and (d) for injuries and losses sustained by the owners or occupants of any such land or areas; provided that such damage or injuries result from the performance of the Work or from other actions or conduct of the Contractor or those for which Contractor is responsible.

2. If a damage or injury claim is made by the owner or occupant of any such land or area because of the performance of the Work, or because of other actions or conduct of the Contractor or those for which Contractor is responsible, Contractor shall (a) take immediate corrective or remedial action as required by Paragraph 7.13, or otherwise; (b) promptly attempt to settle the claim as to all parties through negotiations with such owner or occupant, or otherwise resolve the claim by arbitration or other dispute resolution proceeding, or in a court of competent jurisdiction; and (c) to the fullest extent permitted by Laws and Regulations, indemnify and hold harmless Owner and Engineer, and the officers, directors, members, partners, employees, agents, consultants and subcontractors of each and any of them, from and against any such claim, and against all costs, losses, and damages (including but not limited to all fees and charges of engineers, architects, attorneys, and other professionals and all court or arbitration or other dispute resolution costs) arising out of or relating to any claim or action, legal or equitable, brought by any such owner or occupant against Owner, Engineer, or any other party indemnified hereunder to the extent caused directly or indirectly, in whole or in part by, or based upon, Contractor's performance of the Work, or because of other actions or conduct of the Contractor or those for which Contractor is responsible.
- B. *Removal of Debris During Performance of the Work:* During the progress of the Work the Contractor shall keep the Site and other adjacent areas free from accumulations of waste materials, rubbish, and other debris. Removal and disposal of such waste materials, rubbish, and other debris will conform to applicable Laws and Regulations.
- C. *Cleaning:* Prior to Substantial Completion of the Work Contractor shall clean the Site and the Work and make it ready for utilization by Owner. At the completion of the Work Contractor shall remove from the Site and adjacent areas all tools, appliances, construction equipment and machinery, and surplus materials and shall restore to original condition all property not designated for alteration by the Contract Documents.
- D. *Loading of Structures:* Contractor shall not load nor permit any part of any structure to be loaded in any manner that will endanger the structure, nor shall Contractor subject any part of the Work or adjacent structures or land to stresses or pressures that will endanger them.

5.03 *Subsurface and Physical Conditions*

- A. *Reports and Drawings:* The Supplementary Conditions identify:
 1. Those reports of explorations and tests of subsurface conditions at or adjacent to the Site that contain Technical Data;
 2. Those drawings of existing physical conditions at or adjacent to the Site, including those drawings depicting existing surface or subsurface structures at or adjacent to the Site (except Underground Facilities), that contain Technical Data; and
 3. Technical Data contained in such reports and drawings.
- B. *Underground Facilities:* Underground Facilities are shown or indicated on the Drawings, pursuant to Paragraph 5.05, and not in the drawings referred to in Paragraph 5.03.A. Information and data regarding the presence or location of Underground Facilities are not intended to be categorized, identified, or defined as Technical Data.
- C. *Reliance by Contractor on Technical Data:* Contractor may rely upon the accuracy of the Technical Data expressly identified in the Supplementary Conditions with respect to such reports and drawings, but such reports and drawings are not Contract Documents. If no such express identification has been made, then Contractor may rely upon the accuracy of the Technical Data as defined in Paragraph 1.01.A.46.b.
- D. *Limitations of Other Data and Documents:* Except for such reliance on Technical Data, Contractor may not rely upon or make any claim against Owner or Engineer, or any of their officers, directors, members, partners, employees, agents, consultants, or subcontractors, with respect to:
 1. the completeness of such reports and drawings for Contractor's purposes, including, but not limited to, any aspects of the means, methods, techniques, sequences, and procedures of construction to be employed by Contractor, and safety precautions and programs incident thereto;
 2. other data, interpretations, opinions, and information contained in such reports or shown or indicated in such drawings;
 3. the contents of other Site-related documents made available to Contractor, such as record drawings from other projects at or adjacent to the Site, or Owner's archival documents concerning the Site; or
 4. any Contractor interpretation of or conclusion drawn from any Technical Data or any such other data, interpretations, opinions, or information.

5.04 *Differing Subsurface or Physical Conditions*

- A. *Notice by Contractor:* If Contractor believes that any subsurface or physical condition that is uncovered or revealed at the Site:
 1. is of such a nature as to establish that any Technical Data on which Contractor is entitled to rely as provided in Paragraph 5.03 is materially inaccurate;
 2. is of such a nature as to require a change in the Drawings or Specifications;

3. differs materially from that shown or indicated in the Contract Documents; or
4. is of an unusual nature, and differs materially from conditions ordinarily encountered and generally recognized as inherent in work of the character provided for in the Contract Documents;

then Contractor shall, promptly after becoming aware thereof and before further disturbing the subsurface or physical conditions or performing any Work in connection therewith (except in an emergency as required by Paragraph 7.15), notify Owner and Engineer in writing about such condition. Contractor shall not further disturb such condition or perform any Work in connection therewith (except with respect to an emergency) until receipt of a written statement permitting Contractor to do so.

- B. *Engineer's Review:* After receipt of written notice as required by the preceding paragraph, Engineer will promptly review the subsurface or physical condition in question; determine whether it is necessary for Owner to obtain additional exploration or tests with respect to the condition; conclude whether the condition falls within any one or more of the differing site condition categories in Paragraph 5.04.A; obtain any pertinent cost or schedule information from Contractor; prepare recommendations to Owner regarding the Contractor's resumption of Work in connection with the subsurface or physical condition in question and the need for any change in the Drawings or Specifications; and advise Owner in writing of Engineer's findings, conclusions, and recommendations.
- C. *Owner's Statement to Contractor Regarding Site Condition:* After receipt of Engineer's written findings, conclusions, and recommendations, Owner shall issue a written statement to Contractor (with a copy to Engineer) regarding the subsurface or physical condition in question, addressing the resumption of Work in connection with such condition, indicating whether any change in the Drawings or Specifications will be made, and adopting or rejecting Engineer's written findings, conclusions, and recommendations, in whole or in part.
- D. *Early Resumption of Work:* If at any time Engineer determines that Work in connection with the subsurface or physical condition in question may resume prior to completion of Engineer's review or Owner's issuance of its statement to Contractor, because the condition in question has been adequately documented, and analyzed on a preliminary basis, then the Engineer may at its discretion instruct Contractor to resume such Work.

- E. *Possible Price and Times Adjustments*
 1. Contractor shall be entitled to an equitable adjustment in Contract Price or Contract Times, to the extent that the existence of a differing subsurface or physical condition, or any related delay, disruption, or interference, causes an increase or decrease in Contractor's cost of, or time required for, performance of the Work; subject, however, to the following:
 - a. Such condition must fall within any one or more of the categories described in Paragraph 5.04.A;
 - b. With respect to Work that is paid for on a unit price basis, any adjustment in Contract Price will be subject to the provisions of Paragraph 13.03; and,

- c. Contractor's entitlement to an adjustment of the Contract Times is subject to the provisions of Paragraphs 4.05.D and 4.05.E.
- 2. Contractor shall not be entitled to any adjustment in the Contract Price or Contract Times with respect to a subsurface or physical condition if:
 - a. Contractor knew of the existence of such condition at the time Contractor made a commitment to Owner with respect to Contract Price and Contract Times by the submission of a Bid or becoming bound under a negotiated contract, or otherwise;
 - b. The existence of such condition reasonably could have been discovered or revealed as a result of any examination, investigation, exploration, test, or study of the Site and contiguous areas expressly required by the Bidding Requirements or Contract Documents to be conducted by or for Contractor prior to Contractor's making such commitment; or
 - c. Contractor failed to give the written notice required by Paragraph 5.04.A.
- 3. If Owner and Contractor agree regarding Contractor's entitlement to and the amount or extent of any adjustment in the Contract Price or Contract Times, then any such adjustment will be set forth in a Change Order.
- 4. Contractor may submit a Change Proposal regarding its entitlement to or the amount or extent of any adjustment in the Contract Price or Contract Times, no later than 30 days after Owner's issuance of the Owner's written statement to Contractor regarding the subsurface or physical condition in question.

F. *Underground Facilities; Hazardous Environmental Conditions:* Paragraph 5.05 governs rights and responsibilities regarding the presence or location of Underground Facilities. Paragraph 5.06 governs rights and responsibilities regarding Hazardous Environmental Conditions. The provisions of Paragraphs 5.03 and 5.04 are not applicable to the presence or location of Underground Facilities, or to Hazardous Environmental Conditions.

5.05 *Underground Facilities*

- A. *Contractor's Responsibilities:* Unless it is otherwise expressly provided in the Supplementary Conditions, the cost of all of the following are included in the Contract Price, and Contractor shall have full responsibility for:
 - 1. reviewing and checking all information and data regarding existing Underground Facilities at the Site;
 - 2. complying with applicable state and local utility damage prevention Laws and Regulations;
 - 3. verifying the actual location of those Underground Facilities shown or indicated in the Contract Documents as being within the area affected by the Work, by exposing such Underground Facilities during the course of construction;
 - 4. coordination of the Work with the owners (including Owner) of such Underground Facilities, during construction; and

5. the safety and protection of all existing Underground Facilities at the Site, and repairing any damage thereto resulting from the Work.
- B. *Notice by Contractor:* If Contractor believes that an Underground Facility that is uncovered or revealed at the Site was not shown or indicated on the Drawings, or was not shown or indicated on the Drawings with reasonable accuracy, then Contractor shall, promptly after becoming aware thereof and before further disturbing conditions affected thereby or performing any Work in connection therewith (except in an emergency as required by Paragraph 7.15), notify Owner and Engineer in writing regarding such Underground Facility.
- C. *Engineer's Review:* Engineer will:
 1. promptly review the Underground Facility and conclude whether such Underground Facility was not shown or indicated on the Drawings, or was not shown or indicated with reasonable accuracy;
 2. identify and communicate with the owner of the Underground Facility; prepare recommendations to Owner (and if necessary issue any preliminary instructions to Contractor) regarding the Contractor's resumption of Work in connection with the Underground Facility in question;
 3. obtain any pertinent cost or schedule information from Contractor; determine the extent, if any, to which a change is required in the Drawings or Specifications to reflect and document the consequences of the existence or location of the Underground Facility; and
 4. advise Owner in writing of Engineer's findings, conclusions, and recommendations.
- During such time, Contractor shall be responsible for the safety and protection of such Underground Facility.
- D. *Owner's Statement to Contractor Regarding Underground Facility:* After receipt of Engineer's written findings, conclusions, and recommendations, Owner shall issue a written statement to Contractor (with a copy to Engineer) regarding the Underground Facility in question addressing the resumption of Work in connection with such Underground Facility, indicating whether any change in the Drawings or Specifications will be made, and adopting or rejecting Engineer's written findings, conclusions, and recommendations in whole or in part.
- E. *Early Resumption of Work:* If at any time Engineer determines that Work in connection with the Underground Facility may resume prior to completion of Engineer's review or Owner's issuance of its statement to Contractor, because the Underground Facility in question and conditions affected by its presence have been adequately documented, and analyzed on a preliminary basis, then the Engineer may at its discretion instruct Contractor to resume such Work.
- F. *Possible Price and Times Adjustments*
 1. Contractor shall be entitled to an equitable adjustment in the Contract Price or Contract Times, to the extent that any existing Underground Facility at the Site that was not shown or indicated on the Drawings, or was not shown or indicated with reasonable accuracy, or any related delay, disruption, or interference, causes an increase or decrease in

Contractor's cost of, or time required for, performance of the Work; subject, however, to the following:

- a. With respect to Work that is paid for on a unit price basis, any adjustment in Contract Price will be subject to the provisions of Paragraph 13.03;
- b. Contractor's entitlement to an adjustment of the Contract Times is subject to the provisions of Paragraphs 4.05.D and 4.05.E; and
- c. Contractor gave the notice required in Paragraph 5.05.B.

2. If Owner and Contractor agree regarding Contractor's entitlement to and the amount or extent of any adjustment in the Contract Price or Contract Times, then any such adjustment will be set forth in a Change Order.
3. Contractor may submit a Change Proposal regarding its entitlement to or the amount or extent of any adjustment in the Contract Price or Contract Times, no later than 30 days after Owner's issuance of the Owner's written statement to Contractor regarding the Underground Facility in question.
4. The information and data shown or indicated on the Drawings with respect to existing Underground Facilities at the Site is based on information and data (a) furnished by the owners of such Underground Facilities, or by others, (b) obtained from available records, or (c) gathered in an investigation conducted in accordance with the current edition of ASCE 38, Standard Guideline for the Collection and Depiction of Existing Subsurface Utility Data, by the American Society of Civil Engineers. If such information or data is incorrect or incomplete, Contractor's remedies are limited to those set forth in this Paragraph 5.05.F.

5.06 *Hazardous Environmental Conditions at Site*

- A. *Reports and Drawings:* The Supplementary Conditions identify:
 1. those reports known to Owner relating to Hazardous Environmental Conditions that have been identified at or adjacent to the Site;
 2. drawings known to Owner relating to Hazardous Environmental Conditions that have been identified at or adjacent to the Site; and
 3. Technical Data contained in such reports and drawings.
- B. *Reliance by Contractor on Technical Data Authorized:* Contractor may rely upon the accuracy of the Technical Data expressly identified in the Supplementary Conditions with respect to such reports and drawings, but such reports and drawings are not Contract Documents. If no such express identification has been made, then Contractor may rely on the accuracy of the Technical Data as defined in Paragraph 1.01.A.46.b. Except for such reliance on Technical Data, Contractor may not rely upon or make any claim against Owner or Engineer, or any of their officers, directors, members, partners, employees, agents, consultants, or subcontractors, with respect to:
 1. the completeness of such reports and drawings for Contractor's purposes, including, but not limited to, any aspects of the means, methods, techniques, sequences and procedures

of construction to be employed by Contractor, and safety precautions and programs incident thereto;

2. other data, interpretations, opinions, and information contained in such reports or shown or indicated in such drawings; or
3. any Contractor interpretation of or conclusion drawn from any Technical Data or any such other data, interpretations, opinions or information.

C. Contractor shall not be responsible for removing or remediating any Hazardous Environmental Condition encountered, uncovered, or revealed at the Site unless such removal or remediation is expressly identified in the Contract Documents to be within the scope of the Work.

D. Contractor shall be responsible for controlling, containing, and duly removing all Constituents of Concern brought to the Site by Contractor, Subcontractors, Suppliers, or anyone else for whom Contractor is responsible, and for any associated costs; and for the costs of removing and remediating any Hazardous Environmental Condition created by the presence of any such Constituents of Concern.

E. If Contractor encounters, uncovers, or reveals a Hazardous Environmental Condition whose removal or remediation is not expressly identified in the Contract Documents as being within the scope of the Work, or if Contractor or anyone for whom Contractor is responsible creates a Hazardous Environmental Condition, then Contractor shall immediately: (1) secure or otherwise isolate such condition; (2) stop all Work in connection with such condition and in any area affected thereby (except in an emergency as required by Paragraph 7.15); and (3) notify Owner and Engineer (and promptly thereafter confirm such notice in writing). Owner shall promptly consult with Engineer concerning the necessity for Owner to retain a qualified expert to evaluate such condition or take corrective action, if any. Promptly after consulting with Engineer, Owner shall take such actions as are necessary to permit Owner to timely obtain required permits and provide Contractor the written notice required by Paragraph 5.06.F. If Contractor or anyone for whom Contractor is responsible created the Hazardous Environmental Condition in question, then Owner may remove and remediate the Hazardous Environmental Condition, and impose a set-off against payments to account for the associated costs.

F. Contractor shall not resume Work in connection with such Hazardous Environmental Condition or in any affected area until after Owner has obtained any required permits related thereto, and delivered written notice to Contractor either (1) specifying that such condition and any affected area is or has been rendered safe for the resumption of Work, or (2) specifying any special conditions under which such Work may be resumed safely.

G. If Owner and Contractor cannot agree as to entitlement to or on the amount or extent, if any, of any adjustment in Contract Price or Contract Times, as a result of such Work stoppage, such special conditions under which Work is agreed to be resumed by Contractor, or any costs or expenses incurred in response to the Hazardous Environmental Condition, then within 30 days of Owner's written notice regarding the resumption of Work, Contractor may submit a Change Proposal, or Owner may impose a set-off. Entitlement to any such adjustment is subject to the provisions of Paragraphs 4.05.D, 4.05.E, 11.07, and 11.08.

- H. If, after receipt of such written notice, Contractor does not agree to resume such Work based on a reasonable belief it is unsafe, or does not agree to resume such Work under such special conditions, then Owner may order the portion of the Work that is in the area affected by such condition to be deleted from the Work, following the contractual change procedures in Article 11. Owner may have such deleted portion of the Work performed by Owner's own forces or others in accordance with Article 8.
- I. To the fullest extent permitted by Laws and Regulations, Owner shall indemnify and hold harmless Contractor, Subcontractors, and Engineer, and the officers, directors, members, partners, employees, agents, consultants, and subcontractors of each and any of them, from and against all claims, costs, losses, and damages (including but not limited to all fees and charges of engineers, architects, attorneys, and other professionals, and all court, arbitration, or other dispute resolution costs) arising out of or relating to a Hazardous Environmental Condition, provided that such Hazardous Environmental Condition (1) was not shown or indicated in the Drawings, Specifications, or other Contract Documents, identified as Technical Data entitled to limited reliance pursuant to Paragraph 5.06.B, or identified in the Contract Documents to be included within the scope of the Work, and (2) was not created by Contractor or by anyone for whom Contractor is responsible. Nothing in this Paragraph 5.06.I obligates Owner to indemnify any individual or entity from and against the consequences of that individual's or entity's own negligence.
- J. To the fullest extent permitted by Laws and Regulations, Contractor shall indemnify and hold harmless Owner and Engineer, and the officers, directors, members, partners, employees, agents, consultants, and subcontractors of each and any of them, from and against all claims, costs, losses, and damages (including but not limited to all fees and charges of engineers, architects, attorneys, and other professionals and all court or arbitration or other dispute resolution costs) arising out of or relating to the failure to control, contain, or remove a Constituent of Concern brought to the Site by Contractor or by anyone for whom Contractor is responsible, or to a Hazardous Environmental Condition created by Contractor or by anyone for whom Contractor is responsible. Nothing in this Paragraph 5.06.J obligates Contractor to indemnify any individual or entity from and against the consequences of that individual's or entity's own negligence.
- K. The provisions of Paragraphs 5.03, 5.04, and 5.05 do not apply to the presence of Constituents of Concern or to a Hazardous Environmental Condition uncovered or revealed at the Site.

ARTICLE 6—BONDS AND INSURANCE

6.01 *Performance, Payment, and Other Bonds*

- A. Contractor shall furnish a performance bond and a payment bond, each in an amount at least equal to the Contract Price, as security for the faithful performance and payment of Contractor's obligations under the Contract. These bonds must remain in effect until one year after the date when final payment becomes due or until completion of the correction period specified in Paragraph 15.08, whichever is later, except as provided otherwise by Laws or Regulations, the terms of a prescribed bond form, the Supplementary Conditions, or other provisions of the Contract.

- B. Contractor shall also furnish such other bonds (if any) as are required by the Supplementary Conditions or other provisions of the Contract.
- C. All bonds must be in the form included in the Bidding Documents or otherwise specified by Owner prior to execution of the Contract, except as provided otherwise by Laws or Regulations, and must be issued and signed by a surety named in "Companies Holding Certificates of Authority as Acceptable Sureties on Federal Bonds and as Acceptable Reinsuring Companies" as published in Department Circular 570 (as amended and supplemented) by the Bureau of the Fiscal Service, U.S. Department of the Treasury. A bond signed by an agent or attorney-in-fact must be accompanied by a certified copy of that individual's authority to bind the surety. The evidence of authority must show that it is effective on the date the agent or attorney-in-fact signed the accompanying bond.
- D. Contractor shall obtain the required bonds from surety companies that are duly licensed or authorized, in the state or jurisdiction in which the Project is located, to issue bonds in the required amounts.
- E. If the surety on a bond furnished by Contractor is declared bankrupt or becomes insolvent, or the surety ceases to meet the requirements above, then Contractor shall promptly notify Owner and Engineer in writing and shall, within 20 days after the event giving rise to such notification, provide another bond and surety, both of which must comply with the bond and surety requirements above.
- F. If Contractor has failed to obtain a required bond, Owner may exclude the Contractor from the Site and exercise Owner's termination rights under Article 16.
- G. Upon request to Owner from any Subcontractor, Supplier, or other person or entity claiming to have furnished labor, services, materials, or equipment used in the performance of the Work, Owner shall provide a copy of the payment bond to such person or entity.
- H. Upon request to Contractor from any Subcontractor, Supplier, or other person or entity claiming to have furnished labor, services, materials, or equipment used in the performance of the Work, Contractor shall provide a copy of the payment bond to such person or entity.

6.02 *Insurance—General Provisions*

- A. Owner and Contractor shall obtain and maintain insurance as required in this article and in the Supplementary Conditions.
- B. All insurance required by the Contract to be purchased and maintained by Owner or Contractor shall be obtained from insurance companies that are duly licensed or authorized in the state or jurisdiction in which the Project is located to issue insurance policies for the required limits and coverages. Unless a different standard is indicated in the Supplementary Conditions, all companies that provide insurance policies required under this Contract shall have an A.M. Best rating of A-VII or better.
- C. Alternative forms of insurance coverage, including but not limited to self-insurance and "Occupational Accident and Excess Employer's Indemnity Policies," are not sufficient to meet the insurance requirements of this Contract, unless expressly allowed in the Supplementary Conditions.

- D. Contractor shall deliver to Owner, with copies to each additional insured identified in the Contract, certificates of insurance and endorsements establishing that Contractor has obtained and is maintaining the policies and coverages required by the Contract. Upon request by Owner or any other insured, Contractor shall also furnish other evidence of such required insurance, including but not limited to copies of policies, documentation of applicable self-insured retentions (if allowed) and deductibles, full disclosure of all relevant exclusions, and evidence of insurance required to be purchased and maintained by Subcontractors or Suppliers. In any documentation furnished under this provision, Contractor, Subcontractors, and Suppliers may block out (redact) (1) any confidential premium or pricing information and (2) any wording specific to a project or jurisdiction other than those applicable to this Contract.
- E. Owner shall deliver to Contractor, with copies to each additional insured identified in the Contract, certificates of insurance and endorsements establishing that Owner has obtained and is maintaining the policies and coverages required of Owner by the Contract (if any). Upon request by Contractor or any other insured, Owner shall also provide other evidence of such required insurance (if any), including but not limited to copies of policies, documentation of applicable self-insured retentions (if allowed) and deductibles, and full disclosure of all relevant exclusions. In any documentation furnished under this provision, Owner may block out (redact) (1) any confidential premium or pricing information and (2) any wording specific to a project or jurisdiction other than those relevant to this Contract.
- F. Failure of Owner or Contractor to demand such certificates or other evidence of the other party's full compliance with these insurance requirements, or failure of Owner or Contractor to identify a deficiency in compliance from the evidence provided, will not be construed as a waiver of the other party's obligation to obtain and maintain such insurance.
- G. In addition to the liability insurance required to be provided by Contractor, the Owner, at Owner's option, may purchase and maintain Owner's own liability insurance. Owner's liability policies, if any, operate separately and independently from policies required to be provided by Contractor, and Contractor cannot rely upon Owner's liability policies for any of Contractor's obligations to the Owner, Engineer, or third parties.
- H. Contractor shall require:
 - 1. Subcontractors to purchase and maintain worker's compensation, commercial general liability, and other insurance that is appropriate for their participation in the Project, and to name as additional insureds Owner and Engineer (and any other individuals or entities identified in the Supplementary Conditions as additional insureds on Contractor's liability policies) on each Subcontractor's commercial general liability insurance policy; and
 - 2. Suppliers to purchase and maintain insurance that is appropriate for their participation in the Project.
- I. If either party does not purchase or maintain the insurance required of such party by the Contract, such party shall notify the other party in writing of such failure to purchase prior to the start of the Work, or of such failure to maintain prior to any change in the required coverage.

- J. If Contractor has failed to obtain and maintain required insurance, Contractor's entitlement to enter or remain at the Site will end immediately, and Owner may impose an appropriate set-off against payment for any associated costs (including but not limited to the cost of purchasing necessary insurance coverage), and exercise Owner's termination rights under Article 16.
- K. Without prejudice to any other right or remedy, if a party has failed to obtain required insurance, the other party may elect (but is in no way obligated) to obtain equivalent insurance to protect such other party's interests at the expense of the party who was required to provide such coverage, and the Contract Price will be adjusted accordingly.
- L. Owner does not represent that insurance coverage and limits established in this Contract necessarily will be adequate to protect Contractor or Contractor's interests. Contractor is responsible for determining whether such coverage and limits are adequate to protect its interests, and for obtaining and maintaining any additional insurance that Contractor deems necessary.
- M. The insurance and insurance limits required herein will not be deemed as a limitation on Contractor's liability, or that of its Subcontractors or Suppliers, under the indemnities granted to Owner and other individuals and entities in the Contract or otherwise.
- N. All the policies of insurance required to be purchased and maintained under this Contract will contain a provision or endorsement that the coverage afforded will not be canceled, or renewal refused, until at least 10 days prior written notice has been given to the purchasing policyholder. Within three days of receipt of any such written notice, the purchasing policyholder shall provide a copy of the notice to each other insured and Engineer.

6.03 Contractor's Insurance

- A. *Required Insurance:* Contractor shall purchase and maintain Worker's Compensation, Commercial General Liability, and other insurance pursuant to the specific requirements of the Supplementary Conditions.
- B. *General Provisions:* The policies of insurance required by this Paragraph 6.03 as supplemented must:
 1. include at least the specific coverages required;
 2. be written for not less than the limits provided, or those required by Laws or Regulations, whichever is greater;
 3. remain in effect at least until the Work is complete (as set forth in Paragraph 15.06.D), and longer if expressly required elsewhere in this Contract, and at all times thereafter when Contractor may be correcting, removing, or replacing defective Work as a warranty or correction obligation, or otherwise, or returning to the Site to conduct other tasks arising from the Contract;
 4. apply with respect to the performance of the Work, whether such performance is by Contractor, any Subcontractor or Supplier, or by anyone directly or indirectly employed by any of them to perform any of the Work, or by anyone for whose acts any of them may be liable; and

5. include all necessary endorsements to support the stated requirements.
- C. *Additional Insureds:* The Contractor's commercial general liability, automobile liability, employer's liability, umbrella or excess, pollution liability, and unmanned aerial vehicle liability policies, if required by this Contract, must:
 1. include and list as additional insureds Owner and Engineer, and any individuals or entities identified as additional insureds in the Supplementary Conditions;
 2. include coverage for the respective officers, directors, members, partners, employees, and consultants of all such additional insureds;
 3. afford primary coverage to these additional insureds for all claims covered thereby (including as applicable those arising from both ongoing and completed operations);
 4. not seek contribution from insurance maintained by the additional insured; and
 5. as to commercial general liability insurance, apply to additional insureds with respect to liability caused in whole or in part by Contractor's acts or omissions, or the acts and omissions of those working on Contractor's behalf, in the performance of Contractor's operations.

6.04 *Builder's Risk and Other Property Insurance*

- A. *Builder's Risk:* Unless otherwise provided in the Supplementary Conditions, Contractor shall purchase and maintain builder's risk insurance upon the Work on a completed value basis, in the amount of the Work's full insurable replacement cost (subject to such deductible amounts as may be provided in the Supplementary Conditions or required by Laws and Regulations). The specific requirements applicable to the builder's risk insurance are set forth in the Supplementary Conditions.
- B. *Property Insurance for Facilities of Owner Where Work Will Occur:* Owner is responsible for obtaining and maintaining property insurance covering each existing structure, building, or facility in which any part of the Work will occur, or to which any part of the Work will attach or be adjoined. Such property insurance will be written on a special perils (all-risk) form, on a replacement cost basis, providing coverage consistent with that required for the builder's risk insurance, and will be maintained until the Work is complete, as set forth in Paragraph 15.06.D.
- C. *Property Insurance for Substantially Complete Facilities:* Promptly after Substantial Completion, and before actual occupancy or use of the substantially completed Work, Owner will obtain property insurance for such substantially completed Work, and maintain such property insurance at least until the Work is complete, as set forth in Paragraph 15.06.D. Such property insurance will be written on a special perils (all-risk) form, on a replacement cost basis, and provide coverage consistent with that required for the builder's risk insurance. The builder's risk insurance may terminate upon written confirmation of Owner's procurement of such property insurance.
- D. *Partial Occupancy or Use by Owner:* If Owner will occupy or use a portion or portions of the Work prior to Substantial Completion of all the Work, as provided in Paragraph 15.04, then Owner (directly, if it is the purchaser of the builder's risk policy, or through Contractor) will

provide advance notice of such occupancy or use to the builder's risk insurer, and obtain an endorsement consenting to the continuation of coverage prior to commencing such partial occupancy or use.

E. *Insurance of Other Property; Additional Insurance:* If the express insurance provisions of the Contract do not require or address the insurance of a property item or interest, then the entity or individual owning such property item will be responsible for insuring it. If Contractor elects to obtain other special insurance to be included in or supplement the builder's risk or property insurance policies provided under this Paragraph 6.04, it may do so at Contractor's expense.

6.05 *Property Losses; Subrogation*

A. The builder's risk insurance policy purchased and maintained in accordance with Paragraph 6.04 (or an installation floater policy if authorized by the Supplementary Conditions), will contain provisions to the effect that in the event of payment of any loss or damage the insurer will have no rights of recovery against any insureds thereunder, or against Engineer or its consultants, or their officers, directors, members, partners, employees, agents, consultants, or subcontractors.

1. Owner and Contractor waive all rights against each other and the respective officers, directors, members, partners, employees, agents, consultants, and subcontractors of each and any of them, for all losses and damages caused by, arising out of, or resulting from any of the perils, risks, or causes of loss covered by such policies and any other property insurance applicable to the Work; and, in addition, waive all such rights against Engineer, its consultants, all individuals or entities identified in the Supplementary Conditions as builder's risk or installation floater insureds, and the officers, directors, members, partners, employees, agents, consultants, and subcontractors of each and any of them, under such policies for losses and damages so caused.
2. None of the above waivers extends to the rights that any party making such waiver may have to the proceeds of insurance held by Owner or Contractor as trustee or fiduciary, or otherwise payable under any policy so issued.

B. Any property insurance policy maintained by Owner covering any loss, damage, or consequential loss to Owner's existing structures, buildings, or facilities in which any part of the Work will occur, or to which any part of the Work will attach or adjoin; to adjacent structures, buildings, or facilities of Owner; or to part or all of the completed or substantially completed Work, during partial occupancy or use pursuant to Paragraph 15.04, after Substantial Completion pursuant to Paragraph 15.03, or after final payment pursuant to Paragraph 15.06, will contain provisions to the effect that in the event of payment of any loss or damage the insurer will have no rights of recovery against any insureds thereunder, or against Contractor, Subcontractors, or Engineer, or the officers, directors, members, partners, employees, agents, consultants, or subcontractors of each and any of them, and that the insured is allowed to waive the insurer's rights of subrogation in a written contract executed prior to the loss, damage, or consequential loss.

1. Owner waives all rights against Contractor, Subcontractors, and Engineer, and the officers, directors, members, partners, employees, agents, consultants and subcontractors of each and any of them, for all losses and damages caused by, arising out

of, or resulting from fire or any of the perils, risks, or causes of loss covered by such policies.

- C. The waivers in this Paragraph 6.05 include the waiver of rights due to business interruption, loss of use, or other consequential loss extending beyond direct physical loss or damage to Owner's property or the Work caused by, arising out of, or resulting from fire or other insured peril, risk, or cause of loss.
- D. Contractor shall be responsible for assuring that each Subcontract contains provisions whereby the Subcontractor waives all rights against Owner, Contractor, all individuals or entities identified in the Supplementary Conditions as insureds, the Engineer and its consultants, and the officers, directors, members, partners, employees, agents, consultants, and subcontractors of each and any of them, for all losses and damages caused by, arising out of, relating to, or resulting from fire or other peril, risk, or cause of loss covered by builder's risk insurance, installation floater, and any other property insurance applicable to the Work.

6.06 Receipt and Application of Property Insurance Proceeds

- A. Any insured loss under the builder's risk and other policies of property insurance required by Paragraph 6.04 will be adjusted and settled with the named insured that purchased the policy. Such named insured shall act as fiduciary for the other insureds, and give notice to such other insureds that adjustment and settlement of a claim is in progress. Any other insured may state its position regarding a claim for insured loss in writing within 15 days after notice of such claim.
- B. Proceeds for such insured losses may be made payable by the insurer either jointly to multiple insureds, or to the named insured that purchased the policy in its own right and as fiduciary for other insureds, subject to the requirements of any applicable mortgage clause. A named insured receiving insurance proceeds under the builder's risk and other policies of insurance required by Paragraph 6.04 shall maintain such proceeds in a segregated account, and distribute such proceeds in accordance with such agreement as the parties in interest may reach, or as otherwise required under the dispute resolution provisions of this Contract or applicable Laws and Regulations.
- C. If no other special agreement is reached, Contractor shall repair or replace the damaged Work, using allocated insurance proceeds.

ARTICLE 7—CONTRACTOR'S RESPONSIBILITIES

7.01 Contractor's Means and Methods of Construction

- A. Contractor shall be solely responsible for the means, methods, techniques, sequences, and procedures of construction.
- B. If the Contract Documents note, or Contractor determines, that professional engineering or other design services are needed to carry out Contractor's responsibilities for construction means, methods, techniques, sequences, and procedures, or for Site safety, then Contractor shall cause such services to be provided by a properly licensed design professional, at Contractor's expense. Such services are not Owner-delegated professional design services under this Contract, and neither Owner nor Engineer has any responsibility with respect to

(1) Contractor's determination of the need for such services, (2) the qualifications or licensing of the design professionals retained or employed by Contractor, (3) the performance of such services, or (4) any errors, omissions, or defects in such services.

7.02 *Supervision and Superintendence*

- A. Contractor shall supervise, inspect, and direct the Work competently and efficiently, devoting such attention thereto and applying such skills and expertise as may be necessary to perform the Work in accordance with the Contract Documents.
- B. At all times during the progress of the Work, Contractor shall assign a competent resident superintendent who will not be replaced without written notice to Owner and Engineer except under extraordinary circumstances.

7.03 *Labor; Working Hours*

- A. Contractor shall provide competent, suitably qualified personnel to survey and lay out the Work and perform construction as required by the Contract Documents. Contractor shall maintain good discipline and order at the Site.
- B. Contractor shall be fully responsible to Owner and Engineer for all acts and omissions of Contractor's employees; of Suppliers and Subcontractors, and their employees; and of any other individuals or entities performing or furnishing any of the Work, just as Contractor is responsible for Contractor's own acts and omissions.
- C. Except as otherwise required for the safety or protection of persons or the Work or property at the Site or adjacent thereto, and except as otherwise stated in the Contract Documents, all Work at the Site will be performed during regular working hours, Monday through Friday. Contractor will not perform Work on a Saturday, Sunday, or any legal holiday. Contractor may perform Work outside regular working hours or on Saturdays, Sundays, or legal holidays only with Owner's written consent, which will not be unreasonably withheld.

7.04 *Services, Materials, and Equipment*

- A. Unless otherwise specified in the Contract Documents, Contractor shall provide and assume full responsibility for all services, materials, equipment, labor, transportation, construction equipment and machinery, tools, appliances, fuel, power, light, heat, telephone, water, sanitary facilities, temporary facilities, and all other facilities and incidentals necessary for the performance, testing, start up, and completion of the Work, whether or not such items are specifically called for in the Contract Documents.
- B. All materials and equipment incorporated into the Work must be new and of good quality, except as otherwise provided in the Contract Documents. All special warranties and guarantees required by the Specifications will expressly run to the benefit of Owner. If required by Engineer, Contractor shall furnish satisfactory evidence (including reports of required tests) as to the source, kind, and quality of materials and equipment.
- C. All materials and equipment must be stored, applied, installed, connected, erected, protected, used, cleaned, and conditioned in accordance with instructions of the applicable Supplier, except as otherwise may be provided in the Contract Documents.

7.05 *"Or Equals"*

- A. *Contractor's Request; Governing Criteria:* Whenever an item of equipment or material is specified or described in the Contract Documents by using the names of one or more proprietary items or specific Suppliers, the Contract Price has been based upon Contractor furnishing such item as specified. The specification or description of such an item is intended to establish the type, function, appearance, and quality required. Unless the specification or description contains or is followed by words reading that no like, equivalent, or "or equal" item is permitted, Contractor may request that Engineer authorize the use of other items of equipment or material, or items from other proposed Suppliers, under the circumstances described below.
 1. If Engineer in its sole discretion determines that an item of equipment or material proposed by Contractor is functionally equal to that named and sufficiently similar so that no change in related Work will be required, Engineer will deem it an "or equal" item. For the purposes of this paragraph, a proposed item of equipment or material will be considered functionally equal to an item so named if:
 - a. in the exercise of reasonable judgment Engineer determines that the proposed item:
 - 1) is at least equal in materials of construction, quality, durability, appearance, strength, and design characteristics;
 - 2) will reliably perform at least equally well the function and achieve the results imposed by the design concept of the completed Project as a functioning whole;
 - 3) has a proven record of performance and availability of responsive service; and
 - 4) is not objectionable to Owner.
 - b. Contractor certifies that, if the proposed item is approved and incorporated into the Work:
 - 1) there will be no increase in cost to the Owner or increase in Contract Times; and
 - 2) the item will conform substantially to the detailed requirements of the item named in the Contract Documents.
- B. *Contractor's Expense:* Contractor shall provide all data in support of any proposed "or equal" item at Contractor's expense.
- C. *Engineer's Evaluation and Determination:* Engineer will be allowed a reasonable time to evaluate each "or-equal" request. Engineer may require Contractor to furnish additional data about the proposed "or-equal" item. Engineer will be the sole judge of acceptability. No "or-equal" item will be ordered, furnished, installed, or utilized until Engineer's review is complete and Engineer determines that the proposed item is an "or-equal," which will be evidenced by an approved Shop Drawing or other written communication. Engineer will advise Contractor in writing of any negative determination.
- D. *Effect of Engineer's Determination:* Neither approval nor denial of an "or-equal" request will result in any change in Contract Price. The Engineer's denial of an "or-equal" request will be final and binding, and may not be reversed through an appeal under any provision of the Contract.

E. *Treatment as a Substitution Request:* If Engineer determines that an item of equipment or material proposed by Contractor does not qualify as an "or-equal" item, Contractor may request that Engineer consider the item a proposed substitute pursuant to Paragraph 7.06.

7.06 *Substitutes*

A. *Contractor's Request; Governing Criteria:* Unless the specification or description of an item of equipment or material required to be furnished under the Contract Documents contains or is followed by words reading that no substitution is permitted, Contractor may request that Engineer authorize the use of other items of equipment or material under the circumstances described below. To the extent possible such requests must be made before commencement of related construction at the Site.

1. Contractor shall submit sufficient information as provided below to allow Engineer to determine if the item of material or equipment proposed is functionally equivalent to that named and an acceptable substitute therefor. Engineer will not accept requests for review of proposed substitute items of equipment or material from anyone other than Contractor.
2. The requirements for review by Engineer will be as set forth in Paragraph 7.06.B, as supplemented by the Specifications, and as Engineer may decide is appropriate under the circumstances.
3. Contractor shall make written application to Engineer for review of a proposed substitute item of equipment or material that Contractor seeks to furnish or use. The application:
 - a. will certify that the proposed substitute item will:
 - 1) perform adequately the functions and achieve the results called for by the general design;
 - 2) be similar in substance to the item specified; and
 - 3) be suited to the same use as the item specified.
 - b. will state:
 - 1) the extent, if any, to which the use of the proposed substitute item will necessitate a change in Contract Times;
 - 2) whether use of the proposed substitute item in the Work will require a change in any of the Contract Documents (or in the provisions of any other direct contract with Owner for other work on the Project) to adapt the design to the proposed substitute item; and
 - 3) whether incorporation or use of the proposed substitute item in connection with the Work is subject to payment of any license fee or royalty.
 - c. will identify:
 - 1) all variations of the proposed substitute item from the item specified; and
 - 2) available engineering, sales, maintenance, repair, and replacement services.

- d. will contain an itemized estimate of all costs or credits that will result directly or indirectly from use of such substitute item, including but not limited to changes in Contract Price, shared savings, costs of redesign, and claims of other contractors affected by any resulting change.
- B. *Engineer's Evaluation and Determination:* Engineer will be allowed a reasonable time to evaluate each substitute request, and to obtain comments and direction from Owner. Engineer may require Contractor to furnish additional data about the proposed substitute item. Engineer will be the sole judge of acceptability. No substitute will be ordered, furnished, installed, or utilized until Engineer's review is complete and Engineer determines that the proposed item is an acceptable substitute. Engineer's determination will be evidenced by a Field Order or a proposed Change Order accounting for the substitution itself and all related impacts, including changes in Contract Price or Contract Times. Engineer will advise Contractor in writing of any negative determination.
- C. *Special Guarantee:* Owner may require Contractor to furnish at Contractor's expense a special performance guarantee or other surety with respect to any substitute.
- D. *Reimbursement of Engineer's Cost:* Engineer will record Engineer's costs in evaluating a substitute proposed or submitted by Contractor. Whether or not Engineer approves a substitute so proposed or submitted by Contractor, Contractor shall reimburse Owner for the reasonable charges of Engineer for evaluating each such proposed substitute. Contractor shall also reimburse Owner for the reasonable charges of Engineer for making changes in the Contract Documents (or in the provisions of any other direct contract with Owner) resulting from the acceptance of each proposed substitute.
- E. *Contractor's Expense:* Contractor shall provide all data in support of any proposed substitute at Contractor's expense.
- F. *Effect of Engineer's Determination:* If Engineer approves the substitution request, Contractor shall execute the proposed Change Order and proceed with the substitution. The Engineer's denial of a substitution request will be final and binding, and may not be reversed through an appeal under any provision of the Contract. Contractor may challenge the scope of reimbursement costs imposed under Paragraph 7.06.D, by timely submittal of a Change Proposal.

7.07 *Concerning Subcontractors and Suppliers*

- A. Contractor may retain Subcontractors and Suppliers for the performance of parts of the Work. Such Subcontractors and Suppliers must be acceptable to Owner. The Contractor's retention of a Subcontractor or Supplier for the performance of parts of the Work will not relieve Contractor's obligation to Owner to perform and complete the Work in accordance with the Contract Documents.
- B. Contractor shall retain specific Subcontractors and Suppliers for the performance of designated parts of the Work if required by the Contract to do so.
- C. Subsequent to the submittal of Contractor's Bid or final negotiation of the terms of the Contract, Owner may not require Contractor to retain any Subcontractor or Supplier to furnish or perform any of the Work against which Contractor has reasonable objection.

- D. Prior to entry into any binding subcontract or purchase order, Contractor shall submit to Owner the identity of the proposed Subcontractor or Supplier (unless Owner has already deemed such proposed Subcontractor or Supplier acceptable during the bidding process or otherwise). Such proposed Subcontractor or Supplier shall be deemed acceptable to Owner unless Owner raises a substantive, reasonable objection within 5 days.
- E. Owner may require the replacement of any Subcontractor or Supplier. Owner also may require Contractor to retain specific replacements; provided, however, that Owner may not require a replacement to which Contractor has a reasonable objection. If Contractor has submitted the identity of certain Subcontractors or Suppliers for acceptance by Owner, and Owner has accepted it (either in writing or by failing to make written objection thereto), then Owner may subsequently revoke the acceptance of any such Subcontractor or Supplier so identified solely on the basis of substantive, reasonable objection after due investigation. Contractor shall submit an acceptable replacement for the rejected Subcontractor or Supplier.
- F. If Owner requires the replacement of any Subcontractor or Supplier retained by Contractor to perform any part of the Work, then Contractor shall be entitled to an adjustment in Contract Price or Contract Times, with respect to the replacement; and Contractor shall initiate a Change Proposal for such adjustment within 30 days of Owner's requirement of replacement.
- G. No acceptance by Owner of any such Subcontractor or Supplier, whether initially or as a replacement, will constitute a waiver of the right of Owner to the completion of the Work in accordance with the Contract Documents.
- H. On a monthly basis, Contractor shall submit to Engineer a complete list of all Subcontractors and Suppliers having a direct contract with Contractor, and of all other Subcontractors and Suppliers known to Contractor at the time of submittal.
- I. Contractor shall be solely responsible for scheduling and coordinating the work of Subcontractors and Suppliers.
- J. The divisions and sections of the Specifications and the identifications of any Drawings do not control Contractor in dividing the Work among Subcontractors or Suppliers, or in delineating the Work to be performed by any specific trade.
- K. All Work performed for Contractor by a Subcontractor or Supplier must be pursuant to an appropriate contractual agreement that specifically binds the Subcontractor or Supplier to the applicable terms and conditions of the Contract for the benefit of Owner and Engineer.
- L. Owner may furnish to any Subcontractor or Supplier, to the extent practicable, information about amounts paid to Contractor for Work performed for Contractor by the Subcontractor or Supplier.
- M. Contractor shall restrict all Subcontractors and Suppliers from communicating with Engineer or Owner, except through Contractor or in case of an emergency, or as otherwise expressly allowed in this Contract.

7.08 *Patent Fees and Royalties*

- A. Contractor shall pay all license fees and royalties and assume all costs incident to the use in the performance of the Work or the incorporation in the Work of any invention, design, process, product, or device which is the subject of patent rights or copyrights held by others. If an invention, design, process, product, or device is specified in the Contract Documents for use in the performance of the Work and if, to the actual knowledge of Owner or Engineer, its use is subject to patent rights or copyrights calling for the payment of any license fee or royalty to others, the existence of such rights will be disclosed in the Contract Documents.
- B. To the fullest extent permitted by Laws and Regulations, Owner shall indemnify and hold harmless Contractor, and its officers, directors, members, partners, employees, agents, consultants, and subcontractors, from and against all claims, costs, losses, and damages (including but not limited to all fees and charges of engineers, architects, attorneys, and other professionals, and all court or arbitration or other dispute resolution costs) arising out of or relating to any infringement of patent rights or copyrights incident to the use in the performance of the Work or resulting from the incorporation in the Work of any invention, design, process, product, or device specified in the Contract Documents, but not identified as being subject to payment of any license fee or royalty to others required by patent rights or copyrights.
- C. To the fullest extent permitted by Laws and Regulations, Contractor shall indemnify and hold harmless Owner and Engineer, and the officers, directors, members, partners, employees, agents, consultants and subcontractors of each and any of them, from and against all claims, costs, losses, and damages (including but not limited to all fees and charges of engineers, architects, attorneys, and other professionals and all court or arbitration or other dispute resolution costs) arising out of or relating to any infringement of patent rights or copyrights incident to the use in the performance of the Work or resulting from the incorporation in the Work of any invention, design, process, product, or device not specified in the Contract Documents.

7.09 *Permits*

- A. Unless otherwise provided in the Contract Documents, Contractor shall obtain and pay for all construction permits, licenses, and certificates of occupancy. Owner shall assist Contractor, when necessary, in obtaining such permits and licenses. Contractor shall pay all governmental charges and inspection fees necessary for the prosecution of the Work which are applicable at the time of the submission of Contractor's Bid (or when Contractor became bound under a negotiated contract). Owner shall pay all charges of utility owners for connections for providing permanent service to the Work.

7.10 *Taxes*

- A. Contractor shall pay all sales, consumer, use, and other similar taxes required to be paid by Contractor in accordance with the Laws and Regulations of the place of the Project which are applicable during the performance of the Work.

7.11 *Laws and Regulations*

- A. Contractor shall give all notices required by and shall comply with all Laws and Regulations applicable to the performance of the Work. Neither Owner nor Engineer shall be responsible for monitoring Contractor's compliance with any Laws or Regulations.
- B. If Contractor performs any Work or takes any other action knowing or having reason to know that it is contrary to Laws or Regulations, Contractor shall bear all resulting costs and losses, and shall indemnify and hold harmless Owner and Engineer, and the officers, directors, members, partners, employees, agents, consultants, and subcontractors of each and any of them, from and against all claims, costs, losses, and damages (including but not limited to all fees and charges of engineers, architects, attorneys, and other professionals and all court or arbitration or other dispute resolution costs) arising out of or relating to such Work or other action. It is not Contractor's responsibility to make certain that the Work described in the Contract Documents is in accordance with Laws and Regulations, but this does not relieve Contractor of its obligations under Paragraph 3.03.
- C. Owner or Contractor may give written notice to the other party of any changes after the submission of Contractor's Bid (or after the date when Contractor became bound under a negotiated contract) in Laws or Regulations having an effect on the cost or time of performance of the Work, including but not limited to changes in Laws or Regulations having an effect on procuring permits and on sales, use, value-added, consumption, and other similar taxes. If Owner and Contractor are unable to agree on entitlement to or on the amount or extent, if any, of any adjustment in Contract Price or Contract Times resulting from such changes, then within 30 days of such written notice Contractor may submit a Change Proposal, or Owner may initiate a Claim.

7.12 *Record Documents*

- A. Contractor shall maintain in a safe place at the Site one printed record copy of all Drawings, Specifications, Addenda, Change Orders, Work Change Directives, Field Orders, written interpretations and clarifications, and approved Shop Drawings. Contractor shall keep such record documents in good order and annotate them to show changes made during construction. These record documents, together with all approved Samples, will be available to Engineer for reference. Upon completion of the Work, Contractor shall deliver these record documents to Engineer.

7.13 *Safety and Protection*

- A. Contractor shall be solely responsible for initiating, maintaining, and supervising all safety precautions and programs in connection with the Work. Such responsibility does not relieve Subcontractors of their responsibility for the safety of persons or property in the performance of their work, nor for compliance with applicable safety Laws and Regulations.
- B. Contractor shall designate a qualified and experienced safety representative whose duties and responsibilities are the prevention of Work-related accidents and the maintenance and supervision of safety precautions and programs.

- C. Contractor shall take all necessary precautions for the safety of, and shall provide the necessary protection to prevent damage, injury, or loss to:
 - 1. all persons on the Site or who may be affected by the Work;
 - 2. all the Work and materials and equipment to be incorporated therein, whether in storage on or off the Site; and
 - 3. other property at the Site or adjacent thereto, including trees, shrubs, lawns, walks, pavements, roadways, structures, other work in progress, utilities, and Underground Facilities not designated for removal, relocation, or replacement in the course of construction.
- D. All damage, injury, or loss to any property referred to in Paragraph 7.13.C.2 or 7.13.C.3 caused, directly or indirectly, in whole or in part, by Contractor, any Subcontractor, Supplier, or any other individual or entity directly or indirectly employed by any of them to perform any of the Work, or anyone for whose acts any of them may be liable, shall be remedied by Contractor at its expense (except damage or loss attributable to the fault of Drawings or Specifications or to the acts or omissions of Owner or Engineer or anyone employed by any of them, or anyone for whose acts any of them may be liable, and not attributable, directly or indirectly, in whole or in part, to the fault or negligence of Contractor or any Subcontractor, Supplier, or other individual or entity directly or indirectly employed by any of them).
- E. Contractor shall comply with all applicable Laws and Regulations relating to the safety of persons or property, or to the protection of persons or property from damage, injury, or loss; and shall erect and maintain all necessary safeguards for such safety and protection.
- F. Contractor shall notify Owner; the owners of adjacent property; the owners of Underground Facilities and other utilities (if the identity of such owners is known to Contractor); and other contractors and utility owners performing work at or adjacent to the Site, in writing, when Contractor knows that prosecution of the Work may affect them, and shall cooperate with them in the protection, removal, relocation, and replacement of their property or work in progress.
- G. Contractor shall comply with the applicable requirements of Owner's safety programs, if any. Any Owner's safety programs that are applicable to the Work are identified or included in the Supplementary Conditions or Specifications.
- H. Contractor shall inform Owner and Engineer of the specific requirements of Contractor's safety program with which Owner's and Engineer's employees and representatives must comply while at the Site.
- I. Contractor's duties and responsibilities for safety and protection will continue until all the Work is completed, Engineer has issued a written notice to Owner and Contractor in accordance with Paragraph 15.06.C that the Work is acceptable, and Contractor has left the Site (except as otherwise expressly provided in connection with Substantial Completion).
- J. Contractor's duties and responsibilities for safety and protection will resume whenever Contractor or any Subcontractor or Supplier returns to the Site to fulfill warranty or correction obligations, or to conduct other tasks arising from the Contract Documents.

7.14 *Hazard Communication Programs*

- A. Contractor shall be responsible for coordinating any exchange of safety data sheets (formerly known as material safety data sheets) or other hazard communication information required to be made available to or exchanged between or among employers at the Site in accordance with Laws or Regulations.

7.15 *Emergencies*

- A. In emergencies affecting the safety or protection of persons or the Work or property at the Site or adjacent thereto, Contractor is obligated to act to prevent damage, injury, or loss. Contractor shall give Engineer prompt written notice if Contractor believes that any significant changes in the Work or variations from the Contract Documents have been caused by an emergency, or are required as a result of Contractor's response to an emergency. If Engineer determines that a change in the Contract Documents is required because of an emergency or Contractor's response, a Work Change Directive or Change Order will be issued.

7.16 *Submittals*

A. *Shop Drawing and Sample Requirements*

1. Before submitting a Shop Drawing or Sample, Contractor shall:
 - a. review and coordinate the Shop Drawing or Sample with other Shop Drawings and Samples and with the requirements of the Work and the Contract Documents;
 - b. determine and verify:
 - 1) all field measurements, quantities, dimensions, specified performance and design criteria, installation requirements, materials, catalog numbers, and similar information with respect to the Submittal;
 - 2) the suitability of all materials and equipment offered with respect to the indicated application, fabrication, shipping, handling, storage, assembly, and installation pertaining to the performance of the Work; and
 - 3) all information relative to Contractor's responsibilities for means, methods, techniques, sequences, and procedures of construction, and safety precautions and programs incident thereto;
 - c. confirm that the Submittal is complete with respect to all related data included in the Submittal.
2. Each Shop Drawing or Sample must bear a stamp or specific written certification that Contractor has satisfied Contractor's obligations under the Contract Documents with respect to Contractor's review of that Submittal, and that Contractor approves the Submittal.
3. With each Shop Drawing or Sample, Contractor shall give Engineer specific written notice of any variations that the Submittal may have from the requirements of the Contract Documents. This notice must be set forth in a written communication separate from the Submittal; and, in addition, in the case of a Shop Drawing by a specific notation made on the Shop Drawing itself.

B. *Submittal Procedures for Shop Drawings and Samples:* Contractor shall label and submit Shop Drawings and Samples to Engineer for review and approval in accordance with the accepted Schedule of Submittals.

1. *Shop Drawings*

- a. Contractor shall submit the number of copies required in the Specifications.
- b. Data shown on the Shop Drawings must be complete with respect to quantities, dimensions, specified performance and design criteria, materials, and similar data to show Engineer the services, materials, and equipment Contractor proposes to provide, and to enable Engineer to review the information for the limited purposes required by Paragraph 7.16.C.

2. *Samples*

- a. Contractor shall submit the number of Samples required in the Specifications.
- b. Contractor shall clearly identify each Sample as to material, Supplier, pertinent data such as catalog numbers, the use for which intended and other data as Engineer may require to enable Engineer to review the Submittal for the limited purposes required by Paragraph 7.16.C.
3. Where a Shop Drawing or Sample is required by the Contract Documents or the Schedule of Submittals, any related Work performed prior to Engineer's review and approval of the pertinent submittal will be at the sole expense and responsibility of Contractor.

C. *Engineer's Review of Shop Drawings and Samples*

1. Engineer will provide timely review of Shop Drawings and Samples in accordance with the accepted Schedule of Submittals. Engineer's review and approval will be only to determine if the items covered by the Submittals will, after installation or incorporation in the Work, comply with the requirements of the Contract Documents, and be compatible with the design concept of the completed Project as a functioning whole as indicated by the Contract Documents.
2. Engineer's review and approval will not extend to means, methods, techniques, sequences, or procedures of construction, or to safety precautions or programs incident thereto.
3. Engineer's review and approval of a separate item as such will not indicate approval of the assembly in which the item functions.
4. Engineer's review and approval of a Shop Drawing or Sample will not relieve Contractor from responsibility for any variation from the requirements of the Contract Documents unless Contractor has complied with the requirements of Paragraph 7.16.A.3 and Engineer has given written approval of each such variation by specific written notation thereof incorporated in or accompanying the Shop Drawing or Sample. Engineer will document any such approved variation from the requirements of the Contract Documents in a Field Order or other appropriate Contract modification.
5. Engineer's review and approval of a Shop Drawing or Sample will not relieve Contractor from responsibility for complying with the requirements of Paragraphs 7.16.A and B.

6. Engineer's review and approval of a Shop Drawing or Sample, or of a variation from the requirements of the Contract Documents, will not, under any circumstances, change the Contract Times or Contract Price, unless such changes are included in a Change Order.
7. Neither Engineer's receipt, review, acceptance, or approval of a Shop Drawing or Sample will result in such item becoming a Contract Document.
8. Contractor shall perform the Work in compliance with the requirements and commitments set forth in approved Shop Drawings and Samples, subject to the provisions of Paragraph 7.16.C.4.

D. Resubmittal Procedures for Shop Drawings and Samples

1. Contractor shall make corrections required by Engineer and shall return the required number of corrected copies of Shop Drawings and submit, as required, new Samples for review and approval. Contractor shall direct specific attention in writing to revisions other than the corrections called for by Engineer on previous Submittals.
2. Contractor shall furnish required Shop Drawing and Sample submittals with sufficient information and accuracy to obtain required approval of an item with no more than two resubmittals. Engineer will record Engineer's time for reviewing a third or subsequent resubmittal of a Shop Drawing or Sample, and Contractor shall be responsible for Engineer's charges to Owner for such time. Owner may impose a set-off against payments due Contractor to secure reimbursement for such charges.
3. If Contractor requests a change of a previously approved Shop Drawing or Sample, Contractor shall be responsible for Engineer's charges to Owner for its review time, and Owner may impose a set-off against payments due Contractor to secure reimbursement for such charges, unless the need for such change is beyond the control of Contractor.

E. Submittals Other than Shop Drawings, Samples, and Owner-Delegated Designs

1. The following provisions apply to all Submittals other than Shop Drawings, Samples, and Owner-delegated designs:
 - a. Contractor shall submit all such Submittals to the Engineer in accordance with the Schedule of Submittals and pursuant to the applicable terms of the Contract Documents.
 - b. Engineer will provide timely review of all such Submittals in accordance with the Schedule of Submittals and return such Submittals with a notation of either Accepted or Not Accepted. Any such Submittal that is not returned within the time established in the Schedule of Submittals will be deemed accepted.
 - c. Engineer's review will be only to determine if the Submittal is acceptable under the requirements of the Contract Documents as to general form and content of the Submittal.
 - d. If any such Submittal is not accepted, Contractor shall confer with Engineer regarding the reason for the non-acceptance, and resubmit an acceptable document.
2. Procedures for the submittal and acceptance of the Progress Schedule, the Schedule of Submittals, and the Schedule of Values are set forth in Paragraphs 2.03. 2.04, and 2.05.

F. Owner-delegated Designs: Submittals pursuant to Owner-delegated designs are governed by the provisions of Paragraph 7.19.

7.17 *Contractor's General Warranty and Guarantee*

- A. Contractor warrants and guarantees to Owner that all Work will be in accordance with the Contract Documents and will not be defective. Engineer is entitled to rely on Contractor's warranty and guarantee.
- B. Owner's rights under this warranty and guarantee are in addition to, and are not limited by, Owner's rights under the correction period provisions of Paragraph 15.08. The time in which Owner may enforce its warranty and guarantee rights under this Paragraph 7.17 is limited only by applicable Laws and Regulations restricting actions to enforce such rights; provided, however, that after the end of the correction period under Paragraph 15.08:
 1. Owner shall give Contractor written notice of any defective Work within 60 days of the discovery that such Work is defective; and
 2. Such notice will be deemed the start of an event giving rise to a Claim under Paragraph 12.01.B, such that any related Claim must be brought within 30 days of the notice.
- C. Contractor's warranty and guarantee hereunder excludes defects or damage caused by:
 1. abuse, or improper modification, maintenance, or operation, by persons other than Contractor, Subcontractors, Suppliers, or any other individual or entity for whom Contractor is responsible; or
 2. normal wear and tear under normal usage.
- D. Contractor's obligation to perform and complete the Work in accordance with the Contract Documents is absolute. None of the following will constitute an acceptance of Work that is not in accordance with the Contract Documents, a release of Contractor's obligation to perform the Work in accordance with the Contract Documents, or a release of Owner's warranty and guarantee rights under this Paragraph 7.17:
 1. Observations by Engineer;
 2. Recommendation by Engineer or payment by Owner of any progress or final payment;
 3. The issuance of a certificate of Substantial Completion by Engineer or any payment related thereto by Owner;
 4. Use or occupancy of the Work or any part thereof by Owner;
 5. Any review and approval of a Shop Drawing or Sample submittal;
 6. The issuance of a notice of acceptability by Engineer;
 7. The end of the correction period established in Paragraph 15.08;
 8. Any inspection, test, or approval by others; or
 9. Any correction of defective Work by Owner.

E. If the Contract requires the Contractor to accept the assignment of a contract entered into by Owner, then the specific warranties, guarantees, and correction obligations contained in the assigned contract will govern with respect to Contractor's performance obligations to Owner for the Work described in the assigned contract.

7.18 *Indemnification*

- A. To the fullest extent permitted by Laws and Regulations, and in addition to any other obligations of Contractor under the Contract or otherwise, Contractor shall indemnify and hold harmless Owner and Engineer, and the officers, directors, members, partners, employees, agents, consultants and subcontractors of each and any of them, from losses, damages, costs, and judgments (including but not limited to all fees and charges of engineers, architects, attorneys, and other professionals, and all court or arbitration or other dispute resolution costs) arising from third-party claims or actions relating to or resulting from the performance or furnishing of the Work, provided that any such claim, action, loss, cost, judgment or damage is attributable to bodily injury, sickness, disease, or death, or to damage to or destruction of tangible property (other than the Work itself), including the loss of use resulting therefrom, but only to the extent caused by any negligent act or omission of Contractor, any Subcontractor, any Supplier, or any individual or entity directly or indirectly employed by any of them to perform any of the Work, or anyone for whose acts any of them may be liable.
- B. In any and all claims against Owner or Engineer, or any of their officers, directors, members, partners, employees, agents, consultants, or subcontractors, by any employee (or the survivor or personal representative of such employee) of Contractor, any Subcontractor, any Supplier, or any individual or entity directly or indirectly employed by any of them to perform any of the Work, or anyone for whose acts any of them may be liable, the indemnification obligation under Paragraph 7.18.A will not be limited in any way by any limitation on the amount or type of damages, compensation, or benefits payable by or for Contractor or any such Subcontractor, Supplier, or other individual or entity under workers' compensation acts, disability benefit acts, or other employee benefit acts.

7.19 *Delegation of Professional Design Services*

- A. Owner may require Contractor to provide professional design services for a portion of the Work by express delegation in the Contract Documents. Such delegation will specify the performance and design criteria that such services must satisfy, and the Submittals that Contractor must furnish to Engineer with respect to the Owner-delegated design.
- B. Contractor shall cause such Owner-delegated professional design services to be provided pursuant to the professional standard of care by a properly licensed design professional, whose signature and seal must appear on all drawings, calculations, specifications, certifications, and Submittals prepared by such design professional. Such design professional must issue all certifications of design required by Laws and Regulations.
- C. If a Shop Drawing or other Submittal related to the Owner-delegated design is prepared by Contractor, a Subcontractor, or others for submittal to Engineer, then such Shop Drawing or other Submittal must bear the written approval of Contractor's design professional when submitted by Contractor to Engineer.

- D. Owner and Engineer shall be entitled to rely upon the adequacy, accuracy, and completeness of the services, certifications, and approvals performed or provided by the design professionals retained or employed by Contractor under an Owner-delegated design, subject to the professional standard of care and the performance and design criteria stated in the Contract Documents.
- E. Pursuant to this Paragraph 7.19, Engineer's review, approval, and other determinations regarding design drawings, calculations, specifications, certifications, and other Submittals furnished by Contractor pursuant to an Owner-delegated design will be only for the following limited purposes:
 - 1. Checking for conformance with the requirements of this Paragraph 7.19;
 - 2. Confirming that Contractor (through its design professionals) has used the performance and design criteria specified in the Contract Documents; and
 - 3. Establishing that the design furnished by Contractor is consistent with the design concept expressed in the Contract Documents.
- F. Contractor shall not be responsible for the adequacy of performance or design criteria specified by Owner or Engineer.
- G. Contractor is not required to provide professional services in violation of applicable Laws and Regulations.

ARTICLE 8—OTHER WORK AT THE SITE

8.01 *Other Work*

- A. In addition to and apart from the Work under the Contract Documents, the Owner may perform other work at or adjacent to the Site. Such other work may be performed by Owner's employees, or through contracts between the Owner and third parties. Owner may also arrange to have third-party utility owners perform work on their utilities and facilities at or adjacent to the Site.
- B. If Owner performs other work at or adjacent to the Site with Owner's employees, or through contracts for such other work, then Owner shall give Contractor written notice thereof prior to starting any such other work. If Owner has advance information regarding the start of any third-party utility work that Owner has arranged to take place at or adjacent to the Site, Owner shall provide such information to Contractor.
- C. Contractor shall afford proper and safe access to the Site to each contractor that performs such other work, each utility owner performing other work, and Owner, if Owner is performing other work with Owner's employees, and provide a reasonable opportunity for the introduction and storage of materials and equipment and the execution of such other work.
- D. Contractor shall do all cutting, fitting, and patching of the Work that may be required to properly connect or otherwise make its several parts come together and properly integrate with such other work. Contractor shall not endanger any work of others by cutting, excavating, or otherwise altering such work; provided, however, that Contractor may cut or

alter others' work with the written consent of Engineer and the others whose work will be affected.

- E. If the proper execution or results of any part of Contractor's Work depends upon work performed by others, Contractor shall inspect such other work and promptly report to Engineer in writing any delays, defects, or deficiencies in such other work that render it unavailable or unsuitable for the proper execution and results of Contractor's Work. Contractor's failure to so report will constitute an acceptance of such other work as fit and proper for integration with Contractor's Work except for latent defects and deficiencies in such other work.
- F. The provisions of this article are not applicable to work that is performed by third-party utilities or other third-party entities without a contract with Owner, or that is performed without having been arranged by Owner. If such work occurs, then any related delay, disruption, or interference incurred by Contractor is governed by the provisions of Paragraph 4.05.C.3.

8.02 *Coordination*

- A. If Owner intends to contract with others for the performance of other work at or adjacent to the Site, to perform other work at or adjacent to the Site with Owner's employees, or to arrange to have utility owners perform work at or adjacent to the Site, the following will be set forth in the Supplementary Conditions or provided to Contractor prior to the start of any such other work:
 1. The identity of the individual or entity that will have authority and responsibility for coordination of the activities among the various contractors;
 2. An itemization of the specific matters to be covered by such authority and responsibility; and
 3. The extent of such authority and responsibilities.
- B. Unless otherwise provided in the Supplementary Conditions, Owner shall have sole authority and responsibility for such coordination.

8.03 *Legal Relationships*

- A. If, in the course of performing other work for Owner at or adjacent to the Site, the Owner's employees, any other contractor working for Owner, or any utility owner that Owner has arranged to perform work, causes damage to the Work or to the property of Contractor or its Subcontractors, or delays, disrupts, interferes with, or increases the scope or cost of the performance of the Work, through actions or inaction, then Contractor shall be entitled to an equitable adjustment in the Contract Price or the Contract Times. Contractor must submit any Change Proposal seeking an equitable adjustment in the Contract Price or the Contract Times under this paragraph within 30 days of the damaging, delaying, disrupting, or interfering event. The entitlement to, and extent of, any such equitable adjustment will take into account information (if any) regarding such other work that was provided to Contractor in the Contract Documents prior to the submittal of the Bid or the final negotiation of the terms of the Contract, and any remedies available to Contractor under Laws or Regulations concerning utility action or inaction. When applicable, any such equitable adjustment in Contract Price

will be conditioned on Contractor assigning to Owner all Contractor's rights against such other contractor or utility owner with respect to the damage, delay, disruption, or interference that is the subject of the adjustment. Contractor's entitlement to an adjustment of the Contract Times or Contract Price is subject to the provisions of Paragraphs 4.05.D and 4.05.E.

- B. Contractor shall take reasonable and customary measures to avoid damaging, delaying, disrupting, or interfering with the work of Owner, any other contractor, or any utility owner performing other work at or adjacent to the Site.
 1. If Contractor fails to take such measures and as a result damages, delays, disrupts, or interferes with the work of any such other contractor or utility owner, then Owner may impose a set-off against payments due Contractor, and assign to such other contractor or utility owner the Owner's contractual rights against Contractor with respect to the breach of the obligations set forth in this Paragraph 8.03.B.
 2. When Owner is performing other work at or adjacent to the Site with Owner's employees, Contractor shall be liable to Owner for damage to such other work, and for the reasonable direct delay, disruption, and interference costs incurred by Owner as a result of Contractor's failure to take reasonable and customary measures with respect to Owner's other work. In response to such damage, delay, disruption, or interference, Owner may impose a set-off against payments due Contractor.
- C. If Contractor damages, delays, disrupts, or interferes with the work of any other contractor, or any utility owner performing other work at or adjacent to the Site, through Contractor's failure to take reasonable and customary measures to avoid such impacts, or if any claim arising out of Contractor's actions, inactions, or negligence in performance of the Work at or adjacent to the Site is made by any such other contractor or utility owner against Contractor, Owner, or Engineer, then Contractor shall (1) promptly attempt to settle the claim as to all parties through negotiations with such other contractor or utility owner, or otherwise resolve the claim by arbitration or other dispute resolution proceeding or at law, and (2) indemnify and hold harmless Owner and Engineer, and the officers, directors, members, partners, employees, agents, consultants and subcontractors of each and any of them from and against any such claims, and against all costs, losses, and damages (including but not limited to all fees and charges of engineers, architects, attorneys, and other professionals and all court or arbitration or other dispute resolution costs) arising out of or relating to such damage, delay, disruption, or interference.

ARTICLE 9—OWNER'S RESPONSIBILITIES

9.01 *Communications to Contractor*

- A. Except as otherwise provided in these General Conditions, Owner shall issue all communications to Contractor through Engineer.

9.02 *Replacement of Engineer*

- A. Owner may at its discretion appoint an engineer to replace Engineer, provided Contractor makes no reasonable objection to the replacement engineer. The replacement engineer's status under the Contract Documents will be that of the former Engineer.

9.03 *Furnish Data*

- A. Owner shall promptly furnish the data required of Owner under the Contract Documents.

9.04 *Pay When Due*

- A. Owner shall make payments to Contractor when they are due as provided in the Agreement.

9.05 *Lands and Easements; Reports, Tests, and Drawings*

- A. Owner's duties with respect to providing lands and easements are set forth in Paragraph 5.01.
- B. Owner's duties with respect to providing engineering surveys to establish reference points are set forth in Paragraph 4.03.
- C. Article 5 refers to Owner's identifying and making available to Contractor copies of reports of explorations and tests of conditions at the Site, and drawings of physical conditions relating to existing surface or subsurface structures at the Site.

9.06 *Insurance*

- A. Owner's responsibilities, if any, with respect to purchasing and maintaining liability and property insurance are set forth in Article 6.

9.07 *Change Orders*

- A. Owner's responsibilities with respect to Change Orders are set forth in Article 11.

9.08 *Inspections, Tests, and Approvals*

- A. Owner's responsibility with respect to certain inspections, tests, and approvals is set forth in Paragraph 14.02.B.

9.09 *Limitations on Owner's Responsibilities*

- A. The Owner shall not supervise, direct, or have control or authority over, nor be responsible for, Contractor's means, methods, techniques, sequences, or procedures of construction, or the safety precautions and programs incident thereto, or for any failure of Contractor to comply with Laws and Regulations applicable to the performance of the Work. Owner will not be responsible for Contractor's failure to perform the Work in accordance with the Contract Documents.

9.10 *Undisclosed Hazardous Environmental Condition*

- A. Owner's responsibility in respect to an undisclosed Hazardous Environmental Condition is set forth in Paragraph 5.06.

9.11 *Evidence of Financial Arrangements*

- A. Upon request of Contractor, Owner shall furnish Contractor reasonable evidence that financial arrangements have been made to satisfy Owner's obligations under the Contract (including obligations under proposed changes in the Work).

9.12 *Safety Programs*

- A. While at the Site, Owner's employees and representatives shall comply with the specific applicable requirements of Contractor's safety programs of which Owner has been informed.

B. Owner shall furnish copies of any applicable Owner safety programs to Contractor.

ARTICLE 10—ENGINEER'S STATUS DURING CONSTRUCTION

10.01 *Owner's Representative*

A. Engineer will be Owner's representative during the construction period. The duties and responsibilities and the limitations of authority of Engineer as Owner's representative during construction are set forth in the Contract.

10.02 *Visits to Site*

A. Engineer will make visits to the Site at intervals appropriate to the various stages of construction as Engineer deems necessary in order to observe, as an experienced and qualified design professional, the progress that has been made and the quality of the various aspects of Contractor's executed Work. Based on information obtained during such visits and observations, Engineer, for the benefit of Owner, will determine, in general, if the Work is proceeding in accordance with the Contract Documents. Engineer will not be required to make exhaustive or continuous inspections on the Site to check the quality or quantity of the Work. Engineer's efforts will be directed toward providing for Owner a greater degree of confidence that the completed Work will conform generally to the Contract Documents. On the basis of such visits and observations, Engineer will keep Owner informed of the progress of the Work and will endeavor to guard Owner against defective Work.

B. Engineer's visits and observations are subject to all the limitations on Engineer's authority and responsibility set forth in Paragraph 10.07. Particularly, but without limitation, during or as a result of Engineer's visits or observations of Contractor's Work, Engineer will not supervise, direct, control, or have authority over or be responsible for Contractor's means, methods, techniques, sequences, or procedures of construction, or the safety precautions and programs incident thereto, or for any failure of Contractor to comply with Laws and Regulations applicable to the performance of the Work.

10.03 *Resident Project Representative*

A. If Owner and Engineer have agreed that Engineer will furnish a Resident Project Representative to represent Engineer at the Site and assist Engineer in observing the progress and quality of the Work, then the authority and responsibilities of any such Resident Project Representative will be as provided in the Supplementary Conditions, and limitations on the responsibilities thereof will be as provided in the Supplementary Conditions and in Paragraph 10.07.

B. If Owner designates an individual or entity who is not Engineer's consultant, agent, or employee to represent Owner at the Site, then the responsibilities and authority of such individual or entity will be as provided in the Supplementary Conditions.

10.04 *Engineer's Authority*

A. Engineer has the authority to reject Work in accordance with Article 14.

B. Engineer's authority as to Submittals is set forth in Paragraph 7.16.

- C. Engineer's authority as to design drawings, calculations, specifications, certifications and other Submittals from Contractor in response to Owner's delegation (if any) to Contractor of professional design services, is set forth in Paragraph 7.19.
- D. Engineer's authority as to changes in the Work is set forth in Article 11.
- E. Engineer's authority as to Applications for Payment is set forth in Article 15.

10.05 *Determinations for Unit Price Work*

- A. Engineer will determine the actual quantities and classifications of Unit Price Work performed by Contractor as set forth in Paragraph 13.03.

10.06 *Decisions on Requirements of Contract Documents and Acceptability of Work*

- A. Engineer will render decisions regarding the requirements of the Contract Documents, and judge the acceptability of the Work, pursuant to the specific procedures set forth herein for initial interpretations, Change Proposals, and acceptance of the Work. In rendering such decisions and judgments, Engineer will not show partiality to Owner or Contractor, and will not be liable to Owner, Contractor, or others in connection with any proceedings, interpretations, decisions, or judgments conducted or rendered in good faith.

10.07 *Limitations on Engineer's Authority and Responsibilities*

- A. Neither Engineer's authority or responsibility under this Article 10 or under any other provision of the Contract, nor any decision made by Engineer in good faith either to exercise or not exercise such authority or responsibility or the undertaking, exercise, or performance of any authority or responsibility by Engineer, will create, impose, or give rise to any duty in contract, tort, or otherwise owed by Engineer to Contractor, any Subcontractor, any Supplier, any other individual or entity, or to any surety for or employee or agent of any of them.
- B. Engineer will not supervise, direct, control, or have authority over or be responsible for Contractor's means, methods, techniques, sequences, or procedures of construction, or the safety precautions and programs incident thereto, or for any failure of Contractor to comply with Laws and Regulations applicable to the performance of the Work. Engineer will not be responsible for Contractor's failure to perform the Work in accordance with the Contract Documents.
- C. Engineer will not be responsible for the acts or omissions of Contractor or of any Subcontractor, any Supplier, or of any other individual or entity performing any of the Work.
- D. Engineer's review of the final Application for Payment and accompanying documentation, and all maintenance and operating instructions, schedules, guarantees, bonds, certificates of inspection, tests and approvals, and other documentation required to be delivered by Contractor under Paragraph 15.06.A, will only be to determine generally that their content complies with the requirements of, and in the case of certificates of inspections, tests, and approvals, that the results certified indicate compliance with the Contract Documents.
- E. The limitations upon authority and responsibility set forth in this Paragraph 10.07 also apply to the Resident Project Representative, if any.

10.08 *Compliance with Safety Program*

- A. While at the Site, Engineer's employees and representatives will comply with the specific applicable requirements of Owner's and Contractor's safety programs of which Engineer has been informed.

ARTICLE 11—CHANGES TO THE CONTRACT

11.01 *Amending and Supplementing the Contract*

- A. The Contract may be amended or supplemented by a Change Order, a Work Change Directive, or a Field Order.
- B. If an amendment or supplement to the Contract includes a change in the Contract Price or the Contract Times, such amendment or supplement must be set forth in a Change Order.
- C. All changes to the Contract that involve (1) the performance or acceptability of the Work, (2) the design (as set forth in the Drawings, Specifications, or otherwise), or (3) other engineering or technical matters, must be supported by Engineer's recommendation. Owner and Contractor may amend other terms and conditions of the Contract without the recommendation of the Engineer.

11.02 *Change Orders*

- A. Owner and Contractor shall execute appropriate Change Orders covering:
 1. Changes in Contract Price or Contract Times which are agreed to by the parties, including any undisputed sum or amount of time for Work actually performed in accordance with a Work Change Directive;
 2. Changes in Contract Price resulting from an Owner set-off, unless Contractor has duly contested such set-off;
 3. Changes in the Work which are: (a) ordered by Owner pursuant to Paragraph 11.05, (b) required because of Owner's acceptance of defective Work under Paragraph 14.04 or Owner's correction of defective Work under Paragraph 14.07, or (c) agreed to by the parties, subject to the need for Engineer's recommendation if the change in the Work involves the design (as set forth in the Drawings, Specifications, or otherwise) or other engineering or technical matters; and
 4. Changes that embody the substance of any final and binding results under: Paragraph 11.03.B, resolving the impact of a Work Change Directive; Paragraph 11.09, concerning Change Proposals; Article 12, Claims; Paragraph 13.02.D, final adjustments resulting from allowances; Paragraph 13.03.D, final adjustments relating to determination of quantities for Unit Price Work; and similar provisions.
- B. If Owner or Contractor refuses to execute a Change Order that is required to be executed under the terms of Paragraph 11.02.A, it will be deemed to be of full force and effect, as if fully executed.

11.03 Work Change Directives

- A. A Work Change Directive will not change the Contract Price or the Contract Times but is evidence that the parties expect that the modification ordered or documented by a Work Change Directive will be incorporated in a subsequently issued Change Order, following negotiations by the parties as to the Work Change Directive's effect, if any, on the Contract Price and Contract Times; or, if negotiations are unsuccessful, by a determination under the terms of the Contract Documents governing adjustments, expressly including Paragraph 11.07 regarding change of Contract Price.
- B. If Owner has issued a Work Change Directive and:
 1. Contractor believes that an adjustment in Contract Times or Contract Price is necessary, then Contractor shall submit any Change Proposal seeking such an adjustment no later than 30 days after the completion of the Work set out in the Work Change Directive.
 2. Owner believes that an adjustment in Contract Times or Contract Price is necessary, then Owner shall submit any Claim seeking such an adjustment no later than 60 days after issuance of the Work Change Directive.

11.04 Field Orders

- A. Engineer may authorize minor changes in the Work if the changes do not involve an adjustment in the Contract Price or the Contract Times and are compatible with the design concept of the completed Project as a functioning whole as indicated by the Contract Documents. Such changes will be accomplished by a Field Order and will be binding on Owner and also on Contractor, which shall perform the Work involved promptly.
- B. If Contractor believes that a Field Order justifies an adjustment in the Contract Price or Contract Times, then before proceeding with the Work at issue, Contractor shall submit a Change Proposal as provided herein.

11.05 Owner-Authorized Changes in the Work

- A. Without invalidating the Contract and without notice to any surety, Owner may, at any time or from time to time, order additions, deletions, or revisions in the Work. Changes involving the design (as set forth in the Drawings, Specifications, or otherwise) or other engineering or technical matters will be supported by Engineer's recommendation.
- B. Such changes in the Work may be accomplished by a Change Order, if Owner and Contractor have agreed as to the effect, if any, of the changes on Contract Times or Contract Price; or by a Work Change Directive. Upon receipt of any such document, Contractor shall promptly proceed with the Work involved; or, in the case of a deletion in the Work, promptly cease construction activities with respect to such deleted Work. Added or revised Work must be performed under the applicable conditions of the Contract Documents.
- C. Nothing in this Paragraph 11.05 obligates Contractor to undertake work that Contractor reasonably concludes cannot be performed in a manner consistent with Contractor's safety obligations under the Contract Documents or Laws and Regulations.

11.06 *Unauthorized Changes in the Work*

A. Contractor shall not be entitled to an increase in the Contract Price or an extension of the Contract Times with respect to any work performed that is not required by the Contract Documents, as amended, modified, or supplemented, except in the case of an emergency as provided in Paragraph 7.15 or in the case of uncovering Work as provided in Paragraph 14.05.C.2.

11.07 *Change of Contract Price*

A. The Contract Price may only be changed by a Change Order. Any Change Proposal for an adjustment in the Contract Price must comply with the provisions of Paragraph 11.09. Any Claim for an adjustment of Contract Price must comply with the provisions of Article 12.

B. An adjustment in the Contract Price will be determined as follows:

1. Where the Work involved is covered by unit prices contained in the Contract Documents, then by application of such unit prices to the quantities of the items involved (subject to the provisions of Paragraph 13.03);
2. Where the Work involved is not covered by unit prices contained in the Contract Documents, then by a mutually agreed lump sum (which may include an allowance for overhead and profit not necessarily in accordance with Paragraph 11.07.C.2); or
3. Where the Work involved is not covered by unit prices contained in the Contract Documents and the parties do not reach mutual agreement to a lump sum, then on the basis of the Cost of the Work (determined as provided in Paragraph 13.01) plus a Contractor's fee for overhead and profit (determined as provided in Paragraph 11.07.C).

C. *Contractor's Fee:* When applicable, the Contractor's fee for overhead and profit will be determined as follows:

1. A mutually acceptable fixed fee; or
2. If a fixed fee is not agreed upon, then a fee based on the following percentages of the various portions of the Cost of the Work:
 - a. For costs incurred under Paragraphs 13.01.B.1 and 13.01.B.2, the Contractor's fee will be 15 percent;
 - b. For costs incurred under Paragraph 13.01.B.3, the Contractor's fee will be 5 percent;
 - c. Where one or more tiers of subcontracts are on the basis of Cost of the Work plus a fee and no fixed fee is agreed upon, the intent of Paragraphs 11.07.C.2.a and 11.07.C.2.b is that the Contractor's fee will be based on: (1) a fee of 15 percent of the costs incurred under Paragraphs 13.01.B.1 and 13.01.B.2 by the Subcontractor that actually performs the Work, at whatever tier, and (2) with respect to Contractor itself and to any Subcontractors of a tier higher than that of the Subcontractor that actually performs the Work, a fee of 5 percent of the amount (fee plus underlying costs incurred) attributable to the next lower tier Subcontractor; provided, however, that for any such subcontracted Work the maximum total fee to be paid by Owner will be no greater than 27 percent of the costs incurred by the Subcontractor that actually performs the Work;

- d. No fee will be payable on the basis of costs itemized under Paragraphs 13.01.B.4, 13.01.B.5, and 13.01.C;
- e. The amount of credit to be allowed by Contractor to Owner for any change which results in a net decrease in Cost of the Work will be the amount of the actual net decrease in Cost of the Work and a deduction of an additional amount equal to 5 percent of such actual net decrease in Cost of the Work; and
- f. When both additions and credits are involved in any one change or Change Proposal, the adjustment in Contractor's fee will be computed by determining the sum of the costs in each of the cost categories in Paragraph 13.01.B (specifically, payroll costs, Paragraph 13.01.B.1; incorporated materials and equipment costs, Paragraph 13.01.B.2; Subcontract costs, Paragraph 13.01.B.3; special consultants costs, Paragraph 13.01.B.4; and other costs, Paragraph 13.01.B.5) and applying to each such cost category sum the appropriate fee from Paragraphs 11.07.C.2.a through 11.07.C.2.e, inclusive.

11.08 Change of Contract Times

- A. The Contract Times may only be changed by a Change Order. Any Change Proposal for an adjustment in the Contract Times must comply with the provisions of Paragraph 11.09. Any Claim for an adjustment in the Contract Times must comply with the provisions of Article 12.
- B. Delay, disruption, and interference in the Work, and any related changes in Contract Times, are addressed in and governed by Paragraph 4.05.

11.09 Change Proposals

- A. *Purpose and Content:* Contractor shall submit a Change Proposal to Engineer to request an adjustment in the Contract Times or Contract Price; contest an initial decision by Engineer concerning the requirements of the Contract Documents or relating to the acceptability of the Work under the Contract Documents; challenge a set-off against payment due; or seek other relief under the Contract. The Change Proposal will specify any proposed change in Contract Times or Contract Price, or other proposed relief, and explain the reason for the proposed change, with citations to any governing or applicable provisions of the Contract Documents. Each Change Proposal will address only one issue, or a set of closely related issues.

B. Change Proposal Procedures

- 1. *Submittal:* Contractor shall submit each Change Proposal to Engineer within 30 days after the start of the event giving rise thereto, or after such initial decision.
- 2. *Supporting Data:* The Contractor shall submit supporting data, including the proposed change in Contract Price or Contract Time (if any), to the Engineer and Owner within 15 days after the submittal of the Change Proposal.
 - a. Change Proposals based on or related to delay, interruption, or interference must comply with the provisions of Paragraphs 4.05.D and 4.05.E.

- b. Change proposals related to a change of Contract Price must include full and detailed accounts of materials incorporated into the Work and labor and equipment used for the subject Work.

The supporting data must be accompanied by a written statement that the supporting data are accurate and complete, and that any requested time or price adjustment is the entire adjustment to which Contractor believes it is entitled as a result of said event.

3. *Engineer's Initial Review:* Engineer will advise Owner regarding the Change Proposal, and consider any comments or response from Owner regarding the Change Proposal. If in its discretion Engineer concludes that additional supporting data is needed before conducting a full review and making a decision regarding the Change Proposal, then Engineer may request that Contractor submit such additional supporting data by a date specified by Engineer, prior to Engineer beginning its full review of the Change Proposal.
4. *Engineer's Full Review and Action on the Change Proposal:* Upon receipt of Contractor's supporting data (including any additional data requested by Engineer), Engineer will conduct a full review of each Change Proposal and, within 30 days after such receipt of the Contractor's supporting data, either approve the Change Proposal in whole, deny it in whole, or approve it in part and deny it in part. Such actions must be in writing, with a copy provided to Owner and Contractor. If Engineer does not take action on the Change Proposal within 30 days, then either Owner or Contractor may at any time thereafter submit a letter to the other party indicating that as a result of Engineer's inaction the Change Proposal is deemed denied, thereby commencing the time for appeal of the denial under Article 12.
5. *Binding Decision:* Engineer's decision is final and binding upon Owner and Contractor, unless Owner or Contractor appeals the decision by filing a Claim under Article 12.

C. *Resolution of Certain Change Proposals:* If the Change Proposal does not involve the design (as set forth in the Drawings, Specifications, or otherwise), the acceptability of the Work, or other engineering or technical matters, then Engineer will notify the parties in writing that the Engineer is unable to resolve the Change Proposal. For purposes of further resolution of such a Change Proposal, such notice will be deemed a denial, and Contractor may choose to seek resolution under the terms of Article 12.

D. *Post-Completion:* Contractor shall not submit any Change Proposals after Engineer issues a written recommendation of final payment pursuant to Paragraph 15.06.B.

11.10 *Notification to Surety*

- A. If the provisions of any bond require notice to be given to a surety of any change affecting the general scope of the Work or the provisions of the Contract Documents (including, but not limited to, Contract Price or Contract Times), the giving of any such notice will be Contractor's responsibility. The amount of each applicable bond will be adjusted to reflect the effect of any such change.

ARTICLE 12—CLAIMS

12.01 *Claims*

- A. *Claims Process:* The following disputes between Owner and Contractor are subject to the Claims process set forth in this article:
 1. Appeals by Owner or Contractor of Engineer's decisions regarding Change Proposals;
 2. Owner demands for adjustments in the Contract Price or Contract Times, or other relief under the Contract Documents;
 3. Disputes that Engineer has been unable to address because they do not involve the design (as set forth in the Drawings, Specifications, or otherwise), the acceptability of the Work, or other engineering or technical matters; and
 4. Subject to the waiver provisions of Paragraph 15.07, any dispute arising after Engineer has issued a written recommendation of final payment pursuant to Paragraph 15.06.B.
- B. *Submittal of Claim:* The party submitting a Claim shall deliver it directly to the other party to the Contract promptly (but in no event later than 30 days) after the start of the event giving rise thereto; in the case of appeals regarding Change Proposals within 30 days of the decision under appeal. The party submitting the Claim shall also furnish a copy to the Engineer, for its information only. The responsibility to substantiate a Claim rests with the party making the Claim. In the case of a Claim by Contractor seeking an increase in the Contract Times or Contract Price, Contractor shall certify that the Claim is made in good faith, that the supporting data are accurate and complete, and that to the best of Contractor's knowledge and belief the amount of time or money requested accurately reflects the full amount to which Contractor is entitled.
- C. *Review and Resolution:* The party receiving a Claim shall review it thoroughly, giving full consideration to its merits. The two parties shall seek to resolve the Claim through the exchange of information and direct negotiations. The parties may extend the time for resolving the Claim by mutual agreement. All actions taken on a Claim will be stated in writing and submitted to the other party, with a copy to Engineer.
- D. *Mediation*
 1. At any time after initiation of a Claim, Owner and Contractor may mutually agree to mediation of the underlying dispute. The agreement to mediate will stay the Claim submittal and response process.
 2. If Owner and Contractor agree to mediation, then after 60 days from such agreement, either Owner or Contractor may unilaterally terminate the mediation process, and the Claim submittal and decision process will resume as of the date of the termination. If the mediation proceeds but is unsuccessful in resolving the dispute, the Claim submittal and decision process will resume as of the date of the conclusion of the mediation, as determined by the mediator.
 3. Owner and Contractor shall each pay one-half of the mediator's fees and costs.

- E. *Partial Approval:* If the party receiving a Claim approves the Claim in part and denies it in part, such action will be final and binding unless within 30 days of such action the other party invokes the procedure set forth in Article 17 for final resolution of disputes.
- F. *Denial of Claim:* If efforts to resolve a Claim are not successful, the party receiving the Claim may deny it by giving written notice of denial to the other party. If the receiving party does not take action on the Claim within 90 days, then either Owner or Contractor may at any time thereafter submit a letter to the other party indicating that as a result of the inaction, the Claim is deemed denied, thereby commencing the time for appeal of the denial. A denial of the Claim will be final and binding unless within 30 days of the denial the other party invokes the procedure set forth in Article 17 for the final resolution of disputes.
- G. *Final and Binding Results:* If the parties reach a mutual agreement regarding a Claim, whether through approval of the Claim, direct negotiations, mediation, or otherwise; or if a Claim is approved in part and denied in part, or denied in full, and such actions become final and binding; then the results of the agreement or action on the Claim will be incorporated in a Change Order or other written document to the extent they affect the Contract, including the Work, the Contract Times, or the Contract Price.

ARTICLE 13—COST OF THE WORK; ALLOWANCES; UNIT PRICE WORK

13.01 *Cost of the Work*

- A. *Purposes for Determination of Cost of the Work:* The term Cost of the Work means the sum of all costs necessary for the proper performance of the Work at issue, as further defined below. The provisions of this Paragraph 13.01 are used for two distinct purposes:
 - 1. To determine Cost of the Work when Cost of the Work is a component of the Contract Price, under cost-plus-fee, time-and-materials, or other cost-based terms; or
 - 2. When needed to determine the value of a Change Order, Change Proposal, Claim, set-off, or other adjustment in Contract Price. When the value of any such adjustment is determined on the basis of Cost of the Work, Contractor is entitled only to those additional or incremental costs required because of the change in the Work or because of the event giving rise to the adjustment.
- B. *Costs Included:* Except as otherwise may be agreed to in writing by Owner, costs included in the Cost of the Work will be in amounts no higher than those commonly incurred in the locality of the Project, will not include any of the costs itemized in Paragraph 13.01.C, and will include only the following items:
 - 1. Payroll costs for employees in the direct employ of Contractor in the performance of the Work under schedules of job classifications agreed upon by Owner and Contractor in advance of the subject Work. Such employees include, without limitation, superintendents, foremen, safety managers, safety representatives, and other personnel employed full time on the Work. Payroll costs for employees not employed full time on the Work will be apportioned on the basis of their time spent on the Work. Payroll costs include, but are not limited to, salaries and wages plus the cost of fringe benefits, which include social security contributions, unemployment, excise, and payroll taxes, workers'

compensation, health and retirement benefits, sick leave, and vacation and holiday pay applicable thereto. The expenses of performing Work outside of regular working hours, on Saturday, Sunday, or legal holidays, will be included in the above to the extent authorized by Owner.

2. Cost of all materials and equipment furnished and incorporated in the Work, including costs of transportation and storage thereof, and Suppliers' field services required in connection therewith. All cash discounts accrue to Contractor unless Owner deposits funds with Contractor with which to make payments, in which case the cash discounts will accrue to Owner. All trade discounts, rebates, and refunds and returns from sale of surplus materials and equipment will accrue to Owner, and Contractor shall make provisions so that they may be obtained.
3. Payments made by Contractor to Subcontractors for Work performed by Subcontractors. If required by Owner, Contractor shall obtain competitive bids from subcontractors acceptable to Owner and Contractor and shall deliver such bids to Owner, which will then determine, with the advice of Engineer, which bids, if any, will be acceptable. If any subcontract provides that the Subcontractor is to be paid on the basis of Cost of the Work plus a fee, the Subcontractor's Cost of the Work and fee will be determined in the same manner as Contractor's Cost of the Work and fee as provided in this Paragraph 13.01.
4. Costs of special consultants (including but not limited to engineers, architects, testing laboratories, surveyors, attorneys, and accountants) employed or retained for services specifically related to the Work.
5. Other costs consisting of the following:
 - a. The proportion of necessary transportation, travel, and subsistence expenses of Contractor's employees incurred in discharge of duties connected with the Work.
 - b. Cost, including transportation and maintenance, of all materials, supplies, equipment, machinery, appliances, office, and temporary facilities at the Site, which are consumed in the performance of the Work, and cost, less market value, of such items used but not consumed which remain the property of Contractor.
 - 1) In establishing included costs for materials such as scaffolding, plating, or sheeting, consideration will be given to the actual or the estimated life of the material for use on other projects; or rental rates may be established on the basis of purchase or salvage value of such items, whichever is less. Contractor will not be eligible for compensation for such items in an amount that exceeds the purchase cost of such item.
 - c. *Construction Equipment Rental*
 - 1) Rentals of all construction equipment and machinery, and the parts thereof, in accordance with rental agreements approved by Owner as to price (including any surcharge or special rates applicable to overtime use of the construction equipment or machinery), and the costs of transportation, loading, unloading, assembly, dismantling, and removal thereof. All such costs will be in accordance with the terms of said rental agreements. The rental of any such equipment,

machinery, or parts must cease when the use thereof is no longer necessary for the Work.

- 2) Costs for equipment and machinery owned by Contractor or a Contractor-related entity will be paid at a rate shown for such equipment in the equipment rental rate book specified in the Supplementary Conditions. An hourly rate will be computed by dividing the monthly rates by 176. These computed rates will include all operating costs.
- 3) With respect to Work that is the result of a Change Order, Change Proposal, Claim, set-off, or other adjustment in Contract Price ("changed Work"), included costs will be based on the time the equipment or machinery is in use on the changed Work and the costs of transportation, loading, unloading, assembly, dismantling, and removal when directly attributable to the changed Work. The cost of any such equipment or machinery, or parts thereof, must cease to accrue when the use thereof is no longer necessary for the changed Work.

- d. Sales, consumer, use, and other similar taxes related to the Work, and for which Contractor is liable, as imposed by Laws and Regulations.
- e. Deposits lost for causes other than negligence of Contractor, any Subcontractor, or anyone directly or indirectly employed by any of them or for whose acts any of them may be liable, and royalty payments and fees for permits and licenses.
- f. Losses and damages (and related expenses) caused by damage to the Work, not compensated by insurance or otherwise, sustained by Contractor in connection with the performance of the Work (except losses and damages within the deductible amounts of builder's risk or other property insurance established in accordance with Paragraph 6.04), provided such losses and damages have resulted from causes other than the negligence of Contractor, any Subcontractor, or anyone directly or indirectly employed by any of them or for whose acts any of them may be liable. Such losses include settlements made with the written consent and approval of Owner. No such losses, damages, and expenses will be included in the Cost of the Work for the purpose of determining Contractor's fee.
- g. The cost of utilities, fuel, and sanitary facilities at the Site.
- h. Minor expenses such as communication service at the Site, express and courier services, and similar petty cash items in connection with the Work.
- i. The costs of premiums for all bonds and insurance that Contractor is required by the Contract Documents to purchase and maintain.

C. *Costs Excluded:* The term Cost of the Work does not include any of the following items:

1. Payroll costs and other compensation of Contractor's officers, executives, principals, general managers, engineers, architects, estimators, attorneys, auditors, accountants, purchasing and contracting agents, expeditors, timekeepers, clerks, and other personnel employed by Contractor, whether at the Site or in Contractor's principal or branch office for general administration of the Work and not specifically included in the agreed upon schedule of job classifications referred to in Paragraph 13.01.B.1 or specifically covered

by Paragraph 13.01.B.4. The payroll costs and other compensation excluded here are to be considered administrative costs covered by the Contractor's fee.

2. The cost of purchasing, renting, or furnishing small tools and hand tools.
3. Expenses of Contractor's principal and branch offices other than Contractor's office at the Site.
4. Any part of Contractor's capital expenses, including interest on Contractor's capital employed for the Work and charges against Contractor for delinquent payments.
5. Costs due to the negligence of Contractor, any Subcontractor, or anyone directly or indirectly employed by any of them or for whose acts any of them may be liable, including but not limited to, the correction of defective Work, disposal of materials or equipment wrongly supplied, and making good any damage to property.
6. Expenses incurred in preparing and advancing Claims.
7. Other overhead or general expense costs of any kind and the costs of any item not specifically and expressly included in Paragraph 13.01.B.

D. Contractor's Fee

1. When the Work as a whole is performed on the basis of cost-plus-a-fee, then:
 - a. Contractor's fee for the Work set forth in the Contract Documents as of the Effective Date of the Contract will be determined as set forth in the Agreement.
 - b. for any Work covered by a Change Order, Change Proposal, Claim, set-off, or other adjustment in Contract Price on the basis of Cost of the Work, Contractor's fee will be determined as follows:
 - 1) When the fee for the Work as a whole is a percentage of the Cost of the Work, the fee will automatically adjust as the Cost of the Work changes.
 - 2) When the fee for the Work as a whole is a fixed fee, the fee for any additions or deletions will be determined in accordance with Paragraph 11.07.C.2.
2. When the Work as a whole is performed on the basis of a stipulated sum, or any other basis other than cost-plus-a-fee, then Contractor's fee for any Work covered by a Change Order, Change Proposal, Claim, set-off, or other adjustment in Contract Price on the basis of Cost of the Work will be determined in accordance with Paragraph 11.07.C.2.

E. Documentation and Audit: Whenever the Cost of the Work for any purpose is to be determined pursuant to this Article 13, Contractor and pertinent Subcontractors will establish and maintain records of the costs in accordance with generally accepted accounting practices. Subject to prior written notice, Owner will be afforded reasonable access, during normal business hours, to all Contractor's accounts, records, books, correspondence, instructions, drawings, receipts, vouchers, memoranda, and similar data relating to the Cost of the Work and Contractor's fee. Contractor shall preserve all such documents for a period of three years after the final payment by Owner. Pertinent Subcontractors will afford such access to Owner, and preserve such documents, to the same extent required of Contractor.

13.02 *Allowances*

- A. It is understood that Contractor has included in the Contract Price all allowances so named in the Contract Documents and shall cause the Work so covered to be performed for such sums and by such persons or entities as may be acceptable to Owner and Engineer.
- B. *Cash Allowances:* Contractor agrees that:
 1. the cash allowances include the cost to Contractor (less any applicable trade discounts) of materials and equipment required by the allowances to be delivered at the Site, and all applicable taxes; and
 2. Contractor's costs for unloading and handling on the Site, labor, installation, overhead, profit, and other expenses contemplated for the cash allowances have been included in the Contract Price and not in the allowances, and no demand for additional payment for any of the foregoing will be valid.
- C. *Owner's Contingency Allowance:* Contractor agrees that an Owner's contingency allowance, if any, is for the sole use of Owner to cover unanticipated costs.
- D. Prior to final payment, an appropriate Change Order will be issued as recommended by Engineer to reflect actual amounts due Contractor for Work covered by allowances, and the Contract Price will be correspondingly adjusted.

13.03 *Unit Price Work*

- A. Where the Contract Documents provide that all or part of the Work is to be Unit Price Work, initially the Contract Price will be deemed to include for all Unit Price Work an amount equal to the sum of the unit price for each separately identified item of Unit Price Work times the estimated quantity of each item as indicated in the Agreement.
- B. The estimated quantities of items of Unit Price Work are not guaranteed and are solely for the purpose of comparison of Bids and determining an initial Contract Price. Payments to Contractor for Unit Price Work will be based on actual quantities.
- C. Each unit price will be deemed to include an amount considered by Contractor to be adequate to cover Contractor's overhead and profit for each separately identified item.
- D. Engineer will determine the actual quantities and classifications of Unit Price Work performed by Contractor. Engineer will review with Contractor the Engineer's preliminary determinations on such matters before rendering a written decision thereon (by recommendation of an Application for Payment or otherwise). Engineer's written decision thereon will be final and binding (except as modified by Engineer to reflect changed factual conditions or more accurate data) upon Owner and Contractor, and the final adjustment of Contract Price will be set forth in a Change Order, subject to the provisions of the following paragraph.

E. Adjustments in Unit Price

1. Contractor or Owner shall be entitled to an adjustment in the unit price with respect to an item of Unit Price Work if:
 - a. the quantity of the item of Unit Price Work performed by Contractor differs materially and significantly from the estimated quantity of such item indicated in the Agreement; and
 - b. Contractor's unit costs to perform the item of Unit Price Work have changed materially and significantly as a result of the quantity change.
2. The adjustment in unit price will account for and be coordinated with any related changes in quantities of other items of Work, and in Contractor's costs to perform such other Work, such that the resulting overall change in Contract Price is equitable to Owner and Contractor.
3. Adjusted unit prices will apply to all units of that item.

ARTICLE 14—TESTS AND INSPECTIONS; CORRECTION, REMOVAL, OR ACCEPTANCE OF DEFECTIVE WORK

14.01 Access to Work

- A. Owner, Engineer, their consultants and other representatives and personnel of Owner, independent testing laboratories, and authorities having jurisdiction have access to the Site and the Work at reasonable times for their observation, inspection, and testing. Contractor shall provide them proper and safe conditions for such access and advise them of Contractor's safety procedures and programs so that they may comply with such procedures and programs as applicable.

14.02 Tests, Inspections, and Approvals

- A. Contractor shall give Engineer timely notice of readiness of the Work (or specific parts thereof) for all required inspections and tests, and shall cooperate with inspection and testing personnel to facilitate required inspections and tests.
- B. Owner shall retain and pay for the services of an independent inspector, testing laboratory, or other qualified individual or entity to perform all inspections and tests expressly required by the Contract Documents to be furnished and paid for by Owner, except that costs incurred in connection with tests or inspections of covered Work will be governed by the provisions of Paragraph 14.05.
- C. If Laws or Regulations of any public body having jurisdiction require any Work (or part thereof) specifically to be inspected, tested, or approved by an employee or other representative of such public body, Contractor shall assume full responsibility for arranging and obtaining such inspections, tests, or approvals, pay all costs in connection therewith, and furnish Engineer the required certificates of inspection or approval.

D. Contractor shall be responsible for arranging, obtaining, and paying for all inspections and tests required:

1. by the Contract Documents, unless the Contract Documents expressly allocate responsibility for a specific inspection or test to Owner;
2. to attain Owner's and Engineer's acceptance of materials or equipment to be incorporated in the Work;
3. by manufacturers of equipment furnished under the Contract Documents;
4. for testing, adjusting, and balancing of mechanical, electrical, and other equipment to be incorporated into the Work; and
5. for acceptance of materials, mix designs, or equipment submitted for approval prior to Contractor's purchase thereof for incorporation in the Work.

Such inspections and tests will be performed by independent inspectors, testing laboratories, or other qualified individuals or entities acceptable to Owner and Engineer.

- E. If the Contract Documents require the Work (or part thereof) to be approved by Owner, Engineer, or another designated individual or entity, then Contractor shall assume full responsibility for arranging and obtaining such approvals.
- F. If any Work (or the work of others) that is to be inspected, tested, or approved is covered by Contractor without written concurrence of Engineer, Contractor shall, if requested by Engineer, uncover such Work for observation. Such uncovering will be at Contractor's expense unless Contractor had given Engineer timely notice of Contractor's intention to cover the same and Engineer had not acted with reasonable promptness in response to such notice.

14.03 *Defective Work*

- A. *Contractor's Obligation:* It is Contractor's obligation to assure that the Work is not defective.
- B. *Engineer's Authority:* Engineer has the authority to determine whether Work is defective, and to reject defective Work.
- C. *Notice of Defects:* Prompt written notice of all defective Work of which Owner or Engineer has actual knowledge will be given to Contractor.
- D. *Correction, or Removal and Replacement:* Promptly after receipt of written notice of defective Work, Contractor shall correct all such defective Work, whether or not fabricated, installed, or completed, or, if Engineer has rejected the defective Work, remove it from the Project and replace it with Work that is not defective.
- E. *Preservation of Warranties:* When correcting defective Work, Contractor shall take no action that would void or otherwise impair Owner's special warranty and guarantee, if any, on said Work.
- F. *Costs and Damages:* In addition to its correction, removal, and replacement obligations with respect to defective Work, Contractor shall pay all claims, costs, losses, and damages arising out of or relating to defective Work, including but not limited to the cost of the inspection, testing, correction, removal, replacement, or reconstruction of such defective Work, fines levied against Owner by governmental authorities because the Work is defective, and the

costs of repair or replacement of work of others resulting from defective Work. Prior to final payment, if Owner and Contractor are unable to agree as to the measure of such claims, costs, losses, and damages resulting from defective Work, then Owner may impose a reasonable set-off against payments due under Article 15.

14.04 Acceptance of Defective Work

- A. If, instead of requiring correction or removal and replacement of defective Work, Owner prefers to accept it, Owner may do so (subject, if such acceptance occurs prior to final payment, to Engineer's confirmation that such acceptance is in general accord with the design intent and applicable engineering principles, and will not endanger public safety). Contractor shall pay all claims, costs, losses, and damages attributable to Owner's evaluation of and determination to accept such defective Work (such costs to be approved by Engineer as to reasonableness), and for the diminished value of the Work to the extent not otherwise paid by Contractor. If any such acceptance occurs prior to final payment, the necessary revisions in the Contract Documents with respect to the Work will be incorporated in a Change Order. If the parties are unable to agree as to the decrease in the Contract Price, reflecting the diminished value of Work so accepted, then Owner may impose a reasonable set-off against payments due under Article 15. If the acceptance of defective Work occurs after final payment, Contractor shall pay an appropriate amount to Owner.

14.05 Uncovering Work

- A. Engineer has the authority to require additional inspection or testing of the Work, whether or not the Work is fabricated, installed, or completed.
- B. If any Work is covered contrary to the written request of Engineer, then Contractor shall, if requested by Engineer, uncover such Work for Engineer's observation, and then replace the covering, all at Contractor's expense.
- C. If Engineer considers it necessary or advisable that covered Work be observed by Engineer or inspected or tested by others, then Contractor, at Engineer's request, shall uncover, expose, or otherwise make available for observation, inspection, or testing as Engineer may require, that portion of the Work in question, and provide all necessary labor, material, and equipment.
 1. If it is found that the uncovered Work is defective, Contractor shall be responsible for all claims, costs, losses, and damages arising out of or relating to such uncovering, exposure, observation, inspection, and testing, and of satisfactory replacement or reconstruction (including but not limited to all costs of repair or replacement of work of others); and pending Contractor's full discharge of this responsibility the Owner shall be entitled to impose a reasonable set-off against payments due under Article 15.
 2. If the uncovered Work is not found to be defective, Contractor shall be allowed an increase in the Contract Price or an extension of the Contract Times, directly attributable to such uncovering, exposure, observation, inspection, testing, replacement, and reconstruction. If the parties are unable to agree as to the amount or extent thereof, then Contractor may submit a Change Proposal within 30 days of the determination that the Work is not defective.

14.06 Owner May Stop the Work

- A. If the Work is defective, or Contractor fails to supply sufficient skilled workers or suitable materials or equipment, or fails to perform the Work in such a way that the completed Work will conform to the Contract Documents, then Owner may order Contractor to stop the Work, or any portion thereof, until the cause for such order has been eliminated; however, this right of Owner to stop the Work will not give rise to any duty on the part of Owner to exercise this right for the benefit of Contractor, any Subcontractor, any Supplier, any other individual or entity, or any surety for, or employee or agent of any of them.

14.07 Owner May Correct Defective Work

- A. If Contractor fails within a reasonable time after written notice from Engineer to correct defective Work, or to remove and replace defective Work as required by Engineer, then Owner may, after 7 days' written notice to Contractor, correct or remedy any such deficiency.
- B. In exercising the rights and remedies under this Paragraph 14.07, Owner shall proceed expeditiously. In connection with such corrective or remedial action, Owner may exclude Contractor from all or part of the Site, take possession of all or part of the Work and suspend Contractor's services related thereto, and incorporate in the Work all materials and equipment stored at the Site or for which Owner has paid Contractor but which are stored elsewhere. Contractor shall allow Owner, Owner's representatives, agents and employees, Owner's other contractors, and Engineer and Engineer's consultants access to the Site to enable Owner to exercise the rights and remedies under this paragraph.
- C. All claims, costs, losses, and damages incurred or sustained by Owner in exercising the rights and remedies under this Paragraph 14.07 will be charged against Contractor as set-offs against payments due under Article 15. Such claims, costs, losses and damages will include but not be limited to all costs of repair, or replacement of work of others destroyed or damaged by correction, removal, or replacement of Contractor's defective Work.
- D. Contractor shall not be allowed an extension of the Contract Times because of any delay in the performance of the Work attributable to the exercise by Owner of Owner's rights and remedies under this Paragraph 14.07.

ARTICLE 15—PAYMENTS TO CONTRACTOR; SET-OFFS; COMPLETION; CORRECTION PERIOD

15.01 Progress Payments

- A. *Basis for Progress Payments:* The Schedule of Values established as provided in Article 2 will serve as the basis for progress payments and will be incorporated into a form of Application for Payment acceptable to Engineer. Progress payments for Unit Price Work will be based on the number of units completed during the pay period, as determined under the provisions of Paragraph 13.03. Progress payments for cost-based Work will be based on Cost of the Work completed by Contractor during the pay period.
- B. *Applications for Payments*
 1. At least 20 days before the date established in the Agreement for each progress payment (but not more often than once a month), Contractor shall submit to Engineer for review an Application for Payment filled out and signed by Contractor covering the Work

completed as of the date of the Application and accompanied by such supporting documentation as is required by the Contract Documents.

2. If payment is requested on the basis of materials and equipment not incorporated in the Work but delivered and suitably stored at the Site or at another location agreed to in writing, the Application for Payment must also be accompanied by: (a) a bill of sale, invoice, copies of subcontract or purchase order payments, or other documentation establishing full payment by Contractor for the materials and equipment; (b) at Owner's request, documentation warranting that Owner has received the materials and equipment free and clear of all Liens; and (c) evidence that the materials and equipment are covered by appropriate property insurance, a warehouse bond, or other arrangements to protect Owner's interest therein, all of which must be satisfactory to Owner.
3. Beginning with the second Application for Payment, each Application must include an affidavit of Contractor stating that all previous progress payments received by Contractor have been applied to discharge Contractor's legitimate obligations associated with prior Applications for Payment.
4. The amount of retainage with respect to progress payments will be as stipulated in the Agreement.

C. Review of Applications

1. Engineer will, within 10 days after receipt of each Application for Payment, including each resubmittal, either indicate in writing a recommendation of payment and present the Application to Owner, or return the Application to Contractor indicating in writing Engineer's reasons for refusing to recommend payment. In the latter case, Contractor may make the necessary corrections and resubmit the Application.
2. Engineer's recommendation of any payment requested in an Application for Payment will constitute a representation by Engineer to Owner, based on Engineer's observations of the executed Work as an experienced and qualified design professional, and on Engineer's review of the Application for Payment and the accompanying data and schedules, that to the best of Engineer's knowledge, information and belief:
 - a. the Work has progressed to the point indicated;
 - b. the quality of the Work is generally in accordance with the Contract Documents (subject to an evaluation of the Work as a functioning whole prior to or upon Substantial Completion, the results of any subsequent tests called for in the Contract Documents, a final determination of quantities and classifications for Unit Price Work under Paragraph 13.03, and any other qualifications stated in the recommendation); and
 - c. the conditions precedent to Contractor's being entitled to such payment appear to have been fulfilled in so far as it is Engineer's responsibility to observe the Work.

3. By recommending any such payment Engineer will not thereby be deemed to have represented that:
 - a. inspections made to check the quality or the quantity of the Work as it has been performed have been exhaustive, extended to every aspect of the Work in progress, or involved detailed inspections of the Work beyond the responsibilities specifically assigned to Engineer in the Contract; or
 - b. there may not be other matters or issues between the parties that might entitle Contractor to be paid additionally by Owner or entitle Owner to withhold payment to Contractor.
4. Neither Engineer's review of Contractor's Work for the purposes of recommending payments nor Engineer's recommendation of any payment, including final payment, will impose responsibility on Engineer:
 - a. to supervise, direct, or control the Work;
 - b. for the means, methods, techniques, sequences, or procedures of construction, or the safety precautions and programs incident thereto;
 - c. for Contractor's failure to comply with Laws and Regulations applicable to Contractor's performance of the Work;
 - d. to make any examination to ascertain how or for what purposes Contractor has used the money paid by Owner; or
 - e. to determine that title to any of the Work, materials, or equipment has passed to Owner free and clear of any Liens.
5. Engineer may refuse to recommend the whole or any part of any payment if, in Engineer's opinion, it would be incorrect to make the representations to Owner stated in Paragraph 15.01.C.2.
6. Engineer will recommend reductions in payment (set-offs) necessary in Engineer's opinion to protect Owner from loss because:
 - a. the Work is defective, requiring correction or replacement;
 - b. the Contract Price has been reduced by Change Orders;
 - c. Owner has been required to correct defective Work in accordance with Paragraph 14.07, or has accepted defective Work pursuant to Paragraph 14.04;
 - d. Owner has been required to remove or remediate a Hazardous Environmental Condition for which Contractor is responsible; or
 - e. Engineer has actual knowledge of the occurrence of any of the events that would constitute a default by Contractor and therefore justify termination for cause under the Contract Documents.

D. *Payment Becomes Due*

1. Ten days after presentation of the Application for Payment to Owner with Engineer's recommendation, the amount recommended (subject to any Owner set-offs) will become due, and when due will be paid by Owner to Contractor.

E. *Reductions in Payment by Owner*

1. In addition to any reductions in payment (set-offs) recommended by Engineer, Owner is entitled to impose a set-off against payment based on any of the following:
 - a. Claims have been made against Owner based on Contractor's conduct in the performance or furnishing of the Work, or Owner has incurred costs, losses, or damages resulting from Contractor's conduct in the performance or furnishing of the Work, including but not limited to claims, costs, losses, or damages from workplace injuries, adjacent property damage, non-compliance with Laws and Regulations, and patent infringement;
 - b. Contractor has failed to take reasonable and customary measures to avoid damage, delay, disruption, and interference with other work at or adjacent to the Site;
 - c. Contractor has failed to provide and maintain required bonds or insurance;
 - d. Owner has been required to remove or remediate a Hazardous Environmental Condition for which Contractor is responsible;
 - e. Owner has incurred extra charges or engineering costs related to submittal reviews, evaluations of proposed substitutes, tests and inspections, or return visits to manufacturing or assembly facilities;
 - f. The Work is defective, requiring correction or replacement;
 - g. Owner has been required to correct defective Work in accordance with Paragraph 14.07, or has accepted defective Work pursuant to Paragraph 14.04;
 - h. The Contract Price has been reduced by Change Orders;
 - i. An event has occurred that would constitute a default by Contractor and therefore justify a termination for cause;
 - j. Liquidated or other damages have accrued as a result of Contractor's failure to achieve Milestones, Substantial Completion, or final completion of the Work;
 - k. Liens have been filed in connection with the Work, except where Contractor has delivered a specific bond satisfactory to Owner to secure the satisfaction and discharge of such Liens; or
 - l. Other items entitle Owner to a set-off against the amount recommended.
2. If Owner imposes any set-off against payment, whether based on its own knowledge or on the written recommendations of Engineer, Owner will give Contractor immediate written notice (with a copy to Engineer) stating the reasons for such action and the specific amount of the reduction, and promptly pay Contractor any amount remaining after deduction of the amount so withheld. Owner shall promptly pay Contractor the

amount so withheld, or any adjustment thereto agreed to by Owner and Contractor, if Contractor remedies the reasons for such action. The reduction imposed will be binding on Contractor unless it duly submits a Change Proposal contesting the reduction.

3. Upon a subsequent determination that Owner's refusal of payment was not justified, the amount wrongfully withheld will be treated as an amount due as determined by Paragraph 15.01.D.1 and subject to interest as provided in the Agreement.

15.02 Contractor's Warranty of Title

- A. Contractor warrants and guarantees that title to all Work, materials, and equipment furnished under the Contract will pass to Owner free and clear of (1) all Liens and other title defects, and (2) all patent, licensing, copyright, or royalty obligations, no later than 7 days after the time of payment by Owner.

15.03 Substantial Completion

- A. When Contractor considers the entire Work ready for its intended use Contractor shall notify Owner and Engineer in writing that the entire Work is substantially complete and request that Engineer issue a certificate of Substantial Completion. Contractor shall at the same time submit to Owner and Engineer an initial draft of punch list items to be completed or corrected before final payment.
- B. Promptly after Contractor's notification, Owner, Contractor, and Engineer shall make an inspection of the Work to determine the status of completion. If Engineer does not consider the Work substantially complete, Engineer will notify Contractor in writing giving the reasons therefor.
- C. If Engineer considers the Work substantially complete, Engineer will deliver to Owner a preliminary certificate of Substantial Completion which will fix the date of Substantial Completion. Engineer shall attach to the certificate a punch list of items to be completed or corrected before final payment. Owner shall have 7 days after receipt of the preliminary certificate during which to make written objection to Engineer as to any provisions of the certificate or attached punch list. If, after considering the objections to the provisions of the preliminary certificate, Engineer concludes that the Work is not substantially complete, Engineer will, within 14 days after submission of the preliminary certificate to Owner, notify Contractor in writing that the Work is not substantially complete, stating the reasons therefor. If Owner does not object to the provisions of the certificate, or if despite consideration of Owner's objections Engineer concludes that the Work is substantially complete, then Engineer will, within said 14 days, execute and deliver to Owner and Contractor a final certificate of Substantial Completion (with a revised punch list of items to be completed or corrected) reflecting such changes from the preliminary certificate as Engineer believes justified after consideration of any objections from Owner.
- D. At the time of receipt of the preliminary certificate of Substantial Completion, Owner and Contractor will confer regarding Owner's use or occupancy of the Work following Substantial Completion, review the builder's risk insurance policy with respect to the end of the builder's risk coverage, and confirm the transition to coverage of the Work under a permanent property insurance policy held by Owner. Unless Owner and Contractor agree otherwise in writing, Owner shall bear responsibility for security, operation, protection of the Work,

property insurance, maintenance, heat, and utilities upon Owner's use or occupancy of the Work.

- E. After Substantial Completion the Contractor shall promptly begin work on the punch list of items to be completed or corrected prior to final payment. In appropriate cases Contractor may submit monthly Applications for Payment for completed punch list items, following the progress payment procedures set forth above.
- F. Owner shall have the right to exclude Contractor from the Site after the date of Substantial Completion subject to allowing Contractor reasonable access to remove its property and complete or correct items on the punch list.

15.04 *Partial Use or Occupancy*

- A. Prior to Substantial Completion of all the Work, Owner may use or occupy any substantially completed part of the Work which has specifically been identified in the Contract Documents, or which Owner, Engineer, and Contractor agree constitutes a separately functioning and usable part of the Work that can be used by Owner for its intended purpose without significant interference with Contractor's performance of the remainder of the Work, subject to the following conditions:
 1. At any time, Owner may request in writing that Contractor permit Owner to use or occupy any such part of the Work that Owner believes to be substantially complete. If and when Contractor agrees that such part of the Work is substantially complete, Contractor, Owner, and Engineer will follow the procedures of Paragraph 15.03.A through 15.03.E for that part of the Work.
 2. At any time, Contractor may notify Owner and Engineer in writing that Contractor considers any such part of the Work substantially complete and request Engineer to issue a certificate of Substantial Completion for that part of the Work.
 3. Within a reasonable time after either such request, Owner, Contractor, and Engineer shall make an inspection of that part of the Work to determine its status of completion. If Engineer does not consider that part of the Work to be substantially complete, Engineer will notify Owner and Contractor in writing giving the reasons therefor. If Engineer considers that part of the Work to be substantially complete, the provisions of Paragraph 15.03 will apply with respect to certification of Substantial Completion of that part of the Work and the division of responsibility in respect thereof and access thereto.
 4. No use or occupancy or separate operation of part of the Work may occur prior to compliance with the requirements of Paragraph 6.04 regarding builder's risk or other property insurance.

15.05 *Final Inspection*

- A. Upon written notice from Contractor that the entire Work or an agreed portion thereof is complete, Engineer will promptly make a final inspection with Owner and Contractor and will notify Contractor in writing of all particulars in which this inspection reveals that the Work, or agreed portion thereof, is incomplete or defective. Contractor shall immediately take such measures as are necessary to complete such Work or remedy such deficiencies.

15.06 *Final Payment*

A. *Application for Payment*

1. After Contractor has, in the opinion of Engineer, satisfactorily completed all corrections identified during the final inspection and has delivered, in accordance with the Contract Documents, all maintenance and operating instructions, schedules, guarantees, bonds, certificates or other evidence of insurance, certificates of inspection, annotated record documents (as provided in Paragraph 7.12), and other documents, Contractor may make application for final payment.
2. The final Application for Payment must be accompanied (except as previously delivered) by:
 - a. all documentation called for in the Contract Documents;
 - b. consent of the surety, if any, to final payment;
 - c. satisfactory evidence that all title issues have been resolved such that title to all Work, materials, and equipment has passed to Owner free and clear of any Liens or other title defects, or will so pass upon final payment.
 - d. a list of all duly pending Change Proposals and Claims; and
 - e. complete and legally effective releases or waivers (satisfactory to Owner) of all Lien rights arising out of the Work, and of Liens filed in connection with the Work.
3. In lieu of the releases or waivers of Liens specified in Paragraph 15.06.A.2 and as approved by Owner, Contractor may furnish receipts or releases in full and an affidavit of Contractor that: (a) the releases and receipts include all labor, services, material, and equipment for which a Lien could be filed; and (b) all payrolls, material and equipment bills, and other indebtedness connected with the Work for which Owner might in any way be responsible, or which might in any way result in liens or other burdens on Owner's property, have been paid or otherwise satisfied. If any Subcontractor or Supplier fails to furnish such a release or receipt in full, Contractor may furnish a bond or other collateral satisfactory to Owner to indemnify Owner against any Lien, or Owner at its option may issue joint checks payable to Contractor and specified Subcontractors and Suppliers.

B. *Engineer's Review of Final Application and Recommendation of Payment:* If, on the basis of Engineer's observation of the Work during construction and final inspection, and Engineer's review of the final Application for Payment and accompanying documentation as required by the Contract Documents, Engineer is satisfied that the Work has been completed and Contractor's other obligations under the Contract have been fulfilled, Engineer will, within 10 days after receipt of the final Application for Payment, indicate in writing Engineer's recommendation of final payment and present the final Application for Payment to Owner for payment. Such recommendation will account for any set-offs against payment that are necessary in Engineer's opinion to protect Owner from loss for the reasons stated above with respect to progress payments. Otherwise, Engineer will return the Application for Payment to Contractor, indicating in writing the reasons for refusing to recommend final payment, in which case Contractor shall make the necessary corrections and resubmit the Application for Payment.

- C. *Notice of Acceptability:* In support of its recommendation of payment of the final Application for Payment, Engineer will also give written notice to Owner and Contractor that the Work is acceptable, subject to stated limitations in the notice and to the provisions of Paragraph 15.07.
- D. *Completion of Work:* The Work is complete (subject to surviving obligations) when it is ready for final payment as established by the Engineer's written recommendation of final payment and issuance of notice of the acceptability of the Work.
- E. *Final Payment Becomes Due:* Upon receipt from Engineer of the final Application for Payment and accompanying documentation, Owner shall set off against the amount recommended by Engineer for final payment any further sum to which Owner is entitled, including but not limited to set-offs for liquidated damages and set-offs allowed under the provisions of this Contract with respect to progress payments. Owner shall pay the resulting balance due to Contractor within 30 days of Owner's receipt of the final Application for Payment from Engineer.

15.07 *Waiver of Claims*

- A. By making final payment, Owner waives its claim or right to liquidated damages or other damages for late completion by Contractor, except as set forth in an outstanding Claim, appeal under the provisions of Article 17, set-off, or express reservation of rights by Owner. Owner reserves all other claims or rights after final payment.
- B. The acceptance of final payment by Contractor will constitute a waiver by Contractor of all claims and rights against Owner other than those pending matters that have been duly submitted as a Claim, or appealed under the provisions of Article 17.

15.08 *Correction Period*

- A. If within one year after the date of Substantial Completion (or such longer period of time as may be prescribed by the Supplementary Conditions or the terms of any applicable special guarantee required by the Contract Documents), Owner gives Contractor written notice that any Work has been found to be defective, or that Contractor's repair of any damages to the Site or adjacent areas has been found to be defective, then after receipt of such notice of defect Contractor shall promptly, without cost to Owner and in accordance with Owner's written instructions:
 1. correct the defective repairs to the Site or such adjacent areas;
 2. correct such defective Work;
 3. remove the defective Work from the Project and replace it with Work that is not defective, if the defective Work has been rejected by Owner, and
 4. satisfactorily correct or repair or remove and replace any damage to other Work, to the work of others, or to other land or areas resulting from the corrective measures.
- B. Owner shall give any such notice of defect within 60 days of the discovery that such Work or repairs is defective. If such notice is given within such 60 days but after the end of the correction period, the notice will be deemed a notice of defective Work under Paragraph 7.17.B.

- C. If, after receipt of a notice of defect within 60 days and within the correction period, Contractor does not promptly comply with the terms of Owner's written instructions, or in an emergency where delay would cause serious risk of loss or damage, Owner may have the defective Work corrected or repaired or may have the rejected Work removed and replaced. Contractor shall pay all costs, losses, and damages (including but not limited to all fees and charges of engineers, architects, attorneys, and other professionals and all court or arbitration or other dispute resolution costs) arising out of or relating to such correction or repair or such removal and replacement (including but not limited to all costs of repair or replacement of work of others). Contractor's failure to pay such costs, losses, and damages within 10 days of invoice from Owner will be deemed the start of an event giving rise to a Claim under Paragraph 12.01.B, such that any related Claim must be brought within 30 days of the failure to pay.
- D. In special circumstances where a particular item of equipment is placed in continuous service before Substantial Completion of all the Work, the correction period for that item may start to run from an earlier date if so provided in the Specifications.
- E. Where defective Work (and damage to other Work resulting therefrom) has been corrected or removed and replaced under this paragraph, the correction period hereunder with respect to such Work will be extended for an additional period of one year after such correction or removal and replacement has been satisfactorily completed.
- F. Contractor's obligations under this paragraph are in addition to all other obligations and warranties. The provisions of this paragraph are not to be construed as a substitute for, or a waiver of, the provisions of any applicable statute of limitation or repose.

ARTICLE 16—SUSPENSION OF WORK AND TERMINATION

16.01 *Owner May Suspend Work*

- A. At any time and without cause, Owner may suspend the Work or any portion thereof for a period of not more than 90 consecutive days by written notice to Contractor and Engineer. Such notice will fix the date on which Work will be resumed. Contractor shall resume the Work on the date so fixed. Contractor shall be entitled to an adjustment in the Contract Price or an extension of the Contract Times directly attributable to any such suspension. Any Change Proposal seeking such adjustments must be submitted no later than 30 days after the date fixed for resumption of Work.

16.02 *Owner May Terminate for Cause*

- A. The occurrence of any one or more of the following events will constitute a default by Contractor and justify termination for cause:
 1. Contractor's persistent failure to perform the Work in accordance with the Contract Documents (including, but not limited to, failure to supply sufficient skilled workers or suitable materials or equipment, or failure to adhere to the Progress Schedule);
 2. Failure of Contractor to perform or otherwise to comply with a material term of the Contract Documents;
 3. Contractor's disregard of Laws or Regulations of any public body having jurisdiction; or

4. Contractor's repeated disregard of the authority of Owner or Engineer.
- B. If one or more of the events identified in Paragraph 16.02.A occurs, then after giving Contractor (and any surety) 10 days' written notice that Owner is considering a declaration that Contractor is in default and termination of the Contract, Owner may proceed to:
 1. declare Contractor to be in default, and give Contractor (and any surety) written notice that the Contract is terminated; and
 2. enforce the rights available to Owner under any applicable performance bond.
- C. Subject to the terms and operation of any applicable performance bond, if Owner has terminated the Contract for cause, Owner may exclude Contractor from the Site, take possession of the Work, incorporate in the Work all materials and equipment stored at the Site or for which Owner has paid Contractor but which are stored elsewhere, and complete the Work as Owner may deem expedient.
- D. Owner may not proceed with termination of the Contract under Paragraph 16.02.B if Contractor within 7 days of receipt of notice of intent to terminate begins to correct its failure to perform and proceeds diligently to cure such failure.
- E. If Owner proceeds as provided in Paragraph 16.02.B, Contractor shall not be entitled to receive any further payment until the Work is completed. If the unpaid balance of the Contract Price exceeds the cost to complete the Work, including all related claims, costs, losses, and damages (including but not limited to all fees and charges of engineers, architects, attorneys, and other professionals) sustained by Owner, such excess will be paid to Contractor. If the cost to complete the Work including such related claims, costs, losses, and damages exceeds such unpaid balance, Contractor shall pay the difference to Owner. Such claims, costs, losses, and damages incurred by Owner will be reviewed by Engineer as to their reasonableness and, when so approved by Engineer, incorporated in a Change Order. When exercising any rights or remedies under this paragraph, Owner shall not be required to obtain the lowest price for the Work performed.
- F. Where Contractor's services have been so terminated by Owner, the termination will not affect any rights or remedies of Owner against Contractor then existing or which may thereafter accrue, or any rights or remedies of Owner against Contractor or any surety under any payment bond or performance bond. Any retention or payment of money due Contractor by Owner will not release Contractor from liability.
- G. If and to the extent that Contractor has provided a performance bond under the provisions of Paragraph 6.01.A, the provisions of that bond will govern over any inconsistent provisions of Paragraphs 16.02.B and 16.02.D.

16.03 *Owner May Terminate for Convenience*

- A. Upon 7 days' written notice to Contractor and Engineer, Owner may, without cause and without prejudice to any other right or remedy of Owner, terminate the Contract. In such case, Contractor shall be paid for (without duplication of any items):
 1. completed and acceptable Work executed in accordance with the Contract Documents prior to the effective date of termination, including fair and reasonable sums for overhead and profit on such Work;
 2. expenses sustained prior to the effective date of termination in performing services and furnishing labor, materials, or equipment as required by the Contract Documents in connection with uncompleted Work, plus fair and reasonable sums for overhead and profit on such expenses; and
 3. other reasonable expenses directly attributable to termination, including costs incurred to prepare a termination for convenience cost proposal.
- B. Contractor shall not be paid for any loss of anticipated profits or revenue, post-termination overhead costs, or other economic loss arising out of or resulting from such termination.

16.04 *Contractor May Stop Work or Terminate*

- A. If, through no act or fault of Contractor, (1) the Work is suspended for more than 90 consecutive days by Owner or under an order of court or other public authority, or (2) Engineer fails to act on any Application for Payment within 30 days after it is submitted, or (3) Owner fails for 30 days to pay Contractor any sum finally determined to be due, then Contractor may, upon 7 days' written notice to Owner and Engineer, and provided Owner or Engineer do not remedy such suspension or failure within that time, terminate the contract and recover from Owner payment on the same terms as provided in Paragraph 16.03.
- B. In lieu of terminating the Contract and without prejudice to any other right or remedy, if Engineer has failed to act on an Application for Payment within 30 days after it is submitted, or Owner has failed for 30 days to pay Contractor any sum finally determined to be due, Contractor may, 7 days after written notice to Owner and Engineer, stop the Work until payment is made of all such amounts due Contractor, including interest thereon. The provisions of this paragraph are not intended to preclude Contractor from submitting a Change Proposal for an adjustment in Contract Price or Contract Times or otherwise for expenses or damage directly attributable to Contractor's stopping the Work as permitted by this paragraph.

ARTICLE 17—FINAL RESOLUTION OF DISPUTES

17.01 *Methods and Procedures*

- A. *Disputes Subject to Final Resolution:* The following disputed matters are subject to final resolution under the provisions of this article:
 1. A timely appeal of an approval in part and denial in part of a Claim, or of a denial in full, pursuant to Article 12; and

2. Disputes between Owner and Contractor concerning the Work, or obligations under the Contract Documents, that arise after final payment has been made.
- B. *Final Resolution of Disputes:* For any dispute subject to resolution under this article, Owner or Contractor may:
 1. elect in writing to invoke the dispute resolution process provided for in the Supplementary Conditions;
 2. agree with the other party to submit the dispute to another dispute resolution process; or
 3. if no dispute resolution process is provided for in the Supplementary Conditions or mutually agreed to, give written notice to the other party of the intent to submit the dispute to a court of competent jurisdiction.

ARTICLE 18—MISCELLANEOUS

18.01 *Giving Notice*

- A. Whenever any provision of the Contract requires the giving of written notice to Owner, Engineer, or Contractor, it will be deemed to have been validly given only if delivered:
 1. in person, by a commercial courier service or otherwise, to the recipient's place of business;
 2. by registered or certified mail, postage prepaid, to the recipient's place of business; or
 3. by e-mail to the recipient, with the words "Formal Notice" or similar in the e-mail's subject line.

18.02 *Computation of Times*

- A. When any period of time is referred to in the Contract by days, it will be computed to exclude the first and include the last day of such period. If the last day of any such period falls on a Saturday or Sunday or on a day made a legal holiday by the law of the applicable jurisdiction, such day will be omitted from the computation.

18.03 *Cumulative Remedies*

- A. The duties and obligations imposed by these General Conditions and the rights and remedies available hereunder to the parties hereto are in addition to, and are not to be construed in any way as a limitation of, any rights and remedies available to any or all of them which are otherwise imposed or available by Laws or Regulations, by special warranty or guarantee, or by other provisions of the Contract. The provisions of this paragraph will be as effective as if repeated specifically in the Contract Documents in connection with each particular duty, obligation, right, and remedy to which they apply.

18.04 *Limitation of Damages*

- A. With respect to any and all Change Proposals, Claims, disputes subject to final resolution, and other matters at issue, neither Owner nor Engineer, nor any of their officers, directors, members, partners, employees, agents, consultants, or subcontractors, shall be liable to

Contractor for any claims, costs, losses, or damages sustained by Contractor on or in connection with any other project or anticipated project.

18.05 No Waiver

- A. A party's non-enforcement of any provision will not constitute a waiver of that provision, nor will it affect the enforceability of that provision or of the remainder of this Contract.

18.06 Survival of Obligations

- A. All representations, indemnifications, warranties, and guarantees made in, required by, or given in accordance with the Contract, as well as all continuing obligations indicated in the Contract, will survive final payment, completion, and acceptance of the Work or termination of the Contract or of the services of Contractor.

18.07 Controlling Law

- A. This Contract is to be governed by the law of the state in which the Project is located.

18.08 Assignment of Contract

- A. Unless expressly agreed to elsewhere in the Contract, no assignment by a party to this Contract of any rights under or interests in the Contract will be binding on the other party without the written consent of the party sought to be bound; and, specifically but without limitation, money that may become due and money that is due may not be assigned without such consent (except to the extent that the effect of this restriction may be limited by law), and unless specifically stated to the contrary in any written consent to an assignment, no assignment will release or discharge the assignor from any duty or responsibility under the Contract.

18.09 Successors and Assigns

- A. Owner and Contractor each binds itself, its successors, assigns, and legal representatives to the other party hereto, its successors, assigns, and legal representatives in respect to all covenants, agreements, and obligations contained in the Contract Documents.

18.10 Headings

- A. Article and paragraph headings are inserted for convenience only and do not constitute parts of these General Conditions.

SUPPLEMENTARY CONDITIONS OF THE CONSTRUCTION CONTRACT

TABLE OF CONTENTS

	Page
Article 1— Definitions and Terminology.....	1
Article 2— Preliminary Matters	<u>31</u>
Article 3— Contract Documents: Intent, Requirements, Reuse	8
Article 4— Commencement and Progress of the Work	<u>89</u>
Article 5— Site, Subsurface and Physical Conditions, Hazardoud Environmental Conditions	<u>911</u>
Article 6— Bonds and Insurance.....	<u>1115</u>
Article 7— Contractor's Responsibilities	<u>1929</u>
Article 8— Other Work at the Site.....	<u>2232</u>
Article 9— Owner's Responsibilities	<u>2232</u>
Article 10— Engineer's Status During Construction	<u>2333</u>
Article 11— Changes to the Contract	<u>2435</u>
Article 12— Claims.....	<u>2536</u>
Article 13— Cost of Work; Allowances, Unit Price Work.....	<u>2536</u>
Article 14— Tests and Inspections; Correction, Removal, or Acceptance of Defective Work.....	<u>2637</u>
Article 15— Payments to Contractor, Set Offs; Completions; Correction Period	<u>2637</u>
Article 16— Suspension of Work and Termination	<u>2839</u>
Article 17— Final Resolutions of Disputes	<u>2839</u>
Article 18— Miscellaneous	<u>3042</u>
Exhibit A— Software Requirements for Electronic Document Exchange.....	1
Exhibit B— Foreseeable Bad Weather Days	1
Exhibit C— Geotechnical Baseline Report Supplement to the Supplementary Conditions	1

SUPPLEMENTARY CONDITIONS OF THE CONSTRUCTION CONTRACT

These Supplementary Conditions amend or supplement EJCDC® C-700, Standard General Conditions of the Construction Contract (2018). The General Conditions remain in full force and effect except as amended.

The terms used in these Supplementary Conditions have the meanings stated in the General Conditions. Additional terms used in these Supplementary Conditions have the meanings stated below, which are applicable to both the singular and plural thereof.

The address system used in these Supplementary Conditions is the same as the address system used in the General Conditions, with the prefix "SC" added—for example, "Paragraph SC-4.05."

ARTICLE 1—DEFINITIONS AND TERMINOLOGY

SC-1.01.A.8 – Add the following at the end of the Paragraph:

The Change Order form to be used on this Project is EJCDC C-941 (2018). Agency approval is required before Change Orders are effective.

SC-1.01.A.30 – Add the following at the end of the Paragraph:

For the purposes of Rural Development, this term is synonymous with the term “applicant” as defined in 7 CFR 1780.7 (a) (1), (2) and (3) and is an entity receiving financial assistance from the federal programs.

SC-1.01.A.50 – Add the following at the end of the Paragraph:

The Work Change Directive form to be used on this Project is EJCDC C-940 (2018). Agency approval is required before a Work Change Directive is issued.

SC-1.01.A.51 – Add the following new paragraph immediately after Paragraph 1.01.A.50:

51. Agency - The Project is financed in whole or in part by USDA Rural Utilities Service pursuant to the Consolidated Farm and Rural Development Act (7 USC Section 1921 et seq.). The Rural Utilities Service programs are administered through the USDA Rural Development offices; therefore, the Agency for these documents is USDA Rural Development.

SC-1.01.A.52 – Add the following new paragraph with the title “Domestic Preference Definitions” immediately after Paragraph 1.01.A.51:

52.a *Build America, Buy America Act (BABAA)* - Requirements mandated by Title IX of the Infrastructure Investment and Jobs Act (IIJA), Pub. L. 117-58, §§ 70901-70953-58 mandating domestic preference that all iron and steel, manufactured products, and construction materials are produced in the United States.

52.b *Construction Materials* - Those articles, materials, or supplies — other than an item of primarily iron or steel; a manufactured product; cement and cementitious materials; aggregates such as stone, sand, or gravel; or aggregate binding agents or additives— that are or consist primarily of: non-ferrous metals, plastic and polymer- based products, glass, lumber or drywall.

52.c *Contractor's Certification* - Documentation submitted by the Contractor upon Substantial Completion of the Contract that all iron and steel, manufactured products, and construction materials are produced in the United States.

52.d *De Minimis* - Materials and products that represent a small portion of an infrastructure project, specifically no more than 5% of the project costs up to a maximum of \$1,000,000.

52.e *Domestic Preference* - The Build America, Buy America Act (BABAA) requirements under Title IX of the Infrastructure Investment and Jobs Act (IIJA), Pub. L. 117-58, §§ 70901-70953.

52.f *Engineer's Certification* - Documentation submitted by the Engineer that Drawings, Specifications, and Bidding Documents comply with Domestic Preference requirements.

52.g *Manufactured Product* - Items assembled out of components, or otherwise made or processed from raw materials into finished products. Manufactured products must be manufactured (assembled) in the United States, and the cost of components that were mined, produced, or manufactured in the United States must be greater than 55 percent of the total cost of all components of the product.

52.h *Manufacturer's Certification* - Documentation provided by the Manufacturer stating that Domestic Preference requirements have been satisfied for all provided items. If items are purchased via a Supplier, distributor, vendor, etc. from the Manufacturer directly, then the Supplier, distributor, vendor, etc. will be responsible for obtaining and providing these certifications to the parties purchasing the products.

52.i Minor Components - Components within an iron and/or steel product otherwise compliant with the Domestic Preference requirements. This waiver, typically used by Manufacturers, allows use of non-domestically produced miscellaneous Minor Components comprising up to five percent of the total material cost of an otherwise domestically produced iron and steel product. However, unless a separate waiver for a product has been approved, all other iron and steel components in said product must still meet the Domestic Preference requirements. This waiver does not exempt the whole product from the Domestic Preference requirements only Minor Components within said product and the iron or steel components of the product must be produced domestically.

52.j Primarily Iron or Steel - A product is made of greater than 50 percent iron or Steel on a materials cost basis.

ARTICLE 2—PRELIMINARY MATTERS

2.01 *Delivery of Bonds and Evidence of Insurance*

SC-2.01 Delete Paragraphs 2.01.B. and C. in their entirety and insert the following in their place:

- B. *Evidence of Contractor's Insurance*: When Contractor delivers the signed counterparts of the Agreement to Owner, Contractor shall also deliver to Owner copies of the policies (including all endorsements, and identification of applicable self-insured retentions and deductibles) of insurance required to be provided by Contractor in this Contract. Contractor may block out (redact) any confidential premium or pricing information contained in any policy or endorsement furnished under this provision.
- C. *Evidence of Owner's Insurance*: After receipt from Contractor of the signed counterparts of the Agreement and all required bonds and insurance documentation, Owner shall promptly deliver to Contractor copies of the policies of insurance to be provided by Owner in this Contract (if any). Owner may block out (redact) any confidential premium or pricing information contained in any policy or endorsement furnished under this provision.

2.02 *Copies of Documents*

SC-2.02 Amend the first sentence of Paragraph 2.02.A. to read as follows:

Owner shall furnish to Contractor **five** printed copies of the Contract Documents (including one fully signed counterpart of the Agreement), and **[one copy]** in electronic portable document format (PDF).

SC-2.02 Delete Paragraph 2.02.A in its entirety and insert the following new paragraph in its place:

- A. Owner shall furnish to Contractor **5** printed copies of conformed Contract Documents incorporating and integrating all Addenda and any amendments negotiated prior to the Effective Date of the Contract (including one fully signed counterpart of the Agreement), and one copy in electronic portable document format (PDF). Additional printed copies of the conformed Contract Documents will be furnished upon request at the cost of reproduction.

2.06 *Electronic Transmittals*

SC-2.06 Delete Paragraphs 2.06.B and 2.06.C in their entirety and insert the following in their place:

B. *Electronic Documents Protocol:* The parties shall conform to the following provisions in Paragraphs 2.06.B and 2.06.C, together referred to as the Electronic Documents Protocol ("EDP" or "Protocol") for exchange of electronic transmittals.

1. *Basic Requirements*

- a. To the fullest extent practical, the parties agree to and will transmit and accept Electronic Documents in an electronic or digital format using the procedures described in this Protocol. Use of the Electronic Documents and any information contained therein is subject to the requirements of this Protocol and other provisions of the Contract.
- b. The contents of the information in any Electronic Document will be the responsibility of the transmitting party.
- c. Electronic Documents as exchanged by this Protocol may be used in the same manner as the printed versions of the same documents that are exchanged using non-electronic format and methods, subject to the same governing requirements, limitations, and restrictions, set forth in the Contract Documents.
- d. Except as otherwise explicitly stated herein, the terms of this Protocol will be incorporated into any other agreement or subcontract between a party and any third party for any portion of the Work on the Project, or any Project-related services, where that third party is, either directly or indirectly, required to exchange Electronic Documents with a party or with Engineer. Nothing herein will modify the requirements of the Contract regarding communications between and among the parties and their subcontractors and consultants.
- e. When transmitting Electronic Documents, the transmitting party makes no representations as to long term compatibility, usability, or readability of the items resulting from the receiving party's use of software application packages, operating systems, or computer hardware differing from those established in this Protocol.
- f. Nothing herein negates any obligation 1) in the Contract to create, provide, or maintain an original printed record version of Drawings and Specifications, signed and sealed according to applicable Laws and Regulations; 2) to comply with any applicable Law or Regulation governing the signing and sealing of design documents or the signing and electronic transmission of any other documents; or 3) to comply with the notice requirements of Paragraph 18.01 of the General Conditions.

2. *System Infrastructure for Electronic Document Exchange*

- a. Each party will provide hardware, operating system(s) software, internet, e-mail, and large file transfer functions ("System Infrastructure") at its own cost and sufficient for complying with the EDP requirements. With the exception of minimum standards set forth in this EDP, and any explicit system requirements

EJCDC® C-800, Supplementary Conditions of the Construction Contract.

Copyright® 2018 National Society of Professional Engineers, American Council of Engineering Companies, and American Society of Civil Engineers. All rights reserved.

Modified to include RD edits from RUS Bulletin 1780-26 (5/24/2023).

specified by attachment to this EDP, it is the obligation of each party to determine, for itself, its own System Infrastructure.

- 1) The maximum size of an email attachment for exchange of Electronic Documents under this EDP is [number] MB. Attachments larger than that may be exchanged using large file transfer functions or physical media.
- 2) Each Party assumes full and complete responsibility for any and all of its own costs, delays, deficiencies, and errors associated with converting, translating, updating, verifying, licensing, or otherwise enabling its System Infrastructure, including operating systems and software, for use with respect to this EDP.

- b. Each party is responsible for its own system operations, security, back-up, archiving, audits, printing resources, and other Information Technology ("IT") for maintaining operations of its System Infrastructure during the Project, including coordination with the party's individual(s) or entity responsible for managing its System Infrastructure and capable of addressing routine communications and other IT issues affecting the exchange of Electronic Documents.
- c. Each party will operate and maintain industry-standard, industry-accepted, ISO-standard, commercial-grade security software and systems that are intended to protect the other party from: software viruses and other malicious software like worms, trojans, adware; data breaches; loss of confidentiality; and other threats in the transmission to or storage of information from the other parties, including transmission of Electronic Documents by physical media such as CD/DVD/flash drive/hard drive. To the extent that a party maintains and operates such security software and systems, it shall not be liable to the other party for any breach of system security.
- d. In the case of disputes, conflicts, or modifications to the EDP required to address issues affecting System Infrastructure, the parties shall cooperatively resolve the issues; but, failing resolution, the Owner is authorized to make and require reasonable and necessary changes to the EDP to effectuate its original intent. If the changes cause additional cost or time to Contractor, not reasonably anticipated under the original EDP, Contractor may seek an adjustment in price or time under the appropriate process in the Contract.
- e. Each party is responsible for its own back-up and archive of documents sent and received during the term of the contract under this EDP, unless this EDP establishes a Project document archive, either as part of a mandatory Project website or other communications protocol, upon which the parties may rely for document archiving during the specified term of operation of such Project document archive. Further, each party remains solely responsible for its own post-Project back-up and archive of Project documents after the term of the Contract, or after termination of the Project document archive, if one is established, for as long as required by the Contract and as each party deems necessary for its own purposes.

- f. If a receiving party receives an obviously corrupted, damaged, or unreadable Electronic Document, the receiving party will advise the sending party of the incomplete transmission.
- g. The parties will bring any non-conforming Electronic Documents into compliance with the EDP. The parties will attempt to complete a successful transmission of the Electronic Document or use an alternative delivery method to complete the communication.
- h. The Owner will operate a Project information management system (also referred to in this EDP as "Project Website") for use of Owner, Engineer and Contractor during the Project for exchange and storage of Project-related communications and information. Except as otherwise provided in this EDP or the General Conditions, use of the Project Website by the parties as described in this Paragraph will be mandatory for exchange of Project documents, communications, submittals, and other Project-related information. The following conditions and standards will govern use of the Project Website:
 - 1) Describe the period of time during which the Project Website will be operated and be available for reliance by the parties;
 - 2) Provide any minimum system infrastructure, software licensing and security standards for access to and use of the Project Website;
 - 3) Describe the types and extent of services to be provided at the Project Website (such as large file transfer, email, communication and document archives, etc.); and
 - 4) Include any other Project Website attributes that may be pertinent to Contractor's use of the facility and pricing of such use.

C. *Software Requirements for Electronic Document Exchange; Limitations*

- 1. Each party will acquire the software and software licenses necessary to create and transmit Electronic Documents and to read and to use any Electronic Documents received from the other party (and if relevant from third parties), using the software formats required in this section of the EDP.
 - a. Prior to using any updated version of the software required in this section for sending Electronic Documents to the other party, the originating party will first notify and receive concurrence from the other party for use of the updated version or adjust its transmission to comply with this EDP.
- 2. The parties agree not to intentionally edit, reverse engineer, decrypt, remove security or encryption features, or convert to another format for modification purposes any Electronic Document or information contained therein that was transmitted in a software data format, including Portable Document Format (PDF), intended by sender not to be modified, unless the receiving party obtains the permission of the sending party or is citing or quoting excerpts of the Electronic Document for Project purposes.

3. Software and data formats for exchange of Electronic Documents will conform to the requirements set forth in Exhibit A to this EDP, including software versions, if listed.

SC-2.06 Supplement Paragraph 2.06 of the General Conditions by adding the following paragraph:

D. *Requests by Contractor for Electronic Documents in Other Formats*

1. Release of any Electronic Document versions of the Project documents in formats other than those identified in the Electronic Documents Protocol (if any) or elsewhere in the Contract will be at the sole discretion of the Owner.
2. To extent determined by Owner, in its sole discretion, to be prudent and necessary, release of Electronic Documents versions of Project documents and other Project information requested by Contractor ("Request") in formats other than those identified in the Electronic Documents Protocol (if any) or elsewhere in the Contract will be subject to the provisions of the Owner's response to the Request, and to the following conditions to which Contractor agrees:
 - a. The content included in the Electronic Documents created by Engineer and covered by the Request was prepared by Engineer as an internal working document for Engineer's purposes solely, and is being provided to Contractor on an "AS IS" basis without any warranties of any kind, including, but not limited to any implied warranties of fitness for any purpose. As such, Contractor is advised and acknowledges that the content may not be suitable for Contractor's application, or may require substantial modification and independent verification by Contractor. The content may include limited resolution of models, not-to-scale schematic representations and symbols, use of notes to convey design concepts in lieu of accurate graphics, approximations, graphical simplifications, undocumented intermediate revisions, and other devices that may affect subsequent reuse.
 - b. Electronic Documents containing text, graphics, metadata, or other types of data that are provided by Engineer to Contractor under the request are only for convenience of Contractor. Any conclusion or information obtained or derived from such data will be at the Contractor's sole risk and the Contractor waives any claims against Engineer or Owner arising from use of data in Electronic Documents covered by the Request.
 - c. Contractor shall indemnify and hold harmless Owner and Engineer and their subconsultants from all claims, damages, losses, and expenses, including attorneys' fees and defense costs arising out of or resulting from Contractor's use, adaptation, or distribution of any Electronic Documents provided under the Request.
 - d. Contractor agrees not to sell, copy, transfer, forward, give away or otherwise distribute this information (in source or modified file format) to any third party without the direct written authorization of Engineer, unless such distribution is specifically identified in the Request and is limited to Contractor's subcontractors. Contractor warrants that subsequent use by Contractor's subcontractors complies with all terms of the Contract Documents and Owner's response to Request.

3. In the event that Owner elects to provide or directs the Engineer to provide to Contractor any Contractor-requested Electronic Document versions of Project information that is not explicitly identified in the Contract Documents as being available to Contractor, the Owner shall be reimbursed by Contractor on an hourly basis (at \$[number] per hour) for any engineering costs necessary to create or otherwise prepare the data in a manner deemed appropriate by Engineer.

ARTICLE 3—CONTRACT DOCUMENTS: INTENT, REQUIREMENTS, REUSE

3.01 *Intent*

SC-3.01 Delete Paragraph 3.01.C in its entirety.

ARTICLE 4—COMMENCEMENT AND PROGRESS OF THE WORK

SC-4.01.A – Delete the last sentence of paragraph.

4.05 *Delays in Contractor's Progress*

1.

SC-4.05 Paragraph is mandatory for WWD projects.

SC-4.05 Amend Paragraph 4.05.C by adding the following subparagraphs:

5. *Weather-Related Delays*
 - a. If “abnormal weather conditions” as set forth in Paragraph 4.05.C.2 of the General Conditions are the basis for a request for an equitable adjustment in the Contract Times, such request must be documented by data substantiating each of the following: 1) that weather conditions were abnormal for the period of time in which the delay occurred, 2) that such weather conditions could not have been reasonably anticipated, and 3) that such weather conditions had an adverse effect on the Work as scheduled. **Extreme or unusual weather that is typical for a given region, elevation, or season should not be considered abnormal weather conditions. Requests for time extensions due to abnormal weather conditions will be submitted to the Engineer within five days of the end of the abnormal weather condition event. It is the responsibility of the Contractor to provide the information listed in SC 4.05.C.5.b.**
 - b. The existence of abnormal weather conditions will be determined on a month-by-month basis in accordance with the following:
 - 1) Every workday on which one or more of the following conditions exist will be considered a “bad weather day”:

- i) Total precipitation (as rain equivalent) occurring between 7:00 p.m. on the preceding day (regardless of whether such preceding day is a workday) through 7:00 p.m. on the workday in question equals or exceeds **[threshold precipitation quantity]** of precipitation (as rain equivalent, based on the snow/rain conversion indicated in the table entitled Foreseeable Bad Weather Days; such table is hereby incorporated in this SC-4.05.C by reference.
- ii) Ambient outdoor air temperature at 11:00 a.m. is equal to or less than the following low temperature threshold: **[temperature]** degrees Fahrenheit; or, at 3:00 p.m. the ambient outdoor temperature is equal to or greater than the following high temperature threshold: **[temperature]** degrees Fahrenheit.

- 2) Determination of actual bad weather days during performance of the Work will be based on the weather records measured and recorded by **[name of the entity operating the weather station]** weather monitoring station at **[location of the weather monitoring station]**.
- 3) Contractor shall anticipate the number of foreseeable bad weather days per month indicated in the table in Exhibit **[exhibit number]**—Foreseeable Bad Weather Days.
- 4) In each month, every bad weather day exceeding the number of foreseeable bad weather days established in the table in Exhibit **[exhibit number]**—Foreseeable Bad Weather Days will be considered as “abnormal weather conditions.” The existence of abnormal weather conditions will not relieve Contractor of the obligation to demonstrate and document that delays caused by abnormal weather are specific to the planned work activities or that such activities thus delayed were on Contractor’s then-current Progress Schedule’s critical path for the Project.

ARTICLE 5—SITE, SUBSURFACE AND PHYSICAL CONDITIONS, HAZARDOUS ENVIRONMENTAL CONDITIONS

5.03 *Subsurface and Physical Conditions*

SC-5.03 Add the following new paragraphs immediately after Paragraph 5.03.D:

E. The following table lists the reports of explorations and tests of subsurface conditions at or adjacent to the Site that contain Technical Data, and specifically identifies the Technical Data in the report upon which Contractor may rely: **[If there are no such reports, so indicate in the table.]**

Report Title	Date of Report	Technical Data
		[Identify Technical Data]

EJCDC® C-800, Supplementary Conditions of the Construction Contract.

Copyright© 2018 National Society of Professional Engineers, American Council of Engineering Companies, and American Society of Civil Engineers. All rights reserved.

Modified to include RD edits from RUS Bulletin 1780-26 (5/24/2023).

F. The following table lists the drawings of existing physical conditions at or adjacent to the Site, including those drawings depicting existing surface or subsurface structures at or adjacent to the Site (except Underground Facilities), that contain Technical Data, and specifically identifies the Technical Data upon which Contractor may rely: **[If there are no such drawings, so indicate in the table.]**

Drawings Title	Date of Drawings	Technical Data
		[Identify Technical Data]

G. Contractor may examine copies of reports and drawings identified in SC-5.03.E and SC-5.03.F that were not included with the Bidding Documents at **[location]** during regular business hours, or may request copies from Engineer.

5.06 *Hazardous Environmental Conditions*

SC-5.06 Add the following new paragraphs immediately after Paragraph 5.06.A.3:

4. The following table lists the reports known to Owner relating to Hazardous Environmental Conditions at or adjacent to the Site, and the Technical Data (if any) upon which Contractor may rely: **[If there are no such reports, so indicate in the table]**

Report Title	Date of Report	Technical Data
		[Identify Technical Data]

5. The following table lists the drawings known to Owner relating to Hazardous Environmental Conditions at or adjacent to the Site, and Technical Data (if any) contained in such Drawings upon which Contractor may rely: **[If there are no such drawings, so indicate in the table]**

Drawings Title	Date of Drawings	Technical Data
		[Identify Technical Data]

ARTICLE 6—BONDS AND INSURANCE

6.01 *Performance, Payment, and Other Bonds*

SC-6.01 – Disregard EJCDC Guidance Notes – Performance and Payment Bonds, Note 1. Performance and Payment Bonds are required for WEP projects.

SC-6.01 Add the following paragraphs immediately after Paragraph 6.01.A:

1. *Required Performance Bond Form:* The performance bond that Contractor furnishes will be in the form of EJCDC® C-610, Performance Bond (2010, 2013, or 2018 edition).
2. *Required Payment Bond Form:* The payment bond that Contractor furnishes will be in the form of EJCDC® C-615, Payment Bond (2010, 2013, or 2018 edition).

SC-6.01 – EJCDC Guidance Notes – “Other Bonds,” Warranty Bond, Note 1. RD does not require a Warranty Bond, and RD will not accept a Warranty Bond in place of a Performance and Payment Bond. The decision to include a Warranty Bond is made by the Owner and their counsel. Please refer to EJCDC for guidance.

SC-6.01 Add the following paragraphs immediately after Paragraph 6.01.B:

1. The correction period specified as one year after the date of Substantial Completion in Paragraph 15.08.A of the General Conditions is hereby revised to be **[number—either 2, 3, or other]** years after Substantial Completion.
2. After Substantial Completion, Contractor shall furnish a warranty bond issued in the form of EJCDC® C-612, Warranty Bond (2018). The warranty bond must be in a bond amount of **[number—either 10, 15, or other]** percent of the final Contract Price. The warranty bond period will extend to a date **[number—either 2, 3, or other]** years after Substantial Completion of the Work. Contractor shall deliver the fully executed warranty bond to Owner prior to or with the final application for payment, and in any event no later than 11 months after Substantial Completion.
3. The warranty bond must be issued by the same surety that issues the performance bond required under Paragraph 6.01.A of the General Conditions.

6.02 *Insurance—General Provisions*

SC-6.02 Add the following paragraph immediately after Paragraph 6.02.B:

1. Contractor may obtain worker's compensation insurance from an insurance company that has not been rated by A.M. Best, provided that such company (a) is domiciled in the state in which the Project is located, (b) is certified or authorized as a worker's compensation insurance provider by the appropriate state agency, and (c) has been accepted to provide worker's compensation insurance for similar projects by the state within the last 12 months.

SC-6.02 Add the following paragraph immediately after Paragraph 6.02.H.2 of the General Conditions:

3. For the following Subcontractors, Suppliers, or categories of Subcontractor or Supplier, Contractor shall require the following specified insurance, with policy limits as stated:
[Identify Subcontractors, Suppliers, or categories of same, and insert specific insurance requirements and policy limits]

6.03 *Contractor's Insurance*

SC-6.03 Supplement Paragraph 6.03 with the following provisions after Paragraph 6.03.C:

- D. *Other Additional Insureds:* As a supplement to the provisions of Paragraph 6.03.C of the General Conditions, the commercial general liability, automobile liability, umbrella or excess, pollution liability, and unmanned aerial vehicle liability policies must include as additional insureds (in addition to Owner and Engineer) the following: **[Here list by legal name (not category, role, or classification) other persons or entities to be included as additional insureds. See GC-6.03.C.]**
- E. *Workers' Compensation and Employer's Liability:* Contractor shall purchase and maintain workers' compensation and employer's liability insurance, including, as applicable, United States Longshoreman and Harbor Workers' Compensation Act, Jones Act, stop-gap employer's liability coverage for monopolistic states, and foreign voluntary workers' compensation (from available sources, notwithstanding the jurisdictional requirement of Paragraph 6.02.B of the General Conditions).

Workers' Compensation and Related Policies	Policy limits of not less than:
Workers' Compensation	
State	Statutory
Applicable Federal (e.g., Longshoreman's)	Statutory
Foreign voluntary workers' compensation (employer's responsibility coverage), if applicable	Statutory
Jones Act (if applicable)	
Bodily injury by accident—each accident	\$
Bodily injury by disease—aggregate	\$
Employer's Liability	
Each accident	\$
Each employee	\$
Policy limit	\$
Stop-gap Liability Coverage	
For work performed in monopolistic states, stop-gap liability coverage must be endorsed to either the worker's compensation or commercial general liability policy with a minimum limit of:	\$

F. *Commercial General Liability—Claims Covered:* Contractor shall purchase and maintain commercial general liability insurance, covering all operations by or on behalf of Contractor, on an occurrence basis, against claims for:

1. damages because of bodily injury, sickness or disease, or death of any person other than Contractor's employees,
2. damages insured by reasonably available personal injury liability coverage, and
3. damages because of injury to or destruction of tangible property wherever located, including loss of use resulting therefrom.

G. *Commercial General Liability—Form and Content:* Contractor's commercial liability policy must be written on a 1996 (or later) Insurance Services Organization, Inc. (ISO) commercial general liability form (occurrence form) and include the following coverages and endorsements:

1. Products and completed operations coverage.
 - a. Such insurance must be maintained for three years after final payment.
 - b. Contractor shall furnish Owner and each other additional insured (as identified in the Supplementary Conditions or elsewhere in the Contract) evidence of continuation of such insurance at final payment and three years thereafter.
2. Blanket contractual liability coverage, including but not limited to coverage of Contractor's contractual indemnity obligations in Paragraph 7.18.
3. Severability of interests and no insured-versus-insured or cross-liability exclusions.
4. Underground, explosion, and collapse coverage.
5. Personal injury coverage.
6. Additional insured endorsements that include both ongoing operations and products and completed operations coverage through ISO Endorsements CG 20 10 10 01 and CG 20 37 10 01 (together). If Contractor demonstrates to Owner that the specified ISO endorsements are not commercially available, then Contractor may satisfy this requirement by providing equivalent endorsements.
7. For design professional additional insureds, ISO Endorsement CG 20 32 07 04 "Additional Insured—Engineers, Architects or Surveyors Not Engaged by the Named Insured" or its equivalent.

H. *Commercial General Liability—Excluded Content:* The commercial general liability insurance policy, including its coverages, endorsements, and incorporated provisions, must not include any of the following:

1. Any modification of the standard definition of "insured contract" (except to delete the railroad protective liability exclusion if Contractor is required to indemnify a railroad or others with respect to Work within 50 feet of railroad property).
2. Any exclusion for water intrusion or water damage.

3. Any provisions resulting in the erosion of insurance limits by defense costs other than those already incorporated in ISO form CG 00 01.
4. Any exclusion of coverage relating to earth subsidence or movement.
5. Any exclusion for the insured's vicarious liability, strict liability, or statutory liability (other than worker's compensation).
6. Any limitation or exclusion based on the nature of Contractor's work.
7. Any professional liability exclusion broader in effect than the most recent edition of ISO form CG 22 79.

I. *Commercial General Liability—Minimum Policy Limits*

Commercial General Liability	Policy limits of not less than:
General Aggregate	\$
Products—Completed Operations Aggregate	\$
Personal and Advertising Injury	\$
Bodily Injury and Property Damage—Each Occurrence	\$

J. *Automobile Liability:* Contractor shall purchase and maintain automobile liability insurance for damages because of bodily injury or death of any person or property damage arising out of the ownership, maintenance, or use of any motor vehicle. The automobile liability policy must be written on an occurrence basis.

Automobile Liability	Policy limits of not less than:
Bodily Injury	
Each Person	\$
Each Accident	\$
Property Damage	
Each Accident	\$
[or]	
Combined Single Limit	
Combined Single Limit (Bodily Injury and Property Damage)	\$

K. *Umbrella or Excess Liability:* Contractor shall purchase and maintain umbrella or excess liability insurance written over the underlying employer's liability, commercial general liability, and automobile liability insurance described in the Paragraphs above. The coverage afforded must be at least as broad as that of each and every one of the underlying policies.

Excess or Umbrella Liability	Policy limits of not less than:
Each Occurrence	\$
General Aggregate	\$

- L. *Using Umbrella or Excess Liability Insurance to Meet CGL and Other Policy Limit Requirements:* Contractor may meet the policy limits specified for employer's liability, commercial general liability, and automobile liability through the primary policies alone, or through combinations of the primary insurance policy's policy limits and partial attribution of the policy limits of an umbrella or excess liability policy that is at least as broad in coverage as that of the underlying policy, as specified herein. If such umbrella or excess liability policy was required under this Contract, at a specified minimum policy limit, such umbrella or excess policy must retain a minimum limit of **[\$[specify amount]]** after accounting for partial attribution of its limits to underlying policies, as allowed above.
- M. *Contractor's Pollution Liability Insurance:* Contractor shall purchase and maintain a policy covering third-party injury and property damage, including cleanup costs, as a result of pollution conditions arising from Contractor's operations and completed operations. This insurance must be maintained for no less than three years after final completion.

Contractor's Pollution Liability	Policy limits of not less than:
Each Occurrence/Claim	\$
General Aggregate	\$

- N. *Contractor's Professional Liability Insurance:* If Contractor will provide or furnish professional services under this *Contract*, through a delegation of professional design services or otherwise, then Contractor shall be responsible for purchasing and maintaining applicable professional liability insurance. This insurance must cover negligent acts, errors, or omissions in the performance of professional design or related services by the insured or others for whom the insured is legally liable. The insurance must be maintained throughout the duration of the Contract and for a minimum of two years after Substantial Completion. The retroactive date on the policy must pre-date the commencement of furnishing services on the Project.

Contractor's Professional Liability	Policy limits of not less than:
Each Claim	\$
Annual Aggregate	\$

- O. *Railroad Protective Liability Insurance:* Prior to commencing any Work within 50 feet of railroad-owned and controlled property, Contractor shall (1) endorse its commercial general liability policy with ISO CG 24 17, removing the contractual liability exclusion for work within 50 feet of a railroad, (2) purchase and maintain railroad protective liability insurance meeting the following requirements, (3) furnish a copy of the endorsement to Owner, and (4) submit a copy of the railroad protective policy and other railroad-required documentation to the railroad, and notify Owner of such submittal.

[Insert additional specific requirements, commonly set by the railroad, here.]

Railroad Protective Liability Insurance	Policy limits of not less than:
Each Claim	\$
Aggregate	\$

P. *Unmanned Aerial Vehicle Liability Insurance:* If Contractor uses unmanned aerial vehicles (UAV—commonly referred to as drones) at the Site or in support of any aspect of the Work, Contractor shall obtain UAV liability insurance in the amounts stated; name Owner, Engineer, and all individuals and entities identified in the Supplementary Conditions as additional insureds; and provide a certificate to Owner confirming Contractor's compliance with this requirement. Such insurance will provide coverage for property damage, bodily injury or death, and invasion of privacy.

Unmanned Aerial Vehicle Liability Insurance	Policy limits of not less than:
Each Claim	\$
General Aggregate	\$

Q. *Other Required Insurance:* [Here list additional types and amounts of insurance that Contractor is required to carry.]

6.04 Builder's Risk and Other Property Insurance

SC-6.04 Delete Paragraph 6.04.A and insert the following in its place:

A. Owner shall purchase and maintain builder's risk insurance upon the Work on a completed value basis, in the amount of the Work's full insurable replacement cost (subject to such deductible amounts as may be provided in the Supplementary Conditions or required by Laws and Regulations). The specific requirements applicable to the builder's risk insurance are set forth in the Supplementary Conditions.

SC-6.04 Supplement Paragraph 6.04 of the General Conditions with the following provisions:

F. *Builder's Risk Requirements:* The builder's risk insurance must:

1. be written on a builder's risk "all risk" policy form that at a minimum includes insurance for physical loss or damage to the Work, temporary buildings, falsework, and materials and equipment stored and in transit, and must not exclude the coverage of the following risks: fire; windstorm; hail; flood; earthquake, volcanic activity, and other earth movement; lightning; riot; civil commotion; terrorism; vehicle impact; aircraft; smoke; theft; vandalism and malicious mischief; mechanical breakdown, boiler explosion, and artificially generated electric current; collapse; explosion; debris removal; demolition occasioned by enforcement of Laws and Regulations; and water damage (other than that caused by flood).
 - a. Such policy will include an exception that results in coverage for ensuing losses from physical damage or loss with respect to any defective workmanship, methods, design, or materials exclusions.

- b. If insurance against mechanical breakdown, boiler explosion, and artificially generated electric current; earthquake, volcanic activity, and other earth movement; or flood, are not commercially available under builder's risk policies, by endorsement or otherwise, such insurance will be provided through other insurance policies acceptable to Owner and Contractor.
2. cover, as insured property, at least the following: (a) the Work and all materials, supplies, machinery, apparatus, equipment, fixtures, and other property of a similar nature that are to be incorporated into or used in the preparation, fabrication, construction, erection, or completion of the Work, including Owner-furnished or assigned property; (b) spare parts inventory required within the scope of the Contract; and (c) temporary works which are not intended to form part of the permanent constructed Work but which are intended to provide working access to the Site, or to the Work under construction, or which are intended to provide temporary support for the Work under construction, including scaffolding, form work, fences, shoring, falsework, and temporary structures.
3. cover expenses incurred in the repair or replacement of any insured property (including but not limited to fees and charges of contractors, engineers, and architects).
4. extend to cover damage or loss to insured property while in temporary storage at the Site or in a storage location outside the Site (but not including property stored at the premises of a manufacturer or Supplier). If this coverage is subject to a sublimit, such sublimit will be a minimum of \$[amount].
5. extend to cover damage or loss to insured property while in transit. If this coverage is subject to a sublimit, such sublimit will be a minimum of \$[amount].
6. allow for the waiver of the insurer's subrogation rights, as set forth in this Contract.
7. allow for partial occupancy or use by Owner by endorsement, and without cancellation or lapse of coverage.
8. include performance/hot testing and start-up, if applicable.
9. be maintained in effect until the Work is complete, as set forth in Paragraph 15.06.D of the General Conditions, or until written confirmation of Owner's procurement of property insurance following Substantial Completion, whichever occurs first.
10. include as named insureds the Owner, Contractor, Subcontractors (of every tier), and any other individuals or entities required by this Contract to be insured under such builder's risk policy. For purposes of Paragraphs 6.04, 6.05, and 6.06 of the General Conditions, and this and all other corresponding Supplementary Conditions, the parties required to be insured will be referred to collectively as "insureds." In addition to Owner, Contractor, and Subcontractors of every tier, include as insureds the following:
 - a. **[Here list by legal name (not category, role, or classification) other persons or entities to be included on the builder's risk policy as named insureds. It is generally recommended to list the insured's full legal/contractual name, address, contact person, telephone, and e-mail address. Include only persons or entities**

that have property at the Site that is to be insured by the builder's risk insurance. If applicable, separately identify any mortgagee or lender required to be named as a loss payee.]

11. include, in addition to the Contract Price amount, the value of the following equipment and materials to be installed by the Contractor but furnished by the Owner or third parties:
 - a. **[Here list or provide cross-reference to specific items of Owner-furnished (or third-party furnished) equipment, and purchase value; do not list items whose value is already included in the Contract Price.]**
12. If debris removal in connection with repair or replacement of insured property is subject to a coverage sublimit, such sublimit will be a minimum of \$[amount].
13. In addition to the coverage sublimits stated above, the following coverages are also subject to sublimits, as follows:
 - a. **[Here list a specific coverage, or cause of loss, that has been determined to be likely to be subject to a sublimit. If not applicable, then delete Paragraph SC-6.04.F.13 in its entirety.]** If this coverage is subject to a sublimit, such sublimit will be a minimum of \$[amount].

SC-6.04 Supplement Paragraph 6.04 of the General Conditions with the following provision:

- G. *Coverage for Completion Delays:* The builder's risk policy will include, for the benefit of Owner, loss of revenue and soft cost coverage for losses arising from delays in completion that result from covered physical losses or damage. Such coverage will include, without limitation, fixed expenses and debt service for a minimum of 12 months with a maximum deductible of 30 days, compensation for loss of net revenues, rental costs, and attorneys' fees and engineering or other consultants' fees, if not otherwise covered.

SC-6.04 Supplement Paragraph 6.04 of the General Conditions with the following provisions:

- H. *Builder's Risk and Other Property Insurance Deductibles:* The purchaser of any required builder's risk, installation floater, or other property insurance will be responsible for costs not covered because of the application of a policy deductible.
 1. The builder's risk policy (or if applicable the installation floater) will be subject to a deductible amount of no more than \$[number] for direct physical loss in any one occurrence.

SC-6.04 Delete Paragraph 6.04.A of the General Conditions and substitute the following in its place:

- A. *Installation Floater*
 1. Contractor shall provide and maintain installation floater insurance on a broad form or "all risk" policy providing coverage for materials, supplies, machinery, fixtures, and equipment that will be incorporated into the Work ("Covered Property"). Coverage under the Contractor's installation floater will include loss from covered "all risk" causes (perils) to Covered Property:

- a. of the Contractor, and Covered Property of others that is in Contractor's care, custody, and control;
- b. while in transit to the Site, including while at temporary storage sites;
- c. while at the Site awaiting and during installation, erection, and testing;
- d. continuing at least until the installation or erection of the Covered Property is completed, and the Work into which it is incorporated is accepted by Owner.

2. The installation floater coverage cannot be contingent on an external cause or risk, or limited to property for which the Contractor is legally liable.
3. The installation floater coverage will be in an amount sufficient to protect Contractor's interest in the Covered Property. The Contractor will be solely responsible for any deductible carried under this coverage.
4. This policy will include a waiver of subrogation applicable to Owner, Contractor, Engineer, all Subcontractors, and the officers, directors, partners, employees, agents and other consultants and subcontractors of any of them.

ARTICLE 7—CONTRACTOR'S RESPONSIBILITIES

7.03 *Labor; Working Hours*

SC-7.03 Add the following new subparagraphs immediately after Paragraph 7.03.C:

1. Regular working hours will be **[Here insert schedule of regular working hours]**.
2. Owner's legal holidays are **[Here insert list of legal holidays]**.

SC-7.03 Amend the first and second sentences of Paragraph 7.03.C to state "...all Work at the Site must be performed during regular working hours, **[day of the week]** through **[day of the week]**. Contractor will not perform Work on a **[day of the week]**, **[day of the week]**, or any legal holiday."

SC-7.03 Delete Paragraph 7.03.C in its entirety, and insert the following:

C. In the absence of any Laws or Regulations to the contrary, Contractor may perform the Work on holidays, during any or all hours of the day, and on any or all days of the week, at Contractor's sole discretion.

SC-7.03 Add the following new paragraph immediately after Paragraph 7.03.C:

D. **[Contractor] [Owner] [choose one and delete the other]** shall be responsible for the cost of any overtime pay or other expense incurred by the Owner for Engineer's services (including those of the Resident Project Representative, if any), Owner's representative, and construction observation services, occasioned by the performance of Work on Saturday, Sunday, any legal holiday, or as overtime on any regular work day. If Contractor is responsible

but does not pay, or if the parties are unable to agree as to the amount owed, then Owner may impose a reasonable set-off against payments due under Article 15.

SC-7.03 Add the following new subparagraph immediately after Paragraph SC-7.03.D:

1. For purposes of administering the foregoing requirement, additional overtime costs are defined as [Here insert parameters for compensated overtime hours].

SC-7.04.D – Add the following new paragraph immediately after Paragraph 7.04.C:

D. All products must meet Domestic Preference requirements.

SC-7.04.E – Add the following new paragraph immediately after Paragraph 7.04.D:

E. For projects utilizing a *De Minimis* waiver, Contractor shall maintain an itemized list of non-domestically produced components and ensure that the cost is less than 5% of total project cost for project up to a maximum of \$1,000,000.

SC-7.05.A – Amend the third sentence of paragraph by striking out the following words:

Unless the specification or description contains or is followed by words reading that no like, equivalent, or “or-equal” item is permitted,

SC-7.05.A.1.a.3 – Amend the last sentence of Paragraph a.3 by striking out “and;” and adding a period at the end of Paragraph a.3.

SC-7.05.A.1.a.4 – Delete paragraph in its entirety and insert “Deleted.”

SC-7.05.B – Add the following at the end of paragraph:

Contractor shall include a Manufacturer’s Certification or waiver for compliance with Domestic Preference requirements and supporting data, as applicable. Refer to Sample Language for Manufacturer’s Certification provided in these Contract Documents.

SC-7.06.A.3.a.2 – Remove “and” from the end of paragraph.

SC-7.06.A.3.a.3 – Add “; and” to the end of paragraph.

SC-7.06.A.3.a.4 – Add the following new paragraph immediately after Paragraph 7.06.A.3.a.3:

4. Comply with Domestic Preference requirements by providing Manufacturer's Certification or waiver, as applicable. Refer to Sample Language for Manufacturers' Certification provided in these Contract Documents.

SC-7.07.A – Amend by adding the following to the end of the paragraph:

The total amount of work subcontracted by the Contractor shall not exceed fifty percent of the Contract price without prior approval from the Owner, Engineer and Agency.

SC-7.07.B – Delete paragraph in its entirety and insert "Deleted".

SC-7.07.E – Delete the second sentence of paragraph and insert the following in its place:

Owner may not require that Contractor use a specific replacement.

7.10 Taxes

SC-7.10 Add a new paragraph immediately after Paragraph 7.10.A:

- A. Owner is exempt from payment of sales and compensating use taxes of the State of **[name of state where Project is located]** and of cities and counties thereof on all materials to be incorporated into the Work.
 1. Owner will furnish the required certificates of tax exemption to Contractor for use in the purchase of supplies and materials to be incorporated into the Work.
 2. Owner's exemption does not apply to construction tools, machinery, equipment, or other property purchased by or leased by Contractor, or to supplies or materials not incorporated into the Work.

SC-7.12.A Amend paragraph by adding the following after "written interpretations and clarifications":

Manufacturers' Certifications,

7.13 Safety and Protection

SC-7.13 Insert the following after the second sentence of Paragraph 7.13.G:

The following Owner safety programs are applicable to the Work: **[Here expressly identify by title and/or date, any such Owner safety programs. If Owner's safety programs are included in or addressed in the Specifications, SC-7.13 may be used to provide a cross-reference to the Specification section].**

SC-7.16.A.1.c – Amend paragraph by deleting the last period and adding:

EJCDC® C-800, Supplementary Conditions of the Construction Contract.

Copyright® 2018 National Society of Professional Engineers, American Council of Engineering Companies, and American Society of Civil Engineers. All rights reserved.

Modified to include RD edits from RUS Bulletin 1780-26 (5/24/2023).

, including Manufacturer's Certification, or waiver for any item in the submittal subject to Domestic Preference requirements. Refer to the Sample Language for Manufacturers' Certification provided in these Contract Documents.

SC-7.16.C.9 – Add new paragraph immediately after Paragraph 7.16.C.8:

9. Engineer's review and approval of a Shop Drawing or Sample shall include review of Manufacturers' Certifications and any waivers in order to document compliance with Domestic Preference requirements, as applicable.

SC-7.17.F – Add new paragraph immediately after Paragraph 7.17.E:

F. Contractor shall certify upon Substantial Completion that all Work and Materials have complied with Domestic Preference requirements. Contractor shall provide Certification to Owner and Engineer. Refer to the Sample Language for Contractor's Certification provided in these Contract Documents.

ARTICLE 8—OTHER WORK AT THE SITE

8.02 *Coordination*

SC-8.02 Add the following new Paragraph 8.02.C immediately after Paragraph 8.02.B:

C. Owner intends to contract with others for the performance of other work at or adjacent to the Site.

1. **[Here identify individual or entirety]** shall have authority and responsibility for coordination of the various contractors and work forces at the Site;
2. The following specific matters are to be covered by such authority and responsibility: **[Here itemize such matters];**
3. The extent of such authority and responsibilities is: **[Here provide the extent].**

ARTICLE 9—OWNER'S RESPONSIBILITIES

9.13 *Owner's Site Representative*

SC-9.13 Add the following new paragraph immediately after Paragraph 9.12 of the General Conditions:

9.13 *Owner's Site Representative*

A. Owner will furnish an "Owner's Site Representative" to represent Owner at the Site and assist Owner in observing the progress and quality of the Work. The Owner's Site Representative

EJCDC® C-800, Supplementary Conditions of the Construction Contract.

Copyright® 2018 National Society of Professional Engineers, American Council of Engineering Companies, and American Society of Civil Engineers. All rights reserved.

Modified to include RD edits from RUS Bulletin 1780-26 (5/24/2023).

is not Engineer's consultant, agent, or employee. Owner's Site Representative will be [here identify individual or entity]. The authority and responsibilities of Owner's Site Representative follow: [Here describe the duties and activities of the Owner's Site Representative.]

ARTICLE 10—ENGINEER'S STATUS DURING CONSTRUCTION

10.03 Resident Project Representative

SC-10.03 Add the following new subparagraph immediately after Paragraph 10.03.A:

1. On this Project, by agreement with the Owner, the Engineer will not furnish a Resident Project Representative to represent Engineer at the Site or assist Engineer in observing the progress and quality of the Work.

SC-10.03 Add the following new paragraphs immediately after Paragraph 10.03.B:

- C. The Resident Project Representative (RPR) will be Engineer's representative at the Site. RPR's dealings in matters pertaining to the Work in general will be with Engineer and Contractor. RPR's dealings with Subcontractors will only be through or with the full knowledge or approval of Contractor. The RPR will:

1. *Conferences and Meetings:* Attend meetings with Contractor, such as preconstruction conferences, progress meetings, job conferences, and other Project-related meetings (but not including Contractor's safety meetings), and as appropriate prepare and circulate copies of minutes thereof.
2. *Safety Compliance:* Comply with Site safety programs, as they apply to RPR, and if required to do so by such safety programs, receive safety training specifically related to RPR's own personal safety while at the Site.
3. *Liaison*
 - a. Serve as Engineer's liaison with Contractor. Working principally through Contractor's authorized representative or designee, assist in providing information regarding the provisions and intent of the Contract Documents.
 - b. Assist Engineer in serving as Owner's liaison with Contractor when Contractor's operations affect Owner's on-Site operations.
 - c. Assist in obtaining from Owner additional details or information, when required for Contractor's proper execution of the Work.
4. *Review of Work; Defective Work*
 - a. Conduct on-Site observations of the Work to assist Engineer in determining, to the extent set forth in Paragraph 10.02, if the Work is in general proceeding in accordance with the Contract Documents.
 - b. Observe whether any Work in place appears to be defective.

- c. Observe whether any Work in place should be uncovered for observation, or requires special testing, inspection or approval.
- 5. *Inspections and Tests*
 - a. Observe Contractor-arranged inspections required by Laws and Regulations, including but not limited to those performed by public or other agencies having jurisdiction over the Work.
 - b. Accompany visiting inspectors representing public or other agencies having jurisdiction over the Work.
- 6. *Payment Requests:* Review Applications for Payment with Contractor.
- 7. *Completion*
 - a. Participate in Engineer's visits regarding Substantial Completion.
 - b. Assist in the preparation of a punch list of items to be completed or corrected.
 - c. Participate in Engineer's visit to the Site in the company of Owner and Contractor regarding completion of the Work, and prepare a final punch list of items to be completed or corrected by Contractor.
 - d. Observe whether items on the final punch list have been completed or corrected.

D. The RPR will not:

- 1. Authorize any deviation from the Contract Documents or substitution of materials or equipment (including "or-equal" items).
- 2. Exceed limitations of Engineer's authority as set forth in the Contract Documents.
- 3. Undertake any of the responsibilities of Contractor, Subcontractors, or Suppliers.
- 4. Advise on, issue directions relative to, or assume control over any aspect of the means, methods, techniques, sequences or procedures of construction.
- 5. Advise on, issue directions regarding, or assume control over security or safety practices, precautions, and programs in connection with the activities or operations of Owner or Contractor.
- 6. Participate in specialized field or laboratory tests or inspections conducted off-site by others except as specifically authorized by Engineer.
- 7. Authorize Owner to occupy the Project in whole or in part.

ARTICLE 11—CHANGES TO THE CONTRACT

SC-11.02.C – Add new paragraph immediately after Paragraph 11.02.B:

C. The Engineer or Owner shall contact the Agency for concurrence on each Change Order prior to issuance. All Contract Change Orders must be concurred on (signed) by Agency before they are effective.

SC-11.03.A.2 - Add new Paragraph 11.03.A.2 immediately after Paragraph 11.03.A, which shall be renamed Paragraph 11.03.A.1:

2. The Engineer or Owner shall contact the Agency for concurrence on each Work Change Directive prior to issuance. Once authorized by Owner, a copy of each Work Change Directive shall be provided by Engineer to the Agency.

SC-11.05.B – Add the following at the end of this paragraph:

For Owner-authorized changes in the Work, the Contractor will provide the Manufacturer's Certification, or waiver, for materials subject to Domestic Preference requirements except when sole-source is specified, in which case the Engineer will provide the Manufacturer's Certification, or waiver.

SC-11.09.B.2.c – Add new paragraph immediately after Paragraph 11.09.B.2.b:

c. For change orders involving materials subject to Domestic Preference requirements, Contractor shall include a Manufacturer's Certification or waiver, as applicable. Refer to the Sample Language for Manufacturer's Certification provided in these Contract Documents.

ARTICLE 12—CLAIMS

No suggested Supplementary Conditions in this Article.

ARTICLE 13—COST OF WORK; ALLOWANCES, UNIT PRICE WORK

13.01 Cost of the Work

SC-13.01 Supplement Paragraph 13.01.B.5.c.(2) by adding the following sentence:

The equipment rental rate book that governs the included costs for the rental of machinery and equipment owned by Contractor (or a related entity) under the Cost of the Work provisions of this Contract is the most current edition of [name of equipment rental rate book].

SC-13.01 Supplement Paragraph 13.01.C.2 by adding the following definition of small tools and hand tools:

a. For purposes of this paragraph, "small tools and hand tools" means any tool or equipment whose current price if it were purchased new at retail would be less than \$500. [or insert other threshold price.]

SC-13.02.C – Delete paragraph in its entirety and insert "Deleted".

13.03 *Unit Price Work*

SC-13.03 Delete Paragraph 13.03.E in its entirety and insert the following in its place:

E. *Adjustments in Unit Price*

1. Contractor or Owner shall be entitled to an adjustment in the unit price with respect to an item of Unit Price Work if:
 - a. the extended price of a particular item of Unit Price Work amounts to [number] percent or more of the Contract Price (based on estimated quantities at the time of Contract formation) and the variation in the quantity of that particular item of Unit Price Work actually furnished or performed by Contractor differs by more than [number] percent from the estimated quantity of such item indicated in the Agreement; and
 - b. Contractor's unit costs to perform the item of Unit Price Work have changed materially and significantly as a result of the quantity change.
2. The adjustment in unit price will account for and be coordinated with any related changes in quantities of other items of Work, and in Contractor's costs to perform such other Work, such that the resulting overall change in Contract Price is equitable to Owner and Contractor.
3. Adjusted unit prices will apply to all units of that item.

ARTICLE 14—TESTS AND INSPECTIONS; CORRECTION, REMOVAL, OR ACCEPTANCE OF DEFECTIVE WORK

SC-14.03.G – Add new paragraph immediately after Paragraph 14.03.F:

G. Installation of materials that are non-compliant with Domestic Preference requirements shall be considered defective work. Contractor should ensure that Engineer has an approved Manufacturer's Certification, or waiver, prior to any domestic preference compliant item being delivered to the project site.

ARTICLE 15—PAYMENTS TO CONTRACTOR, SET OFFS; COMPLETIONS; CORRECTION PERIOD

15.01 *Progress Payments*

SC-15.01.B.4 – Add the following language at the end of paragraph:

No payments will be made that would deplete the retainage, place in escrow any funds that are required for retainage or invest the retainage for the benefit of the Contractor.

SC-15.01.B.5 – Add new paragraph immediately after Paragraph 15.01.B.4:

5. The Application for Payment form to be used on this Project is EJCDC® C-620. The Agency must approve all Applications for Payment before payment is made.

SC-15.01.B.6 – Add new paragraph immediately after Paragraph 15.01.B.5:

6. By submitting an Application for Payment, based in whole or in part on furnishing equipment or materials, Contractor certifies that such equipment and materials are compliant with Domestic Preference requirements. Manufacturer's Certification for material(s) satisfy these requirements. Refer to the Sample Language for Manufacturer's Certification provided in these Contract Documents.

SC-15.01.C.2.d – Add the following new paragraph immediately after Paragraph 15.01.C.2.c:

d. The materials presented for payment in an Application for Payment comply with Domestic Preference requirements.

SC-15.01.D.1 – Delete paragraph in its entirety and insert the following in its place:

The Application for Payment with Engineer's recommendations will be presented to the Owner and Agency for consideration. If both the Owner and Agency find the Application for Payment acceptable, the recommended amount less any reduction under the provisions of Paragraph 15.01.E will become due twenty (20) days after the Application for Payment is presented to the Owner, and the Owner will make payment to the Contractor.

SC-15.01 Add the following new Paragraph 15.01.F:

F. For contracts in which the Contract Price is based on the Cost of Work, if Owner determines that progress payments made to date substantially exceed the actual progress of the Work (as measured by reference to the Schedule of Values), or present a potential conflict with the Guaranteed Maximum Price, then Owner may require that Contractor prepare and submit a plan for the remaining anticipated Applications for Payment that will bring payments and progress into closer alignment and take into account the Guaranteed Maximum Price (if any), through reductions in billings, increases in retainage, or other equitable measures. Owner will review the plan, discuss any necessary modifications, and implement the plan as modified for all remaining Applications for Payment.

SC-15.02.A – Amend paragraph by striking out the following text: "7 days after".

15.03 *Substantial Completion*

SC-15.03.A – Modify by adding the following after the last sentence:

Contractor shall also submit the Contractor's Certification of Compliance certifying that to the best of the Contractor's knowledge and belief all Iron and Steel products, Manufactured Products, and Construction Materials proposed in the Shop Drawings, Change Orders, and Partial Payment Estimates, and those installed for the Project, comply with Domestic Preference requirements.

SC-15.03 Add the following new subparagraph to Paragraph 15.03.B:

1. If some or all of the Work has been determined not to be at a point of Substantial Completion and will require re-inspection or re-testing by Engineer, the cost of such re-inspection or re-testing, including the cost of time, travel and living expenses, will be paid by Contractor to Owner. If Contractor does not pay, or the parties are unable to agree as to the amount owed, then Owner may impose a reasonable set-off against payments due under this Article 15.

15.08 *Correction Period*

SC-15.08 Add the following new Paragraph 15.08.G:

- G. The correction period specified as one year after the date of Substantial Completion in Paragraph 15.08.A of the General Conditions is hereby revised to be the number of years set forth in SC-6.01.B.1; or if no such revision has been made in SC-6.01.B, then the correction period is hereby specified to be [number] years after Substantial Completion.

ARTICLE 16—SUSPENSION OF WORK AND TERMINATION

No suggested Supplementary Conditions in this Article.

ARTICLE 17—FINAL RESOLUTIONS OF DISPUTES

17.02 *Arbitration*

SC-17.02 Add the following new paragraph immediately after Paragraph 17.01.

17.02 *Arbitration*

- A. All matters subject to final resolution under this Article will be settled by arbitration administered by the American Arbitration Association in accordance with its Construction Industry Arbitration Rules (subject to the conditions and limitations of this Paragraph SC-17.02). Any controversy or claim in the amount of \$100,000 or less will be settled in accordance with the American Arbitration Association's supplemental rules for Fixed Time and Cost Construction Arbitration. This agreement to arbitrate will be specifically enforceable under the prevailing law of any court having jurisdiction.

- B. The demand for arbitration will be filed in writing with the other party to the Contract and with the selected arbitration administrator, and a copy will be sent to Engineer for information. The demand for arbitration will be made within the specific time required in Article 17, or if no specified time is applicable within a reasonable time after the matter in question has arisen, and in no event will any such demand be made after the date when institution of legal or equitable proceedings based on such matter in question would be barred by the applicable statute of limitations.
- C. The arbitrator(s) must be licensed engineers, contractors, attorneys, or construction managers. Hearings will take place pursuant to the standard procedures of the Construction Arbitration Rules that contemplate in-person hearings. The arbitrators will have no authority to award punitive or other damages not measured by the prevailing party's actual damages, except as may be required by statute or the Contract. Any award in an arbitration initiated under this clause will be limited to monetary damages and include no injunction or direction to any party other than the direction to pay a monetary amount.
- D. The Arbitrators will have the authority to allocate the costs of the arbitration process among the parties, but will only have the authority to allocate attorneys' fees if a specific Law or Regulation or this Contract permits them to do so.
- E. The award of the arbitrators must be accompanied by a reasoned written opinion and a concise breakdown of the award. The written opinion will cite the Contract provisions deemed applicable and relied on in making the award.
- F. The parties agree that failure or refusal of a party to pay its required share of the deposits for arbitrator compensation or administrative charges will constitute a waiver by that party to present evidence or cross-examine witness. In such event, the other party shall be required to present evidence and legal argument as the arbitrator(s) may require for the making of an award. Such waiver will not allow for a default judgment against the non-paying party in the absence of evidence presented as provided for above.
- G. No arbitration arising out of or relating to the Contract will include by consolidation, joinder, or in any other manner any other individual or entity (including Engineer, and Engineer's consultants and the officers, directors, partners, agents, employees or consultants of any of them) who is not a party to this Contract unless:
 - 1. the inclusion of such other individual or entity will allow complete relief to be afforded among those who are already parties to the arbitration;
 - 2. such other individual or entity is substantially involved in a question of law or fact which is common to those who are already parties to the arbitration, and which will arise in such proceedings;
 - 3. such other individual or entity is subject to arbitration under a contract with either Owner or Contractor, or consents to being joined in the arbitration; and
 - 4. the consolidation or joinder is in compliance with the arbitration administrator's procedural rules.

- H. The award will be final. Judgment may be entered upon it in any court having jurisdiction thereof, and it will not be subject to modification or appeal, subject to provisions of the Laws and Regulations relating to vacating or modifying an arbitral award.
- I. Except as may be required by Laws or Regulations, neither party nor an arbitrator may disclose the existence, content, or results of any arbitration hereunder without the prior written consent of both parties, with the exception of any disclosure required by Laws and Regulations or the Contract. To the extent any disclosure is allowed pursuant to the exception, the disclosure must be strictly and narrowly limited to maintain confidentiality to the extent possible.

17.03 Attorneys' Fees

SC-17.03 Add the following new paragraph immediately after Paragraph 17.02. [Note: If there is no Paragraph 17.02, because neither arbitration nor any other dispute resolution process has been specified here in the Supplementary Conditions, then revise this to state "Add the following new Paragraph immediately after Paragraph 17.01" and revise the numbering accordingly].

17.03 Attorneys' Fees

- A. For any matter subject to final resolution under this Article, the prevailing party shall be entitled to an award of its attorneys' fees incurred in the final resolution proceedings, in an equitable amount to be determined in the discretion of the court, arbitrator, arbitration panel, or other arbiter of the matter subject to final resolution, taking into account the parties' initial demand or defense positions in comparison with the final result.

ARTICLE 18—MISCELLANEOUS

18.08 Assignment of Contract

SC-18.08 Add the following new paragraph immediately after Paragraph 18.08.A:

- B. The contract dated [date] between Owner as "buyer" and [identify seller] as "seller" for procurement of goods and special services ("procurement contract") [is hereby] [will be] assigned to Contractor by Owner, and Contractor [accepts] [will accept] such assignment. A form documenting the assignment is attached as an exhibit to this Contract.
 - 1. This assignment will occur on the **[Effective Date of the Contract]**, and will relieve the Owner as "buyer" from all further obligations and liabilities under the procurement contract.
 - 2. Upon assignment, the "seller" will be a Subcontractor or Supplier of the Contractor, and Contractor will be responsible for seller's performance, acts, and omissions, as set forth in Paragraph 7.07 of the General Conditions just as Contractor is responsible for all other Subcontractors and Suppliers.
 - 3. Notwithstanding this assignment, all performance guarantees and warranties required by the procurement contract will continue to run for the benefit of the Owner and, in addition, for the benefit of the Contractor.

4. Except as noted in the procurement contract, all rights, duties and obligations of Engineer to "buyer" and "seller" under the procurement contract will cease **[upon the assignment to Contractor]**.

SC-18.11 – Add new paragraph immediately after Paragraph 18.10:

18.11 *Tribal Sovereignty*

- A. **No provision of this Agreement will be construed by any of the signatories as abridging or debilitating any sovereign powers of the [insert name of Tribe] Tribe; affecting the trust-beneficiary relationship between the Secretary of the Interior, Tribe, and Indian landowner(s); or interfering with the government-to-government relationship between the United States and the Tribe.**

SC-19 – Add the following new Article 19 immediately after Article 18:

Article 19 - FEDERAL REQUIREMENTS

19.01 *Agency Not a Party*

- A. **This Contract is expected to be funded in part with funds provided by Agency. Neither Agency, nor any of its departments, entities, or employees, is a party to this Contract.**

19.02 *Contract Approval*

- A. **Owner and Contractor will furnish Owner's attorney such evidence as required so that Owner's attorney can complete and execute the "Certificate of Owner's Attorney" before Owner submits the executed Contract Documents to Agency for approval. Refer to Certificate of Owner's Attorney and Agency Concurrence provided in these Contract Documents.**

- B. **Agency concurrence is required on both the Bid and the Contract before the Contract is effective.**

19.03 *Conflict of Interest*

- A. **Contractor may not knowingly contract with a Supplier or Manufacturer if the individual or entity who prepared the Drawings and Specifications has a corporate or financial affiliation with the Supplier or Manufacturer. Owner's officers, employees, or agents shall not engage in the award or administration of this Contract if a conflict of interest, real or apparent, would be involved. Such a conflict would arise when: (i) the employee, officer**

or agent; (ii) any member of their immediate family; (iii) their partner or (iv) an organization that employs, or is about to employ, any of the above, has a financial interest or other interest in or a tangible personal benefit from the Contractor. Owner's officers, employees, or agents shall neither solicit nor accept gratuities, favors or anything of monetary value from Contractor or subcontractors.

19.04 *Gratuities*

A. If Owner finds after a notice and hearing that Contractor, or any of Contractor's agents or representatives, offered or gave gratuities (in the form of entertainment, gifts, or otherwise) to any official, employee, or agent of Owner or Agency in an attempt to secure this Contract or favorable treatment in awarding, amending, or making any determinations related to the performance of this Contract, Owner may, by written notice to Contractor, terminate this Contract. Owner may also pursue other rights and remedies that the law or this Contract provides. However, the existence of the facts on which Owner bases such findings shall be an issue and may be reviewed in proceedings under the dispute resolution provisions of this Contract.

B. In the event this Contract is terminated as provided in paragraph 19.04.A, Owner may pursue the same remedies against Contractor as it could pursue in the event of a breach of this Contract by Contractor. As a penalty, in addition to any other damages to which it may be entitled by law, Owner may pursue exemplary damages in an amount (as determined by Owner) which shall not be less than three nor more than ten times the costs Contractor incurs in providing any such gratuities to any such officer or employee.

19.05 *Small, Minority and Women's Businesses*

A. If Contractor intends to let any subcontracts for a portion of the work, Contractor will take all necessary affirmative steps to assure that minority businesses, women's business enterprises, and labor surplus area firms are used when possible. Affirmative steps will include:

1. Placing qualified small and minority businesses and women's business enterprises on solicitation lists;
2. Assuring that small and minority businesses, and women's business enterprises are solicited whenever they are potential sources;
3. Dividing total requirements, when economically feasible, into smaller tasks or quantities to permit maximum participation by small and minority businesses, and women's business enterprises;
4. Establishing delivery schedules, where the requirement permits, which encourage participation by small and minority businesses, and women's business enterprises;

5. Using the services and assistance, as appropriate, of such organizations as the Small Business Administration and the Minority Business Development Agency of the Department of Commerce.

19.06 *Anti-Kickback*

A. Contractor shall comply with the Copeland Anti-Kickback Act (40 USC 3145) as supplemented by Department of Labor regulations (29 CFR Part 3, "Contractors and Subcontractors on Public Buildings or Public Works Financed in Whole or in Part by Loans or Grants of the United States"). The Act provides that Contractor or subcontractor shall be prohibited from inducing, by any means, any person employed in the construction, completion, or repair of public facilities, to give up any part of the compensation to which they are otherwise entitled. Owner shall report all suspected or reported violations to Agency.

19.07 *Clean Air Act (42 U.S.C. 7401-7671q.) and the Federal Water Pollution Control Act (33 U.S.C. 1251-1387), as amended*

A. Contractor to agree to comply with all applicable standards, orders or regulations issued pursuant to the Clean Air Act (42 U.S.C. 7401-7671q) and the Federal Water Pollution Control Act as amended (33 U.S.C. 1251-1387). Violations must be reported to the federal awarding agency and the Regional Office of the Environmental Protection Agency (EPA).

19.08 *Equal Employment Opportunity*

A. The Contract is considered a federally assisted construction contract. Except as otherwise provided under 41 CFR Part 60, all contracts that meet the definition of "federally assisted construction contract" in 41 CFR Part 60-1.3 must include the equal opportunity clause provided under 41 CFR 60-1.4(b), in accordance with Executive Order 11246, "Equal Employment Opportunity" (30 FR 12319, 12935, 3 CFR Part, 1964-1965 Comp., p. 339), as amended by Executive Order 11375, "Amending Executive Order 11246 Relating to Equal Employment Opportunity," and implementing regulations at 41 CFR part 60, "Office of Federal Contract Compliance Programs, Equal Employment Opportunity, Department of Labor."

19.09 *Byrd Anti-Lobbying Amendment (31 U.S.C. 1352)*

A. Contractors that apply or bid for an award exceeding \$100,000 must file the required certification (RD Instruction 1940-Q Exhibit A-1). The Contractor certifies to the Owner and every subcontractor certifies to the Contractor that it will not and has not used federal appropriated funds to pay any person or organization for influencing or attempting to influence an officer or employee of any agency, a member of Congress, officer or employee of Congress, or an employee of a member of Congress in connection with obtaining the

Contract if it is covered by 31 U.S.C. 1352. The Contractor and every subcontractor must also disclose any lobbying with non-federal funds that takes place in connection with obtaining any federal award. Such disclosures are forwarded from tier to tier up to the Owner. Necessary certification and disclosure forms shall be provided by Owner.

19.10 Environmental Requirements

A. When constructing a Project involving trenching and/or other related earth excavations, Contractor shall comply with the following environmental conditions:

1. Wetlands – When disposing of excess, spoil, or other Construction Materials on public or private property, Contractor shall not fill in or otherwise convert wetlands.
2. Floodplains – When disposing of excess, spoil, or other Construction Materials on public or private property, Contractor shall not fill in or otherwise convert 100-year floodplain areas (Standard Flood Hazard Area) delineated on the latest Federal Emergency Management Agency Floodplain Maps, or other appropriate maps, e.g., alluvial soils on NRCS Soil Survey Maps.
3. Historic Preservation - Applicants shall ensure that Contractors maintain a copy of the following inadvertent discovery plan onsite for review:
 - a. If during the course of any ground disturbance related to any Project, any post review discovery, including but not limited to, any artifacts, foundations, or other indications of past human occupation of the area are uncovered, shall be protected by complying with 36 CFR § 800.13(b)(3) and (c) and shall include the following:
 - i. All Work, including vehicular traffic, shall immediately stop within a 50 ft. radius around the area of discovery. The Contractor shall ensure barriers are established to protect the area of discovery and notify the Engineer to contact the appropriate RD personnel. The Engineer shall engage a Secretary of the Interior (SOI) qualified professional archeologist to quickly assess the nature and scope of the discovery; implement interim measures to protect the discovery from looting and vandalism; and establish broader barriers if further historic and/or precontact properties, can reasonably be expected to occur.
 - ii. The RD personnel shall notify the appropriate RD environmental staff member, the Federal Preservation Officer (FPO), and State Historic Preservation Office (SHPO) immediately. Indian tribe(s) or Native Hawaiian Organization (NHOs) that have an interest in the area of discovery shall be contacted immediately. The SHPO may require additional tribes or NHOs who may have an interest in the area of discovery also

be contacted. The notification shall include an assessment of the discovery provided by the SOI qualified professional archeologist.

iii. When the discovery contains burial sites or human remains, the Contractor shall immediately notify the appropriate RD personnel who will contact the RD environmental staff member, FPO, and the SHPO. The relevant law enforcement authorities shall be immediately contacted by onsite personnel to reduce delay times, in accordance with tribal, state, or local laws including 36 CFR Part 800.13; 43 CFR Part 10, Subpart B; and the Advisory Council on Historic Preservation's Policy Statement Regarding treatment of Burial Sites, Human Remains, or Funerary Objects (February 23, 2007).

iv. When the discovery contains burial sites or human remains, all construction activities, including vehicular traffic shall stop within a 100 ft. radius of the discovery and barriers shall be established. The evaluation of human remains shall be conducted at the site of discovery by a SOI qualified professional. Remains that have been removed from their primary context and where that context may be in question may be retained in a secure location, pending further decisions on treatment and disposition. RD may expand this radius based on the SOI professional's assessment of the discovery and establish broader barriers if further subsurface burial sites, or human remains can reasonably be expected to occur. RD, in consultation with the SHPO and interested tribes or NHOs, shall develop a plan for the treatment of native human remains.

v. Work may continue in other areas of the undertaking where no historic properties, burial sites, or human remains are present. If the inadvertent discovery appears to be a consequence of illegal activity such as looting, the onsite personnel shall contact the appropriate legal authorities immediately if the landowner has not already done so.

vi. Work may not resume in the area of the discovery until a notice to proceed has been issued by RD. RD shall not issue the notice to proceed until it has determined that the appropriate local protocols and consulting parties have been consulted.

vii. Inadvertent discoveries on federal and tribal land shall follow the processes required by the federal or tribal entity.

4. Endangered Species – Contractor shall comply with the Endangered Species Act, which provides for the protection of endangered and/or threatened species and critical habitat. Should any evidence of the presence of endangered

and/or threatened species or their critical habitat be brought to the attention of Contractor, Contractor will immediately report this evidence to Owner and a representative of Agency. Construction shall be temporarily halted pending the notification process and further directions issued by Agency after consultation with the U.S. Fish and Wildlife Service.

5. Mitigation Measures – The following environmental mitigation measures are required on this Project: *[Insert mitigation measures from the Letter of Conditions here]*.

19.11 *Contract Work Hours and Safety Standards Act (40 U.S.C. 3701-3708)*

A. Where applicable, for contracts awarded by the Owner in excess of \$100,000 that involve the employment of mechanics or laborers, the Contractor will comply with 40 U.S.C. 3702 and 3704, as supplemented by Department of Labor regulations (29 CFR Part 5). Under 40 U.S.C. 3702 of the Act, the Contractor will compute the wages of every mechanic and laborer on the basis of a standard work week of 40 hours. Work in excess of the standard work week is permissible provided that the worker is compensated at a rate of not less than one and a half times the basic rate of pay for all hours worked in excess of 40 hours in the work week. The requirements of 40 U.S.C. 3704 are applicable to construction work and provide that no laborer or mechanic will be required to work in surroundings or under working conditions which are unsanitary, hazardous or dangerous. These requirements do not apply to the purchases of supplies or materials or articles ordinarily available on the open market, or contracts for transportation or transmission of intelligence.

19.12 *Debarment and Suspension (Executive Orders 12549 and 12689)*

A. A contract award (see 2 CFR 180.220) must not be made to parties listed on the governmentwide exclusions in the System for Award Management (SAM), in accordance with the OMB guidelines at 2 CFR 180 that implement Executive Orders 12549 (3 CFR part 1986 Comp., p. 189) and 12689 (3 CFR part 1989 Comp., p. 235), “Debarment and Suspension.” SAM Exclusions contains the names of parties debarred, suspended, or otherwise excluded by agencies, as well as parties declared ineligible under statutory or regulatory authority other than Executive Order 12549.

19.13 *Procurement of recovered materials*

A. The Contractor will comply with 2 CFR Part 200.322, “Procurement of recovered materials.”

19.14 *Domestic Preference*

A. Build America, Buy America Act (BABAA). All Iron and Steel Products, Manufactured Products, and Construction Materials used in this project must comply with the Build America, Buy America Act (BABAA) requirements mandated by Title IX of the Infrastructure Investment and Jobs Act (IIJA), Pub. L. 117-58, §§ 70901-70953. Aggregates such as stone, sand, or gravel do not apply to BABAA.

B. The following waivers apply to this Contract:

1. **BABAA *De Minimis, Small Grants and Minor Components***
2. **[add project specific waivers as applicable].**

EXHIBIT A—SOFTWARE REQUIREMENTS FOR ELECTRONIC DOCUMENT EXCHANGE

Item	Electronic Documents	Transmittal Means	Data Format	Note (1)
a.1	General communications, transmittal covers, meeting notices and responses to general information requests for which there is no specific prescribed form.	Email	Email	
a.2	Meeting agendas, meeting minutes, RFI's and responses to RFI's, and Contract forms.	Email w/ Attachment	PDF	(2)
a.3	Contactors Submittals (Shop Drawings, "or equal" requests, substitution requests, documentation accompanying Sample submittals and other submittals) to Owner and Engineer, and Owner's and Engineer's responses to Contractor's Submittals, Shop Drawings, correspondence, and Applications for Payment.	Email w/ Attachment	PDF	
a.4	Correspondence; milestone and final version Submittals of reports, layouts, Drawings, maps, calculations and spreadsheets, Specifications, Drawings and other Submittals from Contractor to Owner or Engineer and for responses from Engineer and Owner to Contractor regarding Submittals.	Email w/ Attachment or LFE	PDF	
a.5	Layouts and drawings to be submitted to Owner for future use and modification.	Email w/ Attachment or LFE	DWG	
a.6	Correspondence, reports and Specifications to be submitted to Owner for future word processing use and modification.	Email w/ Attachment or LFE	DOC	
a.7	Spreadsheets and data to be submitted to Owner for future data processing use and modification.	Email w/ Attachment or LFE	EXC	
a.8	Database files and data to be submitted to Owner for future data processing use and modification.	Email w/ Attachment or LFE	DB	
Notes				
(1)	All exchanges and uses of transmitted data are subject to the appropriate provisions of Contract Documents.			
(2)	Transmittal of written notices is governed by Paragraph 18.01 of the General Conditions.			
Key				
Email	Standard Email formats (.htm, .rtf, or .txt). Do not use stationery formatting or other features that impair legibility of content on screen or in printed copies			
LFE	Agreed upon Large File Exchange method (FTP, CD, DVD, hard drive)			
PDF	Portable Document Format readable by Adobe® Acrobat Reader Version [number] or later			
DWG	Autodesk® AutoCAD .dwg format Version [number]			
DOC	Microsoft® Word .docx format Version [number]			
EXC	Microsoft® Excel .xls or .xml format Version [number]			

Tuscarora Township
Sewer Extension Phase I - Gravity
Contract Number 22-5797-A

DB	Microsoft® Access .mdb format Version [number]
----	--

Exhibit A—Software Requirements for Electronic Document Exchange.
EJCDC® C-800, Supplementary Conditions of the Construction Contract.

Copyright© 2018 National Society of Professional Engineers, American Council of Engineering Companies,
and American Society of Civil Engineers. All rights reserved.
Modified to include RD edits from RUS Bulletin 1780-26 (5/24/2023).

EXHIBIT B—FORESEEABLE BAD WEATHER DAYS

Month	Number of Foreseeable Bad Weather Days in Month Based on Precipitation as Rain Equivalent (inches) (1)	Ambient Outdoor Air Temperature (degrees F)	
		Number of Foreseeable Bad Weather Days in Month Based on Low Temperature (at 11:00 a.m.)	Number of Foreseeable Bad Weather Days in Month Based on High Temperature (at 3:00 p.m.)
January			
February			
March			
April			
May			
June			
July			
August			
September			
October			
November			
December			
Notes:			
1. Two inches of sleet equal one inch of rain. Five inches of wet, heavy snow equal one inch of rain. Fifteen inches of "dry" powder snow equals one inch of rain.			

EXHIBIT C—GEOTECHNICAL BASELINE REPORT SUPPLEMENT TO THE SUPPLEMENTARY CONDITIONS

1.01 Definitions

SC-1.01 Add to the list of definitions in Paragraph 1.01.A by inserting the following as numbered items in their proper alphabetical positions:

1. *Geotechnical Baseline Report (GBR)*—The interpretive report prepared by or for Owner regarding subsurface conditions at the Site, and containing specific baseline geotechnical conditions that may be anticipated or relied upon for bidding and contract administration purposes, subject to the controlling provisions of the Contract, including the GBR's own terms. The GBR is a Contract Document.
2. *Geotechnical Data Report (GDR)*—The factual report that collects and presents data regarding actual subsurface conditions at or adjacent to the Site, including Technical Data and other geotechnical data, prepared by or for Owner in support of the Geotechnical Baseline Report. The GDR's content may include logs of borings, trenches, and other site investigations, recorded measurements of subsurface water levels, the results of field and laboratory testing, and descriptions of the investigative and testing programs. The GDR does not include an interpretation of the data. If opinions, or interpretive or speculative non-factual comments or statements appear in a document that is labeled a GDR, such opinions, comments, or statements are not operative parts of the GDR and do not have contractual standing. Subject to that exception, the GDR is a Contract Document.

5.03 Subsurface and Physical Conditions

SC-5.03 Delete Paragraph 5.03 in its entirety and replace with the following:

5.03 Subsurface and Physical Conditions

A. *Reports and Drawings:* The Supplementary Conditions hereby identify:

1. those reports of explorations and tests of subsurface conditions at or adjacent to the Site (other than any Geotechnical Data Report or Geotechnical Baseline Report) that contain Technical Data. Such reports are as follows:
 - a. *Report Title:* **[Exact title of the document]**
 - b. *Date of Report:* **[Date report was issued]**
 - c. *Technical Data in report upon which Contractor may rely:* **[Identify Technical Data (for example, "Boring Log, Test Site 3") and specify page number or other reference where Technical Data is located within the report. List multiple Technical Data line items per entry when appropriate.]**
2. those drawings of existing physical conditions at or adjacent to the Site, including those drawings depicting existing surface or subsurface structures at or adjacent to the Site (except Underground Facilities), that contain Technical Data. Such drawings are as follows:

Exhibit C—Geotechnical Baseline Report Supplement to the Supplementary Conditions.

EJCDC® C-800, Supplementary Conditions of the Construction Contract.

Copyright® 2018 National Society of Professional Engineers, American Council of Engineering Companies, and American Society of Civil Engineers. All rights reserved.

Modified to include RD edits from RUS Bulletin 1780-26 (5/24/2023).

- a. *Drawings Title: [Exact title of the drawings]*
- b. *Date of Drawings: [Date drawings were issued]*
- c. *Technical Data in drawings upon which Contractor may rely: [Identify Technical Data (for example, "Plan View of Rock Outcroppings") in drawings, or state "All information in drawing" if entire content is Technical Data entitled to reliance; and specify drawing number, page number, or other reference where the Technical Data is located. List multiple Technical Data line items per entry when appropriate.]*

3. Contractor may examine copies of reports and drawings identified immediately above that were not included with the Bidding Documents at **[location]** during regular business hours, or may request copies from Engineer, at the cost of reproduction.

B. *Underground Facilities:* Underground Facilities are shown or indicated on the Drawings, pursuant to Paragraph 5.05, and not in the drawings referred to in Paragraph SC-5.03.A. Information and data regarding the presence or location of Underground Facilities are not intended to be categorized, identified, or defined as Technical Data.

C. *Reliance by Contractor on Technical Data Authorized:* Contractor may rely upon the accuracy of the Technical Data expressly identified in the Supplementary Conditions with respect to such reports and drawings, but such reports and drawings are not Contract Documents. If no such express identification has been made, then Contractor may rely upon the accuracy of the Technical Data as defined in Paragraph 1.01.A.46.b.

D. *Limitations of Other Data and Documents:* Except for such reliance on Technical Data, Contractor may not rely upon or make any claim against Owner or Engineer, or any of their officers, directors, members, partners, employees, agents, consultants, or subcontractors, with respect to:

1. the completeness of such reports and drawings for Contractor's purposes, including, but not limited to, any aspects of the means, methods, techniques, sequences, and procedures of construction to be employed by Contractor, and safety precautions and programs incident thereto; or
2. other data, interpretations, opinions, and information contained in such reports or shown or indicated in such drawings; or
3. the contents of other Site-related documents made available to Contractor, such as record drawings from other projects at or adjacent to the Site, or Owner's archival documents concerning the Site; or
4. any Contractor interpretation of or conclusion drawn from any Technical Data or any such other data, interpretations, opinions, or information.

E. *Geotechnical Baseline Report*

1. This Contract contains a Geotechnical Baseline Report ("GBR"), identified as follows: **[Example: Geotechnical Baseline Report for Northwest Interceptor, dated February**

12, 2013, prepared by ABC Geotechnical Engineers, Inc., Sacramento, California]. This Contract also contains a Geotechnical Data Report (GDR), identified as follows: **[Example: Geotechnical Data Report for Northwest Interceptor, dated June 15, 2012, prepared by ABC Geotechnical Engineers, Inc., Sacramento, California].**

2. The GBR and GDR are incorporated as Contract Documents. The GBR and GDR are to be used in conjunction with other Contract Documents, including the Drawings and Specifications. If there is a conflict between the terms of the GBR and the GDR, the GBR's terms prevail.
3. The GBR describes certain select subsurface conditions that are anticipated to be encountered by Contractor during construction in specified locations (referred to here in the Supplementary Conditions as "Baseline Conditions"). These may include ground, geological, groundwater, and other subsurface geotechnical conditions, and baselines of anticipated Underground Facilities or subsurface structures.
4. The Baseline Conditions will be used to assist in the administration of the Contract's differing site conditions clause at locations where subsurface conditions have been baselined. If a condition is baselined in the GBR, then only the pertinent Baseline Conditions will be used to determine whether there is a differing site condition; and no other indication of that condition in the Contract Documents or Technical Data, or of a condition that describes, quantifies, or measures a similar characteristic of the subsurface, will be used for the differing site condition determination.
5. The Baseline Conditions will not be used to make differing site conditions determinations at locations that have not been baselined in the GBR, or at any location with respect to subsurface conditions that the Baseline Conditions do not address. If Underground Facilities or Hazardous Environmental Conditions are expressly addressed in the Baseline Conditions, then comparison to such Baseline Conditions will be the primary means of determining (a) whether an Underground Facility was shown or indicated with reasonable accuracy, as provided in Paragraph 5.05 of the General Conditions, or (b) whether a Hazardous Environmental Condition was shown or indicated in the Contract Documents as indicated in Paragraph 5.06.H of the General Conditions. As indicated in Paragraph SC-5.04 below, the GDR will be the primary resource for differing site conditions determinations in cases in which the GBR is inapplicable.
6. The descriptions of subsurface conditions provided in the GBR are based on geotechnical investigations, laboratory tests, interpretation, interpolation, extrapolation, and analyses. Neither Owner, Engineer, nor any geotechnical or other consultant warrants or guarantees that actual subsurface conditions will be as described in the GBR, nor is the GBR intended to warrant or guarantee the use of specific means or methods of construction.
7. The behavior of the ground during construction depends substantially upon the Contractor's selected means, methods, techniques, sequences, and procedures of

Exhibit C—Geotechnical Baseline Report Supplement to the Supplementary Conditions.

EJCDC® C-800, Supplementary Conditions of the Construction Contract.

Copyright® 2018 National Society of Professional Engineers, American Council of Engineering Companies, and American Society of Civil Engineers. All rights reserved.

Modified to include RD edits from RUS Bulletin 1780-26 (5/24/2023).

construction. If ground behavior conditions are baselined in the GBR, they are based on stated assumptions regarding construction means and methods.

8. The GBR will not reduce or relieve Contractor of its responsibility for the planning, selection, and implementation of safety precautions and programs incident to Contractor's means, methods, techniques, sequences, and procedures of construction, or to the Work.

5.04 *Differing Subsurface or Physical Conditions*

SC-5.04 Delete Paragraph 5.04 in its entirety and replace with the following:

5.04 *Differing Subsurface or Physical Conditions*

- A. *Notice:* If Contractor believes that any subsurface condition that is uncovered or revealed at the Site:

1. differs materially from conditions shown or indicated in the GBR; or
2. differs materially from conditions shown or indicated in the GDR, to the extent the GBR is inapplicable; or
3. differs materially from conditions shown or indicated in Contract Documents other than the GBR or GDR, to the extent the GBR and GDR are inapplicable; or
4. to the extent the GBR and GDR are inapplicable, is of such a nature as to establish that any Technical Data on which Contractor is entitled to rely as provided in Paragraph 5.03 is materially inaccurate; or
5. to the extent the GBR and GDR are inapplicable, is of such a nature as to require a change in the Drawings or Specifications; or
6. to the extent the GBR and GDR are inapplicable, is of an unusual nature, and differs materially from conditions ordinarily encountered and generally recognized as inherent in work of the character provided for in the Contract Documents;

then Contractor shall, promptly after becoming aware thereof and before further disturbing the subsurface conditions or performing any Work in connection therewith (except in an emergency as required by Paragraph 7.15), notify Owner and Engineer in writing about such condition. Contractor shall not further disturb such condition or perform any Work in connection therewith (except with respect to an emergency) until receipt of a written statement permitting Contractor to do so.

- B. *Engineer's Review:* After receipt of written notice as required by the preceding paragraph, Engineer will promptly review the subsurface or physical condition in question; determine the necessity of Owner's obtaining additional exploration or tests with respect to the condition; conclude whether the condition falls within any one or more of the differing site condition categories in Paragraph SC-5.04.A above; obtain any pertinent cost or schedule information from Contractor; prepare recommendations to Owner regarding the Contractor's resumption or continuation of Work in connection with the subsurface or

physical condition in question and the need for any change in the Drawings or Specifications; and advise Owner in writing of Engineer's findings, conclusions, and recommendations.

- C. *Owner's Statement to Contractor Regarding Site Condition:* After receipt of Engineer's written findings, conclusions, and recommendations, Owner shall issue a written statement to Contractor (with a copy to Engineer) regarding the subsurface or physical condition in question, addressing the resumption or continuation of Work in connection with such condition, indicating whether any change in the Drawings or Specifications will be made, and adopting or rejecting Engineer's written findings, conclusions, and recommendations, in whole or in part.
- D. *Early Resumption of Work:* If at any time Engineer determines that Work in connection with the subsurface or physical condition in question may resume prior to completion of Engineer's review or Owner's issuance of its statement to Contractor, because the condition in question has been adequately documented, and analyzed on a preliminary basis, then the Engineer may at its discretion instruct Contractor to resume such Work.
- E. *Possible Price and Times Adjustments*
 - 1. Contractor shall be entitled to an equitable adjustment in Contract Price or Contract Times, to the extent that the existence of a differing subsurface or physical condition, or any related delay, disruption, or interference, causes an increase or decrease in Contractor's cost of, or time required for, performance of the Work; subject, however, to the following:
 - a. such condition must fall within any one or more of the categories described in Paragraph SC-5.04.A;
 - b. with respect to Work that is paid for on a unit price basis, any adjustment in Contract Price will be subject to the provisions of Paragraph 13.03 of the General Conditions; and
 - c. Contractor's entitlement to an adjustment of the Contract Times is subject to the provisions of Paragraphs 4.05.D and 4.05.E.
 - 2. Contractor shall not be entitled to any adjustment in the Contract Price or Contract Times with respect to a subsurface or physical condition if:
 - a. Contractor knew of the existence of such condition at the time Contractor made a commitment to Owner with respect to Contract Price and Contract Times by the submission of a Bid or becoming bound under a negotiated contract, or otherwise; or
 - b. the existence of such condition reasonably could have been discovered or revealed as a result of any examination, investigation, exploration, test, or study of the Site and contiguous areas expressly required by the Bidding Requirements or Contract Documents to be conducted by or for Contractor prior to Contractor's making such commitment; or
 - c. Contractor failed to give the written notice as required by Paragraph SC-5.04.A.

Exhibit C—Geotechnical Baseline Report Supplement to the Supplementary Conditions.

EJCDC® C-800, Supplementary Conditions of the Construction Contract.

Copyright® 2018 National Society of Professional Engineers, American Council of Engineering Companies, and American Society of Civil Engineers. All rights reserved.

Modified to include RD edits from RUS Bulletin 1780-26 (5/24/2023).

3. If Owner and Contractor agree regarding Contractor's entitlement to and the amount or extent of any adjustment in the Contract Price or Contract Times, then any such adjustment must be set forth in a Change Order.
4. Contractor may submit a Change Proposal regarding its entitlement to or the amount or extent of any adjustment in the Contract Price or Contract Times, no later than 30 days after Owner's issuance of the Owner's written statement to Contractor regarding the subsurface or physical condition in question.

F. *Underground Facilities; Hazardous Environmental Conditions:* Paragraph 5.05 of the General Conditions governs rights and responsibilities regarding the presence or location of Underground Facilities. Paragraph 5.06 of the General Conditions governs rights and responsibilities regarding Hazardous Environmental Conditions. The provisions of Paragraphs SC-5.03 and SC-5.04 are not applicable to the presence or location of Underground Facilities, or to Hazardous Environmental Conditions.

WORK CHANGE DIRECTIVE NO.: [Number of Work Change Directive]

Owner: Tuscarora Township Owner's Project No.:
Engineer: Performance Engineers, Inc. Engineer's Project No.: 22-5797-A
Contractor: Contractor's Project No.:
Project: Tuscarora Township Sewer Extension Phase I - Gravity
Contract Name: Tuscarora Township Sewer Extension Phase I - Gravity
Date Issued: Effective Date of Work Change Directive:

Contractor is directed to proceed promptly with the following change(s):

Description:

[Description of the change to the Work]

Attachments:

[List documents related to the change to the Work]

Purpose for the Work Change Directive:

[Describe the purpose for the change to the Work]

Directive to proceed promptly with the Work described herein, prior to agreeing to change in Contract Price and Contract Time, is issued due to:

Notes to User—Check one or both of the following

Non-agreement on pricing of proposed change. Necessity to proceed for schedule or other reasons.

Estimated Change in Contract Price and Contract Times (non-binding, preliminary):

Contract Price: \$ [increase] [decrease] [not yet estimated].

Contract Time: days [increase] [decrease] [not yet estimated].

Basis of estimated change in Contract Price:

Lump Sum Unit Price Cost of the Work Other

Recommended by Engineer

Authorized by Owner

By:

Title:

Date:

CHANGE ORDER NO.: [Number of Change Order]

Owner:	Tuscarora Township	Owner's Project No.:
Engineer:	Performance Engineers, Inc.	Engineer's Project No.: 22-5797-A
Contractor:		Contractor's Project No.:
Project:	Tuscarora Township Sewer Extension Phase I - Gravity	
Contract Name:	Tuscarora Township Sewer Extension Phase I - Gravity	
Date Issued:	Effective Date of Change Order:	

The Contract is modified as follows upon execution of this Change Order:

Description:

[Description of the change]

Attachments:

[List documents related to the change]

Change in Contract Times
[State Contract Times as either a specific date or a number of days]

Change in Contract Price	Change in Contract Times [State Contract Times as either a specific date or a number of days]
Original Contract Price: \$ _____	Original Contract Times: Substantial Completion: _____ Ready for final payment: _____
[Increase] [Decrease] from previously approved Change Orders No. 1 to No. [Number of previous Change Order] : \$ _____	[Increase] [Decrease] from previously approved Change Orders No.1 to No. [Number of previous Change Order] : Substantial Completion: _____ Ready for final payment: _____
Contract Price prior to this Change Order: \$ _____	Contract Times prior to this Change Order: Substantial Completion: _____ Ready for final payment: _____
[Increase] [Decrease] this Change Order: \$ _____	[Increase] [Decrease] this Change Order: Substantial Completion: _____ Ready for final payment: _____
Contract Price incorporating this Change Order: \$ _____	Contract Times with all approved Change Orders: Substantial Completion: _____ Ready for final payment: _____

Recommended by Engineer (if required)

Accepted by Contractor

By: _____	_____
Title: _____	_____
Date: _____	_____
Authorized by Owner	Approved by Funding Agency (if applicable)
By: _____	_____
Title: _____	_____
Date: _____	_____

FIELD ORDER NO.: [Number of Field Order]

Owner: Tuscarora Township Owner's Project No.:
Engineer: Performance Engineers, Inc. Engineer's Project No.: 22-5797-A
Contractor: Contractor's Project No.:
Project: Tuscarora Township Sewer Extension Phase I - Gravity
Contract Name: Tuscarora Township Sewer Extension Phase I - Gravity
Date Issued: Effective Date of Field Order:

Contractor is hereby directed to promptly perform the Work described in this Field Order, issued in accordance with Paragraph 11.04 of the General Conditions, for minor changes in the Work without changes in Contract Price or Contract Times. If Contractor considers that a change in Contract Price or Contract Times is required, submit a Change Proposal before proceeding with this Work.

Reference:

Specification Section(s):

Drawing(s) / Details (s):

Description:

[Description of the change to the Work]

Attachments:

[List documents supporting change]

Issued by Engineer

By:

Title:

Date:

CERTIFICATE OF OWNER'S ATTORNEY AND AGENCY CONCURRENCE

Notes to User: This exhibit consists of two certificates, on a single page, to be attached to the Contract and signed upon execution. The first is a certificate to be signed by the Owner's attorney and the second is the concurrence to be signed by the State Engineer. This page is to be inserted after the Agreement between Owner and Contractor for Construction Contract (Stipulated Price) (EJCDC C-520, 2018) in the Construction Contract Documents.

CERTIFICATE OF OWNER'S ATTORNEY

PROJECT NAME:

CONTRACTOR NAME AND CONTRACT NUMBER: _____

I, the undersigned, _____, the duly authorized and acting legal representative of _____, do hereby certify as follows: I have examined the attached Contract(s) and performance and payment bond(s) and the manner of execution thereof, and I am of the opinion that each of the aforesaid agreements is adequate and has been duly executed by the proper parties thereto acting through their duly authorized representatives; that said representatives have full power and authority to execute said agreements on behalf of the respective parties named thereon; and that the foregoing agreements constitute valid and legally binding obligations upon the parties executing the same in accordance with the terms, conditions, and provisions thereof.

Name

Date

AGENCY CONCURRENCE

As lender or insurer of funds to defray the costs of this Contract, and without liability for any payments thereunder, the Agency hereby concurs in the form, content, and execution of this Agreement.

Agency Representative

Date

Name

This statement relates to a proposed contract with _____

(Name of borrower or grantee)

who expects to finance the contract with assistance from either the Rural Housing Service (RHS), Rural Business-Cooperative Service (RBS), or the Rural Utilities Service (RUS) or their successor agencies, United States Department of Agriculture (whether by a loan, grant, loan insurance, guarantee, or other form of financial assistance). I am the undersigned bidder or prospective contractor, I represent that:

1. I have have not, participated in a previous contract or subcontract subject to Executive 11246 (regarding equal employment opportunity) or a preceding similar Executive Order.
2. If I have participated in such a contract or subcontract, I have, have not, filed all compliance reports that have been required to file in connection with the contract or subcontract.
 If the proposed contract is for \$50,000 or more: or if the proposed nonconstruction contract is for \$50,000 or more and I have 50 or more employees, I also represent that:
3. I have, have not previously had contracts subject to the written affirmative action programs requirements of the Secretary of Labor.
4. If I have participated in such a contract or subcontract, I have, have not developed and placed on file at each establishment affirmative action programs as required by the rules and regulations of the Secretary of Labor.

I understand that if I have failed to file any compliance reports that have been required of me, I am not eligible and will not be eligible to have my bid considered or to enter into the proposed contract unless and until I make an arrangement regarding such reports that is satisfactory to either the RHS, RBS or RUS, or to the office where the reports are required to be filed.

I also certify that I do not maintain or provide for my employees any segregated facilities at any of my establishments, and that I do not permit my employees to perform their services at any location, under my control, where segregated facilities are maintained. I certify further that I will not maintain or provide for my employees any segregated facilities at any of my establishments, and that I will not permit my employees to perform their services at any location, under my control, where segregated facilities are maintained. I agree that a breach of this certification is a violation of the Equal Opportunity clause in my contract. As used in this certification, the term "segregated facilities" means any waiting rooms, work areas, restrooms and wash rooms, restaurants and other eating areas time clocks, locker rooms and other storage or dressing areas, parking lots, drinking fountains, recreation or entertainment areas, transportation, and housing facilities provided for employees which are segregated by explicit directive or are in fact segregated on the basis of race, creed, color, or national origin, because of habit, local custom, or otherwise. I further agree that (except where I have obtained identical certifications for proposed subcontractors for specific time periods) I will obtain identical certifications from proposed subcontractors prior to the award of subcontracts exceeding \$10,000 which are not exempt from the provisions of the Equal Opportunity clause; that I will retain such certifications in my files; and that I will forward the following notice to such proposed subcontractors (except where the proposed subcontractors have submitted identical certifications for specific time periods):

A federal agency may not conduct or sponsor, and a person is not required to respond to, nor shall a person be subject to a penalty for failure to comply with a collection of information subject to the requirements of the Paperwork Reduction Act unless that collection of information displays a currently valid OMB Control Number. The OMB Control Number for this information collection is 0575-0018. Public reporting for this collection of information is estimated to be approximately 10 minutes per response, including the time for reviewing instructions, searching existing data sources, gathering and maintaining the data needed, completing and reviewing the collection of information. All responses to this collection of information are voluntary. However, in order to obtain or retain a benefit, the information in this form is required 7 CFR 1901-E. Rural Development has no plans to publish information collected under the provisions of this program. Send comments regarding this burden estimate or any other aspect of this collection of information, including suggestions for reducing this burden to: Information Collection Clearance Officer, Rural Development Innovation Center, Regulations Management Division at ICRMTRRequests@usda.gov.



Certification Regarding Debarment, Suspension, Ineligibility and Voluntary Exclusion Lower Tier Covered Transactions

The following statement is made in accordance with the Privacy Act of 1974 (5 U.S.C. § 552a, as amended). This certification is required by the regulations implementing Executive Order 12549, Debarment and Suspension, and 2 CFR §§ 180.300, 180.335. Participants' responsibilities. The regulations were amended and published on August 31, 2005, in 70 Fed. Reg. 51865-51880. Copies of the regulations may be obtained by contacting the Department of Agriculture agency offering the proposed covered transaction.

According to the Paperwork Reduction Act of 1995, an agency may not conduct or sponsor, and a person is not required to respond to a collection of information unless it displays a valid OMB control number. The valid OMB control number for this information collection is 0505-0027. The time required to complete this information collection is estimated to average 15 minutes per response, including the time for reviewing instructions, searching existing data sources, gathering and maintaining the data needed, and completing and reviewing the collection of information. The provisions of appropriate criminal or civil fraud, privacy, and other statutes may be applicable to the information provided.

(Read instructions on page two before completing certification.)

- A. The prospective lower tier participant certifies, by submission of this proposal, that neither it nor its principals is presently debarred, suspended, proposed for debarment, declared ineligible, or voluntarily excluded from participation in this transaction by any Federal department or agency;
- B. Where the prospective lower tier participant is unable to certify to any of the statements in this certification, such prospective participant shall attach an explanation to this proposal.

ORGANIZATION NAME	PR/AWARD NUMBER OR PROJECT NAME
NAME(S) AND TITLE(S) OF AUTHORIZED REPRESENTATIVE(S)	
SIGNATURE	DATE

In accordance with Federal civil rights law and U.S. Department of Agriculture (USDA) civil rights regulations and policies, the USDA, its Agencies, offices, and employees, and institutions participating in or administering USDA programs are prohibited from discriminating based on race, color, national origin, religion, sex, gender identity (including gender expression), sexual orientation, disability, age, marital status, family/parental status, income derived from a public assistance program, political beliefs, or reprisal or retaliation for prior civil rights activity, in any program or activity conducted or funded by USDA (not all bases apply to all programs). Remedies and complaint filing deadlines vary by program or incident.

Persons with disabilities who require alternative means of communication for program information (e.g., Braille, large print, audiotape, American Sign Language, etc.) should contact the responsible Agency or USDA's TARGET Center at (202) 720-2600 (voice and TTY) or contact USDA through the Federal Relay Service at (800) 877-8339. Additionally, program information may be made available in languages other than English.

To file a program discrimination complaint, complete the USDA Program Discrimination Complaint Form, AD-3027, found online at [How to File a Program Discrimination Complaint](#) and at any USDA office or write a letter addressed to USDA and provide in the letter all of the information requested in the form. To request a copy of the complaint form, call (866) 632-9992. Submit your completed form or letter to USDA by: (1) mail: U.S. Department of Agriculture, Office of the Assistant Secretary for Civil Rights, 1400 Independence Avenue, SW, Washington, D.C. 20250-9410; (2) fax: (202) 690-7442; or (3) email: program.intake@usda.gov.

USDA is an equal opportunity provider, employer, and lender.

Instructions for Certification

- (1) By signing and submitting this form, the prospective lower tier participant is providing the certification set out on page 1 in accordance with these instructions.
- (2) The certification in this clause is a material representation of fact upon which reliance was placed when this transaction was entered into. If it is later determined that the prospective lower tier participant knowingly rendered an erroneous certification, in addition to other remedies available to the Federal Government, the Department or agency with which this transaction originated may pursue available remedies, including suspension or debarment.
- (3) The prospective lower tier participant must provide immediate written notice to the person(s) to which this proposal is submitted if at any time the prospective lower tier participant learns that its certification was erroneous when submitted or has become erroneous by reason of changed circumstances.
- (4) The terms "covered transaction," "debarred," "suspended," "ineligible," "lower tier covered transaction," "participant," "person," "'primary covered transaction," "principal," "proposal," and "voluntarily excluded," as used in this clause, have the meanings set out in the Definitions and Coverage sections of the rules implementing Executive Order 12549, at 2 CFR Parts 180 and 417. You may contact the Department or agency to which this proposal is being submitted for assistance in obtaining a copy of those regulations.
- (5) The prospective lower tier participant agrees by submitting this form that, should the proposed covered transaction be entered into, it may not knowingly enter into any lower tier covered transaction with a person who is debarred, suspended, declared ineligible, or voluntarily excluded from participation in this covered transaction, unless authorized by the Department or agency with which this transaction originated.
- (6) The prospective lower tier participant further agrees by submitting this form that it will include this clause titled "Certification Regarding Debarment, Suspension, Ineligibility and Voluntary Exclusion - Lower Tier Covered Transactions," without modification, in all lower tier covered transactions and in all solicitations for lower tier covered transactions.
- (7) A participant in a covered transaction may rely upon a certification of a prospective participant in a lower tier covered transaction that is not debarred, suspended, ineligible, or voluntarily excluded from the covered transaction, unless it knows that the certification is erroneous. A participant may decide the method and frequency by which it determines the eligibility of its principals. Each participant may, but is not required to, check the General Services Administration's System for Award Management Exclusions database.
- (8) Nothing contained in the foregoing shall be construed to require establishment of a system of records to render in good faith the certification required by this clause. The knowledge and information of a participant is not required to exceed that which is normally possessed by a prudent person in the ordinary course of business dealings.
- (9) Except for transactions authorized under paragraph (5) of these instructions, if a participant in a covered transaction knowingly enters into a lower tier covered transaction with a person who is suspended, debarred, ineligible, or voluntarily excluded from participation in this transaction, in addition to other remedies available to the Federal Government, the Department or agency with which this transaction originated may pursue available remedies, including suspension and/or debarment.

CERTIFICATION FOR CONTRACTS, GRANTS AND LOANS

The undersigned certifies, to the best of his or her knowledge and belief, that:

1. No Federal appropriated funds have been paid or will be paid, by or on behalf of the undersigned, to any person for influencing or attempting to influence an officer or employee of any agency, a Member of Congress, an officer or employee of Congress, or an employee of a Member of Congress in connection with the awarding of any Federal contract, the making of any Federal grant or Federal loan, and the extension, continuation, renewal, amendment, or modification of any Federal contract, grant or loan.
2. If any funds other than Federal appropriated funds have been paid or will be paid to any person for influencing or attempting to influence an officer or employee of any agency, a Member of Congress, an officer or employee of Congress, or an employee of a Member of Congress in connection with this Federal contract, grant or loan, the undersigned shall complete and submit Standard Form - LLL, "Disclosure of Lobbying Activities," in accordance with its instructions.
3. The undersigned shall require that the language of this certification be included in the award documents for all subawards at all tiers (including contracts, subcontracts, and subgrants under grants and loans) and that all subrecipients shall certify and disclose accordingly.

This certification is a material representation of fact upon which reliance was placed when this transaction was made or entered into. Submission of this certification is a prerequisite for making or entering into this transaction imposed by section 1352, title 31, U.S. Code. Any person who fails to file the required certification shall be subject to a civil penalty of not less than \$10,000 and not more than \$100,000 for each such failure.

(name)

(date)

(title)

oOo

SAMPLE LANGUAGE FOR CONTRACTOR'S
CERTIFICATION OF COMPLIANCE

Notes to User: This exhibit provides sample language that the Contractor can use to certify compliance with the Build America Buy America Act requirements. Note that the language can be modified (for example if the project is subject to AIS the BABAA reference should be replaced with language such as "American Iron and Steel (AIS) requirements mandated by Section 746 of Title VII of the Consolidated Appropriations Act of 2017 and subsequent annual appropriations for WWD programs"). A certification is to be provided by Contractor to Engineer for delivery to the Owner and Agency at Substantial Completion. The certification should be on letterhead and should be signed and dated by an authorized company representative.

Project Name
Owner / Applicant
Contract Number

I hereby certify, that to the best of my knowledge and belief, all Iron and Steel products, Manufactured Products, and Construction Materials installed for this project by my company and by any and all subcontractors and Manufacturers my company has contracted with for this project comply with the Build America, Buy America Act (BABAA) requirements under Title IX of the Infrastructure Investment and Jobs Act (IIJA), Pub. L. 117-58, §§ 70901-70953 or are the subject of a waiver approved by the Secretary of Agriculture or designee.

SAMPLE LANGUAGE FOR MANUFACTURER'S CERTIFICATION OF COMPLIANCE

Notes to User: This exhibit provides sample language for the Manufacturer's Certification of Compliance with Domestic Preference requirements. Contractor should ensure that Engineer has an approved Manufacturers' Certification prior to any domestic preference item being delivered to the project site. The Manufacturer's Certification should be on letterhead and should indicate the project, specific item being certified, reference which domestic preference requirement is being certified and be signed by an authorized company representative. The Manufacturer's Certification may include multiple domestic preference requirements. It is important for the governing domestic preference requirement (whether AIS, BABAA or other) to be clearly included within the certification.

Date:

Company Name:

Company Address:


Subject: Domestic Preference Requirement Certification for {Owner's Name and Project Name (City, State)} Certification for Project (X), Owner's Name, and Contract Number
Sample text:

I hereby certify that the following product(s) and / or material(s) shipped or provided for the subject project are in full compliance with the Build America, Buy America Act (BABAA) requirements under Title IX of the Infrastructure Investment and Jobs Act (IIJA), Pub. L. 117-58, §§ 70901-70953.

[List common name of items, products and/or materials]

TEMPORARY CONSTRUCTION SIGN FOR RURAL DEVELOPMENT PROJECTS

Recommended Fonts: Helvetica or Arial

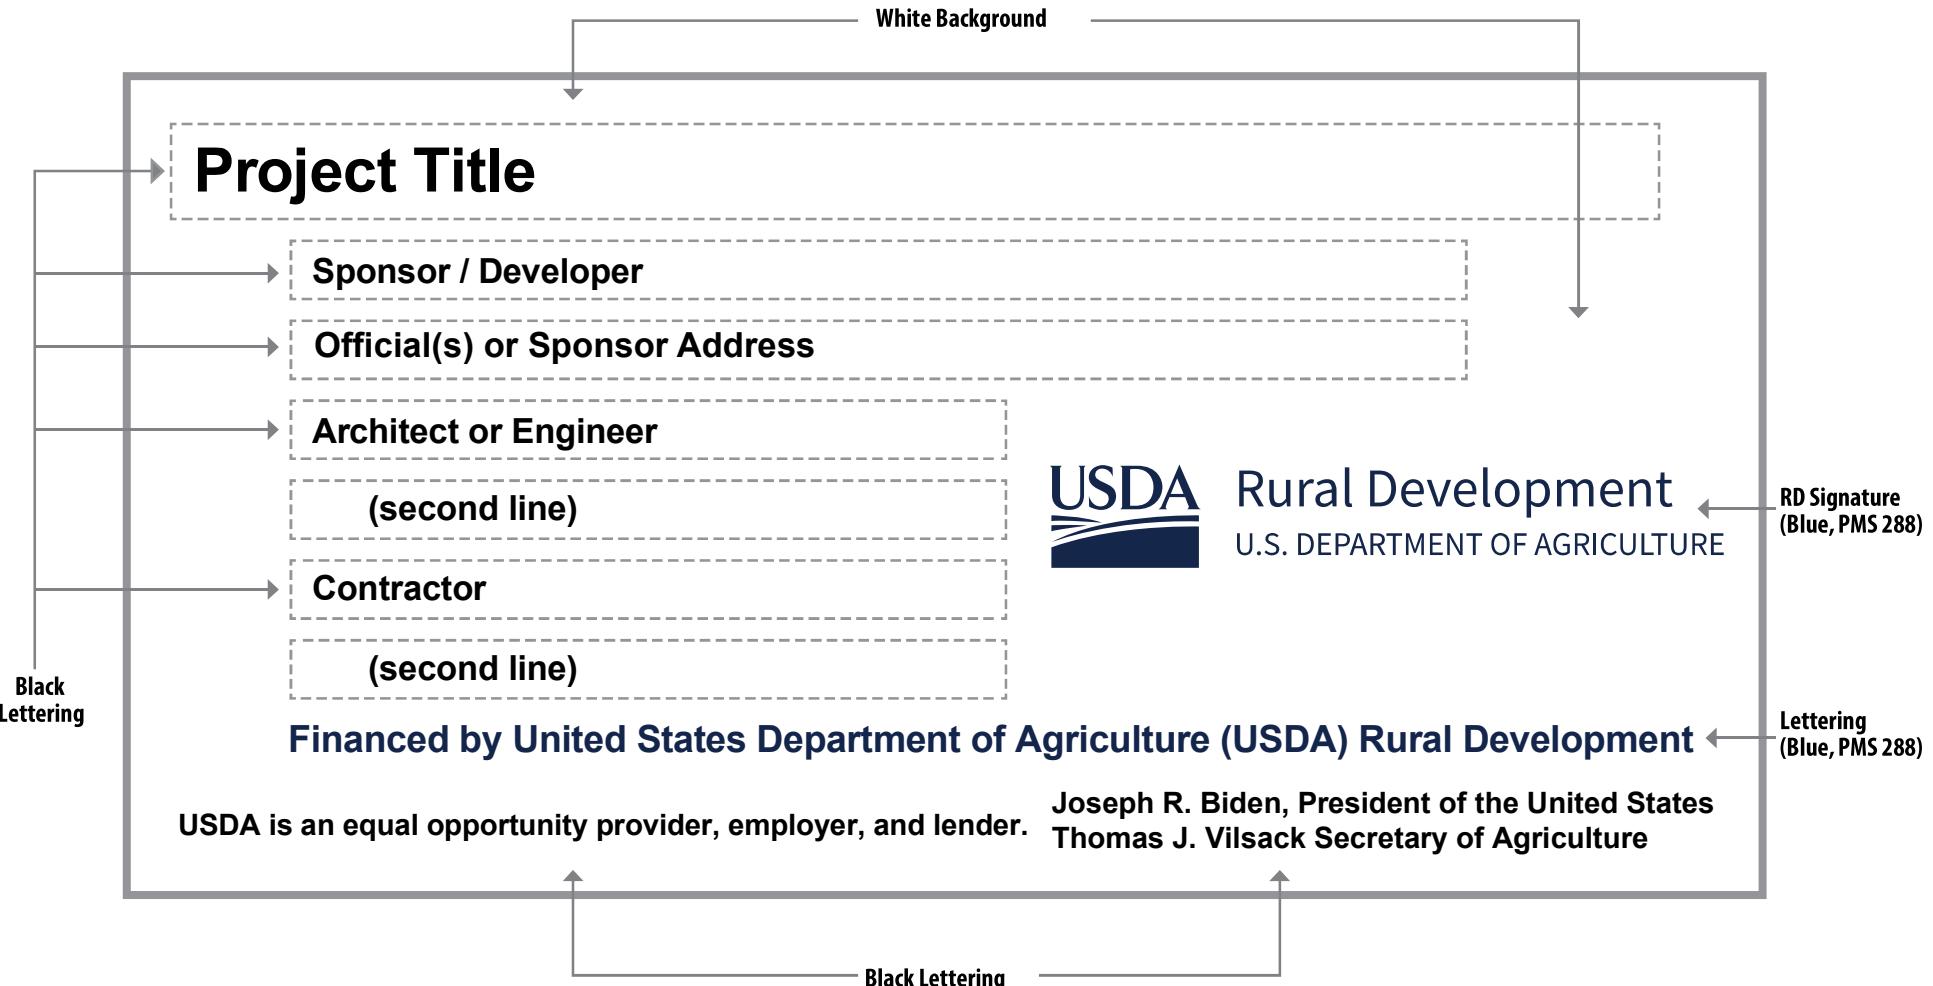

SIGN DIMENSIONS : 1200 mm x 2400 mm x 19 mm (approx. 4' x 8' x 3/4")
PLYWOOD PANEL (APA RATED A-B GRADE-EXTERIOR)

TUSCARORA TOWNSHIP

STANDARD SPECIFICATIONS

TABLE OF CONTENTS

- SECTION 1 - GENERAL REQUIREMENTS
- SECTION 2 - STANDARDS & REGULATIONS
- SECTION 3 - PROJECT CLOSEOUT
- SECTION 4 - EXCAVATING, TRENCHING, & BACKFILL
- SECTION 5 - CONCRETE WORK
- SECTION 6 - SANITARY SEWER MAIN
- SECTION 7 - SANITARY SEWER APPURTENANCES
- SECTION 12 – SUBMERSIBLE SEWAGE PUMPING STATION
- SECTION 13 – REPLACEMENT AND CLEANUP

SECTION 1 – GENERAL REQUIREMENTS

1.01 PROJECT DESCRIPTION

The Project generally consists of constructing sanitary sewer piping, manholes, cleanouts, pumping stations, and appurtenances within public road rights-of-way. The construction requires demolition and removal of surface structures, excavation, dewatering, construction, and restoration activities, the standards and specifications for which are provided herein.

1.02 DEFINITIONS

The intent of this section is to identify certain persons involved in the project.

DPW	The agency, group, or groups designated by the Authority performing the system operations and maintenance typically identified as a Department of Public Works.
Owner or Authority	Tuscarora Township
Authority or Owner's Engineer	Engineer whose services are procured by the Authority to review sanitary sewage system plans and installation methods. When the authority is the owner, the engineer will function as the owner's engineer.
Contractor	Contractor is prime Contractor who is so identified by the Owner and is responsible for the sanitary sewage system facilities installation.

1.03 PRECONSTRUCTION CONFERENCE

Prior to commencement of any construction activities involving the sanitary sewer system, a principal member representing the Owner, the Contractor, the Engineer, and the Authority DPW shall meet at a pre-determined location and time to discuss the project. It shall be the responsibility of the Owner or the Engineer to organize this meeting. At that time, the Contractor schedule, as well as the construction requirements, will be discussed to obtain a mutual understanding of the project and the Authority's inspection process.

1.04 LINES AND GRADES FOR CONSTRUCTION

The Owner (his Contractor and/or Engineer) shall provide adequate lines and grades for construction of the sanitary sewer prior to installing the utilities. The Engineer shall be given **48 hours notice** for review of these lines and grades prior to the start of construction.

1.05 PROGRESS SCHEDULE

The Contractor shall, as soon as practical, prepare and submit to the Engineer three (3) copies of the Progress Schedule regarding sanitary sewer construction. This schedule shall show in a clear, graphical manner the proposed date for commencement, progress and completion of the work.

1.06 INTERFERENCE WITH EXISTING SEWAGE TREATMENT WORKS

No bypassing of untreated sewage will be allowed during the construction of this project other than that which normally takes place due to stormwater overflows, etc. The Contractor shall provide a plan of work to the Engineer for approval before starting work on any phases of the project which might involve existing sewage facilities.

1.07 RELATIONS TO OTHER CONTRACTORS AND UTILITY FORCES

The Contractor shall so conduct his operations as not to interfere with or injure the work of other contractors or adjacent force account work, and he shall promptly make good any injury or damage which may be done to such work by him or his employees or agents. The Contractor shall grant to other contractors and forces necessary means of access to their work.

1.08 PERMITTING AGENCIES

The Contractor shall perform all work in accordance with any and all applicable permit requirements. The Authority, with the assistance of the Authority Engineer, will obtain the necessary permit for construction/installation prior to commencement of any work.

1.09 ACCESS TO WORK

The Engineer or Resident Project Representative shall have access maintained to all sanitary sewer work at all times. Proper notification (**48 hours**) shall be given to the Authority Engineer prior to the start of any construction or testing.

1.10 SHOP DRAWINGS

Shop drawings of all equipment shall be issued to the Engineer during the shop drawing review stage for his approval. The Authority Engineer shall review the shop drawings regarding compliance with the Authority requirements. The Contractor should supply a minimum of six (6) copies of all equipment shop drawings to the Engineer. Final record shop drawings shall be issued to the Authority Engineer as part of the close-out procedure in accordance with the close-out section of these specifications.

1.11 STREAM CROSSINGS

Stream crossings shall be performed in accordance with all permit requirements of the regulatory agencies (P.A. 451 requirements).

1.12 **DUST AND NOISE REDUCTION**

The Contractor shall keep dust and noise from construction operations to a minimum. A dust palliative shall be used on disturbed road sections prior to surfacing if so determined by the Authority Engineer.

1.13 **MATERIAL CERTIFICATION**

Manufacturer's certification slips shall be submitted to the Authority Engineer for all pipe, manholes, fittings, etc. used in the installation of sanitary sewer or watermains. This is to verify that the product meets applicable standard specifications required.

1.14 **MAINTENANCE BOND REQUIREMENTS**

The Contractor shall supply the Owner with a maintenance bond for the full cost of the installation of the sanitary sewer system that is to be turned over to the Authority. The maintenance bond shall be effective from the date of substantial completion for a period of one (1) year.

1.15 **INSURANCE REQUIREMENTS**

Where the contract involves construction in a public right-of-way, the Contractor shall provide proof of insurance in the type and amounts required by the Authority prior to start of the construction. In addition to the Authority, the Authority Engineer shall be named as additional insured.

SECTION 2 – STANDARDS AND REGULATIONS

2.01 REFERENCE STANDARDS

- A. Throughout these specifications, reference is made to various standard specifications. Such reference gives the serial designation. The latest revised specification shall apply in all cases. These standard specifications, where applicable, shall be binding on all construction activities.
- B. The following specifications and standards form part of this specification to the extent indicated by reference thereto or for quality of workmanship and materials required under the contract.

American Society of Testing Materials	(ASTM)
American Water Works Association	(AWWA)
American National Standards Institute, Inc.	(ANSI)
Michigan Department of Transportation	(MDOT)
American Concrete Institute	(ACI)
National Concrete Masonry Association	(NCMA)
Truss Plate Institute	(TPI)
National Electrical Code	(NEC)
Michigan Department of Environment, Great Lakes, and Energy	(EGLE)

2.02 REGULATORY REQUIREMENTS

- A. All construction work, alterations, repairs or mechanical installations and appliances connected herewith shall comply with all the State Rules and Regulations and local ordinances and such other statutory provisions pertaining to this class of work. Such Rules and Regulations and local ordinances are to be considered a part of these specifications by reference.
- B. All electrical work shall be in accordance with the latest edition of the National Electrical Code, the National Electrical Safety Code and applicable state and local codes. This shall not be construed to permit a lower grade of construction where the plans and specifications require workmanship or materials in excess of code requirements. All electrical equipment, wiring, cable, pre-assembled electrical panels, and materials shall be listed by Underwriters Laboratories, Inc.

SECTION 3 – PROJECT CLOSE OUT

3.01 CLEANUP

Before final acceptance of the sanitary sewer system work, the Contractor shall remove all false work, excavated or useless materials, and rubbish, and restore to presentable condition per the restoration specifications and satisfactory to the Authority Engineer, all property, both public and private, which may have been used or damaged during the prosecution of the sanitary sewer system work.

3.02 OPERATING AND MAINTENANCE DATA

The Contractor shall furnish written instructions for the operation and maintenance of all equipment provided at the time of shop drawing submittal. The instructions shall be short, easy to understand, with directions specifically written for this project, describing the various possible methods of operating the equipment. The instructions shall include procedures for tests required, adjustments to be made and safety precautions to be taken with the equipment. Maintenance instructions shall include test and calibration charts, exploded views of assembled components and spare parts lists. At least three (3) instruction booklets shall be furnished for each separate piece of equipment. These shall be transmitted to the Engineer as part of the close out of the project. Record drawings (1 hard copy and digital file) shall be submitted to the Authority along with drilling logs, manhole reports, and sanitary sewer lead reports as applicable to the project.

A. Pumps

Include the manufacturer's technical specification of the pump along with the application for the pump, the manufacturer's warranty certificate, installation instructions, serial numbers for all pumps, pump performance curve, pump trouble shooting guide and the pump efficiency rating.

B. Control Panel Operation and Maintenance Manual

Include the electrical panel legend, bill of material report, catalog cut sheets indicating make and model of all general accessories, installation instructions for the control panel, recommended spare parts, installation instructions for general accessories and a maintenance frequency chart.

C. Electrical Wiring

A color coded drawing of the as-installed electrical schematic shall be submitted for all electrical work performed as part of the project.

3.03 GUARANTEE

The Contractor shall guarantee all materials and equipment furnished and work performed for a period of one (1) year from the date of substantial completion. The Contractor shall warrant and guarantee for a period of one (1) year from the date of substantial completion of the system that the completed system is free from all defects due to faulty materials or workmanship. The Contractor shall promptly make such corrections as may be necessary including the repairs of any damage to other parts of the system resulting from such defects. The Owner will give notice of observed defects with reasonable promptness. In the event that the Contractor should fail to make such repairs, adjustments or other work that may be made necessary by such defects, the Owner may do so and charge the Contractor the cost thereby incurred.

3.04 FINAL COMPLETION/ACCEPTANCE OF PROJECT BY AUTHORITY

A. Authority Projects

Final payment will not be made to the Contractor until all closeout documents have been received and approved by the Authority Engineer. These items are listed below:

1. Punch list items satisfactorily completed.
2. Maintenance bond.
3. Letter of guarantee (prepared by Authority Engineer).
4. Affidavit of completion/consent of surety.
5. Sanitary Sewer Lead Reports (as applicable).
6. Record Drawings: Record drawings shall consist of plan and profile. Sanitary sewer leads and/or water service leads shall be re-drawn in the new location along with the mainline structures and piping when deviated from plan location. Manhole numbering sequences shall be obtained from the Authority Engineer. Each structure installed, manhole, sewer lead or other structures placed shall have 3 physical measurements from structures which are shown on the plans and apparently not to be changed. These measurements must be incorporated onto the record drawings except sewer leads. (Lead measurements are to be placed on the individual reports). Sanitary sewer profiles shall include rim and invert elevations, distances between structures, size and type of pipe. All profiles shall show conflict with existing utilities. Sanitary sewer lead information shall be placed in a table format on the record drawings. Each plan sheet shall have a table for the leads shown on that sheet. See Table 3.1 for an example.

Table 3.1

SEWER LEAD NUMBER	DISTANCE FROM DOWNSTREAM MANHOLE	DISTANCE FROM SEWER TO END OF LEAT AT PROPERTY LINE OR EASEMENT LINE	DEPTH BELOW GRADE

7. Operations and maintenance manuals.

SECTION 4 – EXCAVATING, TRENCHING AND BACKFILLING

4.01 SCOPE OF WORK

The work covered by this section shall consist of furnishing all materials, equipment and labor for the excavating, trenching, backfilling, and bore and jack required to install or repair sanitary sewers, and other structures as shown on the plans and referred to in these specifications.

4.02 MATERIALS

A. Backfill Material

All backfill material shall be free from cinders, ashes, refuse, sod, frozen lumps, vegetable or organic material, boulders, rocks or stones or other material which, in the opinion of the Engineer, is unsuitable. Pipe bedding material shall meet an MDOT Class II gradation, modified for not greater than $\frac{3}{4}$ " stone. However, from one foot above the top of the pipe to the subgrade of the pavement, material containing stones up to three (3) inches in their greatest dimension may be used.

Where the type of backfill material is not specified, the Contractor may backfill with the excavated material provided that such material meets the requirements described above. Where excavated material is to be used for backfill and there is a deficiency due to a rejection of part thereof, the Contractor shall furnish the required amount of sand, gravel or other approved material at no additional cost.

B. Bore and Jack Materials

1. Steel Pipe

Jacked in place steel pipe shall meet the requirements of either ASTM A53, Type E or S, Grade B or ASTM A139, Grade B.

The ends of all steel pipe to be jacked shall be prepared for field welding at joints.

The nominal outside diameter and minimum wall thicknesses of steel pipe to be jacked in place shall be as shown below. Minimum wall thickness for railroad crossings may be reduced by 0.063 inch if cathodic protection is provided per railroad specifications.

Nominal Size	Outside Diameter (Inches)	Minimum Wall Thickness Required (Inches)	
		M.D.O.T.	Railroads
2"	2.375	0.154	0.251
2"	4.500	0.188	0.251
6"	6.625	0.188	0.251
8"	8.625	0.188	0.251
10"	10.750	0.188	0.251
12"	12.750	0.188	0.251
14"	14.000	0.250	0.282
16"	16.000	0.250	0.282
18"	18.000	0.250	0.313
20"	20.000	0.250	0.344
22"	22.000	0.250	0.375
24"	24.000	0.250	0.407
26"	26.000	0.312	0.438
28"	28.000	0.312	0.469
30"	30.000	0.312	0.469
34"	34.000	0.312	0.532

2. Grout

Grout shall consist of a mixture of Portland cement and sand in any proportion which does not have more than 50 percent sand by volume.

4.03 EXECUTION

A. Excavation

Excavation includes clearing the site of the proposed work and removal of all materials to a depth which is sufficient to permit the construction of the structure or utility in accordance with the plans. Excavated materials may be temporarily stored along the trench in a manner that will not cause damage to trees, shrubbery, or other properties and that will not endanger the banks of the trench by imposing too great a load thereon.

B. Length and Width of Trench

Not more than 200 feet of open trench will be permitted at a time without approval from the Authority Engineer, unless pedestrian bridges are maintained at 200 foot intervals and vehicular crossings of at least one lane are maintained at 300 foot intervals.

Streets shall not be completely blocked without written permission from the Engineer and roadway officials. All fire alarm boxes and fire hydrants must be kept clear and accessible at all times.

The width of the trench shall be ample to permit the pipe to be laid and joined properly and the backfill to be placed and compacted as specified.

In order to limit excessive loads on the pipe, the maximum width of trench shall not be more than two feet greater than the nominal inside diameter of the pipe. This limitation shall apply to the width of the trench at the top of the pipe. Trenches shall be of such extra width, when required, as will permit the convenient placing of timber supports, sheeting and bracing and handling of special conditions.

C. Bracing, Sheeting and Shoring

Open cut trenches shall be sheeted and braced as required by any governing federal or state laws and municipal ordinances and as may be necessary to protect life, property or the work. All bracing, sheeting, and shoring design, installation, and maintenance is the responsibility of the Contractor. The specifications contained herein provide general guidance and minimum criteria, the Engineer and Owner will not provide any excavation safety design for the project.

Sheeting and bracing left in place must be removed for a depth of three (3) feet below the established finish grade or the existing surface, whichever is lower.

Trench bracing, except that which must be left in place, may be removed when the backfilling has reached the respective levels of such bracing. Sheetling, except that which has been ordered left in place, shall be removed as the backfilling progresses.

D. Pumping, Bailing and Draining

The Contractor shall provide and maintain adequate pumping and draining facilities for removal and disposal of water from trenches or other excavations in accordance with the dewatering specifications. He shall provide pumping and draining facilities for bulkheaded sewer sections and shall operate same until bulkheads have been removed or construction is completed, if bulkheads are to be left in place. The drainage system must be maintained until the pipe has been covered with sufficient backfill material to prevent floating of the installed pipe sections. Where work occurs below the groundwater table, the Contractor shall provide, install and maintain a suitable dewatering system and shall so operate it to insure proper construction of the work. Proper disposal of the dewatering discharge (necessary easements, permits, erosion control, etc.) shall be the responsibility of the Contractor. Contractor shall not discharge or allow any groundwater to enter existing sanitary sewage system. Any water which does enter the existing sewage system shall be the Contractor's responsibility and he will pay any and all transporting and treatment costs involved with this water according to the local municipal authority. Cost of pumping, bailing and draining shall be included in the dewatering pay item.

E. Excavation to Grade

The trench shall be excavated to the depth required to provide a uniform and continuous bearing and support for the pipe barrel on solid and undisturbed ground. The Contractor shall excavate the last four inches of depth to grade using hand tools.

Any part of the bottom of the trench excavated below the specified grade shall be refilled with approved materials and thoroughly compacted to a minimum of 95% of the maximum dry density as determined by ASTM D698 or the Michigan Cone Method. The finished subgrade shall be prepared accurately by means of hand tools. Blocking to bring the pipe to grade will not be permitted. Bell holes in the subgrade must be provided to allow for continuous support of the pipe barrel when bell type pipe is used.

If, in the opinion of the Engineer, subgrade pipe support conditions at some locations are found to be unsatisfactory, he shall have the authority to order subgrade preparation at these locations in accordance with the provisions for special foundations in clay, rock or poor soils.

F. Special Foundation in Clay or Rock

Subgrade consisting of clay or rock shall be excavated to at least four inches and not more than six (6) inches below the specified grade. Before the pipe is laid, the subgrade shall be prepared by backfilling with an approved granular material in three-inch compacted layers. The layers shall be thoroughly tamped as directed by the Engineer so as to provide a uniform and continuous bearing and support for the pipe barrel with a minimum compaction of 95% of the herein defined maximum dry density. The Contractor will not be allowed extra compensation for this work.

G. Special Foundations in Poor Soils

Where the bottom of the trench at subgrade is found to consist of unstable material which will, in the opinion of the Engineer, not provide adequate pipe support, the Engineer shall have authority to require the removal of the unstable material and replacement with approved backfill material. The use of stone bedding by the Contractor to reduce dewatering requirements will not be paid as an extra.

H. Backfilling around Pipes

From the bottom of the trench to a depth of one (1) foot above the top of the pipe, the trench shall be backfilled by hand with sand or approved excavated materials and tamped to a minimum of 95% of the herein defined maximum dry density.

The Contractor shall take care in placing this portion of the backfill so as to make sure sufficient material has been worked under the pipe and also avoid injuring or moving the pipe. Backfilling around PVC pipe shall be done in accordance with ASTM D2321 "Standard Recommended Practice for Underground Installation of Flexible Thermoplastic Sewer Pipe".

I. Backfilling to Natural Grade

From one (1) foot above the pipe to the grade shown on the drawing or specified herein, the trench shall be backfilled by mechanical methods approved by the Engineer. A minimum compaction of 85% of maximum unit weight is required, unless otherwise noted.

Provide 30 inches of cover above the top of the pipe before application of wheel loading and 48 inches before use of heavy compactors.

J. Backfill under Structures

Where the excavation is made through or under existing or proposed pavement, curb, shoulders, driveways or sidewalks or where such structures are undercut by the excavation or where noted on the plans, the entire backfill to the subgrade of the structure shall be made with granular material. The granular material backfill shall be placed in layers and compacted to 95% of the herein defined maximum dry density throughout. This requirement shall apply to- any trench that is within a one-on-three slope beneath the road from the shoulder point or back of curb line. Extra compensation will not be allowed for this work.

Granular material is defined as a material meeting granular material Class II as defined in M.D.O.T. Standard Specifications.

K. Special Backfilling Requirements

The Contractor will be required to comply with the regulations of the State Highway, Municipal or County Road Engineering Departments with regard to backfilling in their respective rights-of-way and beneath the roads, and shall be responsible for determining these regulations prior to bidding.

L. Compaction Testing

Compaction testing may be periodically performed by a source and method approved by the Authority Engineer to ensure that compaction requirements are being met. Compaction percentage is based on the maximum dry density as determined by ASTM 01557 or the Michigan Cone Method.

M. Boring and Jacking

The following provisions apply to the construction of sewers, forcemains, and house leads which cross pavements under the control of the Michigan Department of Transportation, County Road Commission, or under railroads.

1. General

Steel pipes shall be jacked in place under highways as specified in the current standards published by the Michigan Department of Transportation. Pipe jacked in place under railroads shall meet the current standards established by the

affected railroad. The Design Engineer shall incorporate bore and jack requirements into the contract documents. After the pipe has been installed in the steel casing pipe, the casing pipe shall be pressure grouted with an M.D.O.T. approved flowable fill or blown full of pea stone and the ends sealed with concrete.

2. Location of Jacking Pits:

a. State Highways

The minimum distance of the jacking pit to the edge of pavement will be specified by the M.D.O.T. and placed on the plans or contract documents by the Engineer.

b. County Roads

On all highways, a minimum distance of 15 feet shall be provided from edge of pavement to the face of boring pts. Any variances from these distances will require tight sheeting and if a traffic hazard, permanent guard rail will be required.

c. Railroads

The location of the jacking pit will be specified by the Railroad and/or the Design Engineer.

3. The boring machine shall be capable of assuring a crossing with no voids.

- a. In solid clay soils the cutting head or the auger, if no head is used, may be allowed to within one inch of the front of the casing.
- b. In sandy soils the cutting head or the auger, if no head is used, must be inside the casing at least 1/2 the diameter of the casing.
- c. If the soil is both clay and sand, the same procedure as for sand shall apply.
- d. In wet, sandy or gravelly type soils that have a tendency to move or run, the cutting head and/or auger shall be pulled back to at least three feet from the front of the casing.
- e. When boring is used to facilitate jacking pipe in place, the minimum diameter of the lead auger section shall be 1/2 inch smaller than the inside diameter of the pipe being jacked.
- f. Trenchless pipe placement - methods such as trenchless pneumatic piercing tools utilized to perform horizontal bores must be approved by the Authority Engineer prior to its use.

SECTION 5 – CONCRETE WORK

5.01 SCOPE OF WORK

The work under this section shall include all materials, labor and equipment necessary to achieve a finished product, including but not limited to the items in these specifications and those shown on the working drawings. Work includes, but is not limited to building footings, floor slabs, sidewalks, curb and gutter, driveways, etc.

All procedures and materials under this section, where not specifically stated, shall be in accordance with standards and recommendations of the American Concrete Institute's Building Code Requirements for reinforced concrete (ACI 318 - latest edition).

5.02 MATERIALS

- A. Cement: Portland cement shall conform to "Standard Specifications for Portland Cement" (ASTM C150 latest edition) and shall be Type I, IA, III or IIIA.
- B. Aggregates: Concrete aggregates shall conform to "Standard Specifications for Concrete Aggregates" (ASTM C33 - latest edition). Maximum coarse aggregate size for all members less than eight (8) inches in thickness shall be 3/4 inch. For members with thicknesses greater than or equal to eight (8) inches, the maximum coarse aggregate size shall be 1-1/2 inches.
- C. Mixing Water: All water used in concrete shall be from a potable water supply.
- D. Admixtures: Air-entraining admixtures shall conform to "Standard Specifications for Air-Entrained Admixtures for Concrete" (ASTM C260 latest edition).
- E. Concrete Mix Proportions

Section 4.3.1. (ACI-318) shall be used for developing mixture portions. The Contractor shall furnish, for the Engineer's approval, all records to show that his concrete supplier is in compliance with all provisions of Section 4.3.1. If the concrete supplier is unable to furnish all records to comply with Section 4.3.1, Sections 4.3.1.2 and 4.3.2.2 can be used. If no records are available for any of the above ACI Sections, Section 4.3.3.2 shall be used to develop a concrete mix design.

5.03 EXECUTION

A. Concrete Quality

All concrete shown on the working drawings or referred to in the specifications shall be from an approved batch plant and shall have a minimum compressive strength of 2500 psi and a maximum water-cement ratio of 0.64. Air entrainment shall be 5%, more or less, 1% for concrete with maximum aggregate size of 1-1/2 inches and shall be 6%, more or less, 1% for concrete

with a maximum aggregate size of 3/4 inch. The concrete shall be of a consistency to work easily into corners, angles of forms and around reinforcement. The slump shall not exceed 4 inches.

A. Mixing and Placing Concrete

1. Preparation of Equipment and Place of Deposit:

- a. Before placement, all equipment for mixing and transporting the concrete shall be cleaned and all debris and ice shall be removed from the places to be occupied by the concrete. Forms shall be thoroughly wetted (except in freezing weather) or oiled and masonry filler units that will be in contact with concrete shall be well drenched (except in freezing weather).
- b. Water shall be removed from place of deposit before concrete is placed unless otherwise permitted by the Engineer. All latents and other unsound material shall be removed from hardened concrete before additional concrete is added.
- c. Expansion joint material shall be placed at all locations where concrete is placed against a structure.

2. Mixing:

- a. Ready mixed concrete shall be mixed and delivered in accordance with "Standard Specification for Ready Mixed Concrete (ASTM C94 - latest edition). Mixing and transporting equipment shall be capable of providing concrete which meets the ASTM C94 requirements for uniformity.
- b. For job mixed concrete, the mixer shall be rotated at a speed recommended by the manufacturer. If mixer performance tests are not made, each batch of 1 cubic yard or less shall be mixed for at least 1 minute after all materials are in the mixer. The mixing time shall be increased 15 seconds for each additional cubic yard or fraction thereof. The entire batch shall be discharged before the mixer is recharged.

3. Conveying:

- a. Concrete shall be conveyed from the mixer to the place of final deposit by methods that will prevent separation or loss of materials.
- b. Equipment for chuting, pumping and pneumatically conveying concrete shall be of such size and design as to ensure a practically continuous flow of concrete at the delivery end without separation of materials.

4. Placing:

- a. Concrete shall be deposited, as nearly as practicable, in its final position to avoid segregation due to rehandling or flowing. Concrete shall be placed at such a rate that it is at all times plastic and flows readily. No concrete contaminated by foreign material shall be used nor shall retempered concrete be used unless approved by the Engineer.
- b. When placing is started, it shall be carried on as a continuous operation until placement is completed.
- c. All concrete shall be thoroughly consolidated during placement. It shall be thoroughly worked around embedded fixtures and into the corners of the forms.

5. Cold Weather Requirements:

- a. Adequate equipment shall be provided for heating concrete materials and protecting concrete during freezing or near-freezing weather. No frozen materials or materials containing snow or ice shall be used.
- b. All reinforcement, forms, fillers and ground with which the concrete is to come in contact shall be free from snow and ice.
- B. Construction during cold weather shall be performed in accordance with ACI 306, "Recommended Practice for Cold Weather Concreting", or as directed by the Engineer.

SECTION 6 – SANITARY SEWER MAIN

6.01 SCOPE

The work covered by this section of the specifications consists of the furnishing of all plant, labor, materials, equipment and supervision and performing all operations involved in the construction of sanitary sewer mains in accordance with the provisions of the Plans and Specifications and subject to the terms and conditions of the Contract Documents.

Sanitary sewer leads and sewer appurtenances are covered under Section 7 of these specifications.

6.02 MATERIALS

A. Sewer Pipe

1. General

- a. Sewer pipe, unless otherwise indicated on the plans or authorized in writing by the Authority, shall be new, unused material of the size and type shown on the plans and shall conform to the requirements of these specifications.
- b. Pipe, materials and accessories offered by the Contractor shall be the standard products of reputable manufacturers normally engaged in the manufacturing of the particular item in question. The Authority Engineer shall have the final approval of a pipe manufacturer.

2. Sewer Pipe Selection

The sanitary sewer pipe used for gravity sewer main shall be PVC, unless otherwise specifically indicated. The sanitary sewer pipe used for pressure sewer may be PVC or HDPE, as indicated in the drawings.

3. PVC Gravity Sewer Pipe

PVC sanitary sewer pipe 15 inches in diameter and smaller shall meet the requirements of ASTM Designation D-3034 (latest edition), "Type PSM Polyvinyl Chloride (PVC) Sewer Pipe and Fittings". The minimum wall thickness shall conform to SDR-35.

PVC sanitary sewer pipe 18 inches to 27 inches in diameter shall meet the requirements of ASTM Designation F-679 (latest edition), "Standard Specification for Polyvinyl Chloride (PVC) Large Diameter Plastic Gravity

Sewer Pipe and Fittings". The minimum wall thickness shall conform to ASTM Designation T-1.

The use of PVC sewer pipe requires special attention to proper subgrade and backfilling procedures. Failure of the Contractor to provide proper construction will result in probable excessive deflection of the PVC pipe and require replacement by the Contractor at no additional cost to the Owner.

4. Ductile Iron Pipe

Ductile iron pipe shall meet the requirements of ANSI A21-50, A21-5 1 and AWWA C15 1 and shall be of the design thickness classification as indicated on the plans.

5. Pressure Sewer Pipe (PVC)

Pressure sewer PVC pipe shall meet the requirements for Type 1, Grade 1 (PVC 1120) of ASTM Specification D-1784 and ASTM D-2241, Standard Specification for PVC pipe (SDR- PR). PVC pipe shall be a minimum rating of Class 200, SDR 21. PVC shall only be utilized for force mains installed in an open cut trench.

6. Pressure Sewer Pipe (HDPE)

Pipe shall be made from a material having a material designation code of PE 4710 or 3608. The material shall meet the requirements of ASTM D3350 and shall have a minimum cell classification of PE445474C for PE 4710 and PE345464C for PE 3608. Pipe wall thickness shall be in accordance with manufacturer specifications for SDR-11. Use adapters and transition fitting assemblies with combination of clamps, couplings, adapters, gaskets, and threaded or flanged parts; compatible with system pressures, piping, and system liquid; made for joining different piping materials.

B. Pipe Joints

1. For PVC Sewer Pipe: PVC sewer pipe joints may be either solvent cement or elastomeric gasket type in accordance with ASTM D3212 (elastomeric gasket type) and/or in accordance with ASTM D2855 (for PVC pipe solvent cemented joints). Only chemical solvents approved by the pipe manufacturer shall be used.
2. For HDPE Sewer Pipe: HDPE sewer pipe shall be joined to itself by the heat fusion process which produces a homogeneous seal, leak tight. HDPE shall be joined by the butt fusion procedure outlined in ASTM F2620 whenever possible. Electrofusion welding, conforming to ASTM F1290 is

also permitted when necessary.

3. For Ductile Iron Pipe: Ductile iron pipe joints shall conform to the following:
 - a. Flange joints shall meet ANSI B 16.1, Class 125.
 - b. Mechanical joints shall meet ANSI A21.11 or Federal Specification WW-P-421.
 - c. Rubber gasket joints shall be of a bell and spigot type "TYTON", "SUPER BELL-TITE" or equal.

C. Pipe Fittings

Pipe fittings in sewer lines shall correspond in type, size, class, joints and all other respects with the type of pipe used as specified above including the applicable ASTM requirements. Where linings and coatings are specified for pipe, the fittings to be used in conjunction therewith shall have the same lining and coating.

Fittings shall be used in ductile iron pipe lines as required, whether specifically called for or not, according to the best practice in installation of these lines. A manhole water stop shall be provided at each manhole connection as shown in the standard details.

As approved by the Authority Engineer, specifically designed adapters shall be used to connect pipes of different diameter or materials of construction. The adapters shall be constructed of flexible materials and clamped onto the pipe with stainless steel bands. Use mastic, solvent weld or rubber gasket seals and encase in concrete to prevent displacement.

D. Tracer Wire

Where required, force main and service laterals shall have a tracer wire, 12 AWG (minimum), Break Load 452 lbs, installed with the pipe to provide a continuous conductor between access points. Copperhead High Strength Tracer Wire (or approved equal).

E. Valves and Appurtenances

1. Gate valves shall meet the requirements of AWWA C500 and/or C509 of the American Water Works Association. Valves shall be designed for not less than 150 psi working pressure and shall be tested for leakage and distortion under a hydraulic pressure of not less than 150 psi. Under such pressure, the valves shall show no leakage or distortion.

All gate valves shall be cast iron body, fully bronze mounted, bronze stem double disc gauge valves or resilient seated gate valves. Each valve shall

have a clear waterway equivalent in area, when open, to that of the connecting pipe. Valves shall be made to close when turned to the right or clockwise. All valves shall be operated by non-rising stems and shall have square wrench nuts, or hand-wheel operators with an opening arrow cast in the metal.

2. Plug valves shall be lubricated round port valves. Valves shall be 100% port area type with semi-steel body. Valve bodies shall be suitably marked to indicate whether the valve is open or closed.

The seating surface of the rotating element shall be of material recommended by the manufacturer for sewage sludge service. Bearings at the top and bottom supporting the rotating element shall be permanently lubricated corrosion-resistant type, suitable for sewage plant service. Stem seals shall be O-ring type of the same material as the seating surface and designed so replacement can be accomplished without disassembly of the valve.

All plug valves shall be designed to operate with a pressure of 150 psi on either side of the valve without leakage.

3. Check valves shall be designed for a minimum working pressure of 150 pounds per square inch or as indicated. Valves shall have a clear waterway equal to the full nominal diameter of the valve. Valves shall open to permit flow when inlet pressure is greater than the discharge pressure and shall close tightly to prevent return flow when discharge pressure exceeds inlet pressure. Distinctly cast on the body of each valve shall be the manufacturer's name or initials or trademark by which he can be readily identified and the size of the valve, working pressure and the direction of flow.

Check valves larger than 2 inches shall be iron body, bronze mounted, shall have flanged ends and shall be the non-slam type. Flanges shall be the 125-pound type conforming to ANSI Standard B16.1. All check valves shall be supplied with an external lever and weight. Springs shall be applied to lever, if necessary, to create a non-slam condition.

4. Valve operators shall be provided for all sewage and sludge valves of a type as indicated on the plans. Valve operators shall be of sufficient size and strength to overcome expected maximum operating torque. Valve operators found to be inadequate strength will be replaced by the Contractor at no expense to the Owner or the Authority.

All valves 8 inches and larger to have crank, handwheel, chain wheel or square nut for buried service, totally enclosed, weatherproof worm gear or traveling screw-type operators with indicators.

For automatic (if required by the drawings) operation, cylinder, rotary or similar types of electric or pneumatic actuators may be used regardless of valve size. Various accessories shall be used, depending on the application, such as positioners, limit switches, solenoid valves, speed controls and failsafe assemblies.

5. Valve boxes shall be cast-iron, three piece, adjustable type with a 5-1/4 inch shaft. Covers shall be furnished with fingerholes and marked "SEWER". Valve boxes shall be similar to that as manufactured by the East Jordan Iron Works, Clow Corporation or equal.
6. Pipe supports, where required, shall be of the adjustable type made to support cast iron type pipe.

6.03 EXECUTION

A. Excavation

As specified in "Excavation, Trenching and Backfilling".

B. Gravity Sewer Main

Thermoplastic sewer pipe shall be installed per ASTM designation D 2321 (latest edition) unless otherwise indicated in these specifications. Rigid pipe types (DIP) shall conform to ASTM C12. Embedment material shall be ASTM D2321 standards unless otherwise indicated herein, or in the standard details.

Pipes located inside structures or above ground shall be rigidly supported as shown on the plans or as specified herein. The full length of each section of underground pipe shall rest solidly upon the prepared bed of undisturbed earth or compacted backfill with recesses only to accommodate pipe bells and joints. Any pipe which has its grade, alignment or joints disturbed after laying shall be taken up and re-laid. The interior of all pipe shall be thoroughly cleaned of all foreign matter before being lowered into the trench and shall be kept clean during laying operations.

The pipe shall not be laid in water or when trench or weather conditions are unsuitable for work. Water shall be kept out of the trench until the joints and backfilling are completed. When the work is not in progress, open ends of pipe and fittings shall be securely closed so that no water, earth, or other foreign substances can enter the line.

All sanitary sewer main shall be laid using a laser for alignment and grade. The Contractor shall be responsible for checking their work using the hubs, stakes,

and/or benchmarks provided by the Owner and/or Engineer. Any sewer found to have a grade or alignment that varies by more than 10% from the plan grade or elevation will be considered deficient. The Engineer will determine if the deficiency is serious enough to affect the objective of the project. The Contractor shall remove and re-lay any deficient sewer, if directed by the Authority Engineer, at no additional cost to the Owner.

Any section of pipe found to be defective, either before or after laying, shall be replaced with new pipe at the Contractor's expense. If repairs are necessary, Fernco adaptors will not be allowed for main line pipe. Similar material shall be utilized. Fernco adaptors may be allowed if constructed above the water table and approved by the Authority Engineer.

The Authority Engineer shall be notified at least 24 hours prior to the start of laying sewer main.

C. Force Main, Open Trench

PVC piping: PVC pressure sewer piping shall be installed in accordance with ASTM D-2774 for underground installation of PVC pipe, the manufacturer's written instructions, the drawings, and the following:

1. All force main piping shall be laid to the alignment and burial depth called for on the Drawings. Pipe shall be laid to minimize sags or high points as much as practical and shall be installed in a properly prepared, dry trench.
2. Piping shall be placed on trench bottom that is constructed to provide a firm, stable, and uniform support for the full length of the pipe.
3. Thrust blocking shall be installed at changes in direction greater than 45 degrees.
4. Pipe shall be lowered into the trench, bells and spigots cleaned, then promptly joined. Pipe shall be placed with the bell end pointed in the direction of the work.
5. After the pipe is laid, the bedding shall be carefully compacted under the haunches of the pipe, and the trench shall be backfilled to 12 inches above the pipe as specified within the trench backfill detail. Sufficient backfill shall be placed after each joint is made along the sides of the pipe to offset conditions that might tend to move the pipe off line and grade. Any pipe found off grade or out of line shall be re-laid properly by the Contractor.
6. Where a full pipe length must be field cut, the cut shall provide a smooth end at a right angle to the length of the pipe. Pipe spigot end shall be deburred and beveled to approximately match the factory bevel or left square when inserted into fittings.
7. Use proper size increasers, reducers, and couplings where different sizes or materials of pipes and fittings are connected. Reducing size of piping in direction of flow is prohibited.
8. Each pipe shall be inspected for defects prior to being lowered into the trench. Pipe having cuts or gouges in excess of 10% of wall thickness shall not be installed.
9. The PVC pressure piping shall be installed with a minimum allowable bending radius as indicated below:

1-1/2" nominal I.D.	= 52 feet
2" nominal I.D.	= 60 feet

2-1/2" nominal I.D.	= 72 feet
3" nominal I.D.	= 84 feet
4" nominal I.D.	= 100 feet
6" nominal I.D.	= 144 feet
8" nominal I.D.	= 189 feet

HDPE piping: HDPE piping shall be installed in accordance with ASTM D2657 for heat fused joints, piping manufacturers written instructions, the drawings, and the following:

1. All force main piping shall be laid to the alignment and burial depth called for on the Drawings. Pipe shall be laid to minimize sags or high points as much as practical and shall be installed in a properly prepared, dry trench.
2. Piping shall be laid in continuous sections, butt-fusing ends to join piping segments, or connection to mechanical joints.
3. Use proper size increasers, reducers, and couplings where different sizes or materials of pipes and fittings are connected. Reducing size of piping in direction of flow is prohibited.
4. Each pipe shall be inspected for defects prior to being lowered into the trench. HDPE pipe having cuts or gouges in excess of 10% of wall thickness shall be cut out and removed. The undamaged portions of the pipe shall then be butt fused to rejoin.
5. The HDPE SDR-11 pipe shall be installed with a minimum allowable bending radius as indicated below:

1-1/2" nominal I.D.	= 7 feet
2" nominal I.D.	= 9 feet
2-1/2" nominal I.D.	= 11 feet
3" nominal I.D.	= 13 feet
4" nominal I.D.	= 17 feet
6" nominal I.D.	= 25 feet
8" nominal I.D.	= 37 feet

6. After the pipe is laid, the bedding shall be carefully compacted under the haunches of the pipe, and the trench shall be backfilled to 12 inches above the pipe as specified under Division 2, "Earthwork." Sufficient backfill shall be placed after each joint is made along the sides of the pipe to offset conditions that might tend to move the pipe off line and grade. Any pipe found off grade or out of line shall be re-laid properly by the Contractor.

D. Connections to Existing Force Main

The Contractor shall furnish all labor and materials required for the connection of new sewers under this Contract to existing force main, as called for on the Drawings. Contractor shall coordinate temporary service disruption for tap with the Owner and provide notice to residents that will be affected. At time of service disruption, Contractor shall be prepared to immediately commence with tap; including having the excavation prepared and dewatered, having all necessary parts and equipment ready, and having personnel prepared to make connection, in order to minimize the duration of the service disruption.

E. Force Main, Directional Drilling

A. Staging Area & Bore Pits

1. Conduct all construction work, including pit excavations, equipment layout, material storage, and construction traffic within the designated areas established for the project.
2. Before beginning construction at any location, locate existing utilities, structures, and other facilities in the vicinity of the HDD alignment. Locate and size pit excavations to minimize conflicts with and damage to existing utilities.
3. Size upstream and downstream pits to completely contain drilling fluid and prevent fluid escape. Provide a secondary containment system around pits.
4. Fabricate the required length of pipe within the designated pipe laydown area.
5. Conduct all operations while maintaining access to the surrounding roads without creating dust or other construction nuisance to surrounding properties. Driveways shall not be closed for more than a 4 hour period.
6. All work shall be done to minimize disturbance or damage to roadways, adjacent structures, utilities or landscaped areas. Promptly repair any damage from operations to the satisfaction of the Owner, Engineer, property Owner or utility involved.

B. Control of Drilling Fluids, Cuttings, and Water

1. Control operational pressures, drilling mud weights, drilling speeds, and any other operational factors required to avoid hydrofracture fluid losses to formations, and control drilling fluid spillage. This includes any spillages or returns at upstream and downstream locations or at any intermediate point.
2. Provide a secondary spillage containment system down slope of the launch pit, capable of preventing spills from flowing beyond the immediate work zone.
3. Maintain on-site mobile spill removal equipment during all drilling, pre-reaming, reaming and pullback operations capable of quickly removing spills or inadvertent returns. Notify the Engineer of any spills or inadvertent returns and immediately contain and clean up the return or spill.
4. Drilling Fluids & Cuttings
 - i. Recirculation of Drilling Fluids - Provide solids control and fluid cleaning equipment sufficient to handle the amount of recirculated drilling fluid and process it to produce drilling fluid suitable for reuse.
 - ii. Dispose of all drilling fluid and cuttings off-site and in compliance with applicable state and local regulations.
 - iii. Drilling fluid and cuttings shall not be discharged into any surface ditch, waterway, storm drain, sanitary sewer or any other such conveyance.
5. Water: Contractor shall be prepared to contend with any groundwater encountered and to dispose of any surfacing groundwater in accordance with applicable regulations.

C. Pilot Hole Drilling: Contractor shall drill the pilot hole along the profile indicated on the drawings or as otherwise approved by the Engineer. Contractor shall provide and maintain instrumentation to monitor drill fluid flow rate, fluid pressure and volume. Contractor shall maintain pilot hole location within the area delineated on the drawings and by Permits and right-of-way restrictions.

D. Reaming: Ream as required to enlarge the pilot hole so as to ensure a borehole diameter sufficient to accommodate the HDD pullback. The hole shall be reamed to a minimum

diameter of 150% of the effective outside diameter of the pipe. Contractor may incrementally upsize the ream as necessary to prevent damage to reaming tool.

E. Pipe Pullback

1. Pipe Assembly:

- i. Assemble the entire length of pipe to be installed by horizontal directional drilling methods in the pipe laydown area.
- ii. Assembled pipe shall be moved to the bore pit location in a manner that does not disrupt traffic or damage the pipe. Pipe shall not be dragged across surfaces which may damage the exterior surface of the pipe.

2. Pipe Pullback:

- i. Plan pullback operation to ensure that once started the operation can be completed without stopping.
- ii. Determine and apply safe pulling load required for proper installation.
- iii. Completely seal pipe to prevent drilling fluid from entering pipe during pullback.
- iv. Compensate for buoyancy effects as pullback installation proceeds, to help reduce pipe friction.
- v. Control torsional stress by use of a fully operational swivel to connect the pull section to the reaming assembly to minimize torsional stress. The torsional stress imposed on the pull section shall not exceed the maximum allowable torsional stress specified by the pipe manufacturer.
- vi. Provide accurate working gauges with register force being used to pull the pipeline back through the reamed borehole. If during the pipeline pulling process this force reaches 75% of the allowable load for the pipeline, notify the Engineer immediately.
- vii. Provide adequate support / rollers along pipe assembly and laydown area to support the required length of pipe for each location. Arrange supports to allow free movement during pullback. Monitor roller operation and use side-booms if required to assist movement of the pipe. Do not allow tail end of pipe or pipe sags to drag on the ground.
- viii. Take care as the pipeline is pulled to the borehole entrance and casing to avoid damage to pipe and/or tracer wire.
- ix. The tensile pulling load imposed on the pipe in the pull section shall not exceed the maximum allowable tensile load of the pipe as specified by the pipe manufacturer.
- x. Cut pipe to final length as shown on the Drawings. Install transition fittings as necessary to mate with fittings and valves as shown on the drawings.
- xi. Upon completion, Contractor shall provide paint markings along the route, indicating the as-installed pipe location and depth for the Engineer's documentation purposes.

F. Placement within Easements

Where sewer lines are shown crossing private property, the alignment of the sewers shall be as shown on the plans and as directed by the Engineer and extra care must be taken

to ensure that the work is done within the construction easements.

G. Handling

The sewer pipe shall be handled at all times in such a manner as to ensure delivery to the site and installation in a sound, undamaged condition. Any damaged or defective pipe or other materials will not be accepted. PVC pipe shall not be stored or handled in a manner which will permit exposure to sunlight for extended periods of time.

H. Horizontal and Vertical Separation

Sewers shall be laid 10 feet horizontally from any existing or proposed watermains. This distance shall be measured edge to edge. Should local conditions exist which do not allow for this separation, the crown of the sewer pipe shall be laid at least 18 inches below the invert of the watermain - with the permission of the Authority Engineer and the Michigan Department of Environmental Quality, Drinking Water division.

Sewers crossing watermains shall be laid to provide a minimum vertical distance of 18 inches between the outside of the pipes. This shall be the case where the watermain is either above or below the sewer. The crossing shall be arranged so that one full length sewer pipe shall be centered with respect to the water pipe. Where a watermain crosses a sewer, adequate structural support shall be provided to prevent damage. If the 18-inch isolation distance cannot be maintained due to site constraints, then approval from the MDEQ Water Division will be required for the special construction method proposed (casing, sleeving, etc.)

When it is impossible to obtain proper horizontal and vertical separation as stipulated above, the sewer shall be designed and constructed equal to water pipe and shall be pressure tested to assure watertightness prior to backfilling.

In all cases, state and local permit requirements shall be adhered to.

I. Placement of Sewer Pipe

The pipe shall be placed as soon as possible after the trench excavation has been made. The pipe shall be carefully laid to the required grade in a prepared trench, up-grade from structure to structure, with the bell or groove end of the pipe upgrade. Each section shall have a firm bearing throughout its length with recesses only to accommodate pipe bells and joints. Any pipe which has its alignment, grade or joints disturbed after laying shall be removed and re-laid. The joints and interior of all pipe shall be thoroughly cleaned of all foreign matter before being lowered into the trench and shall be kept clean during the laying operations. Starting sewer construction in the middle of a project must be approved in writing by the Authority Engineer.

Water shall be kept out of the trench until the material of the joints has hardened and the trench partially backfilled to prevent floating of the pipe. When work is not in progress, open ends of pipe and fittings shall be securely closed so that no trench water, earth or other foreign substance can enter the line.

J. Joints

Joints shall be of the material specified and shall be placed in accordance with the manufacturer's specifications.

K. Backfilling

As specified in "Excavation, Trenching and Backfilling".

L. Cleaning Sewers

The sanitary sewer main must be clean at the time of acceptance. If, at any time, there is an accumulation of earth or silt in the pipe, the Contractor shall clean out and remove such deposits at their own expense.

M. Acceptance Tests

1. Gravity Sewer Air Testing

All new sewers shall be subjected to air, infiltration or exfiltration tests or a combination of same prior to acceptance by the Owner. All tests for acceptance of the sewer line shall be witnessed by the Authority Engineer. All sewers where the groundwater level above the crown of the sewer at the upstream manhole is over seven (7) feet shall be subjected to air tests or infiltration tests. If an exfiltration test is performed, the maximum exfiltration rate shall be the same as that permitted from infiltration. For the purposes of exfiltration testing, the internal water level shall be equal to the external water level plus seven (7) feet as measured from the crown of the pipe at the upstream manhole.

No sewer lines will be accepted until testing has been satisfactorily completed and approved. Testing shall be completed within 30 days of laying operations.

Where groundwater conditions require dewatering operations in order to construct sewers, the Contractor may, at his option, perform preliminary air tests after backfilling and while the dewatering equipment is still operating. After dewatering operations have ceased and the groundwater has stabilized at its normal level seven (7) feet or less above the sewer and if the preliminary air test was satisfactory, the preliminary air test may be accepted as final.

Maximum allowable infiltration shall not exceed 100 gallons per inch of

diameter per mile of pipe per 24 hours for any individual run between manholes.

The procedure for air testing of PVC (flexible / plastic pipe) sewers shall conform to ASTM F1 417 and be as follows:

The sewer line shall be tested in increments between manholes. All leads and wyes shown on the plans must be in place prior to testing. The lines shall be cleaned and plugged at each manhole. Such plugs shall be designed to hold against the test pressure, be braced in place, and shall provide an air tight seal. There shall be no standing water in the pipe during testing operations. One of the plugs shall have an orifice through which air can be introduced into the sewer. An air supply line shall be connected to the orifice. The air supply line shall be fitted with suitable control valves and a pressure gauge for continually measuring the air pressure in the sewer. The pressure gauge shall have a minimum diameter of 3-1/2 inches and a range of 0-10 PSIG. The gauge shall have minimum divisions of 0.10 PSIG and an accuracy of + 0.04PSIG.

The sewer shall be pressurized to 4 PSIG greater than the greatest back pressure caused by groundwater over the top of the sewer pipe. Greatest back pressure is determined by averaging groundwater depth over the top of the pipe averaged at each manhole and multiplying by 0.433 to obtain psi. At least two (2) minutes shall be allowed for the air pressure to stabilize between 3.5 and 4 PSIG. If necessary, air shall be added to the sewer to maintain a minimum pressure of 3.5 PSIG during the stabilization period.

After the stabilization period, the air supply control valve shall be closed so that no more air will enter the sewer. The sewer air pressure shall be noted and timing for the test begun. The test shall not begin if the air pressure is less than 3.5 PSIG or such other pressure as is necessary to compensate for groundwater level.

The air test shall be performed for the duration shown in Table 6-2. The air pressure shall not drop over 1.0 psi during this test period.

TABLE 6-2 Required Test Time for Air Pressure Testing

Pipe Diameter In Inches	Duration of Air Test in Minutes per 100 ft. of Sewer Pipe Length
6	3.0
8	4.0
10	5.0
12	6.5
15	7.5
18	8.5
21	10.5

24	11.5
----	------

If a sewer segment fails to pass the air pressure test, the Contractor shall determine the location of the deficiency, repair them and retest the sewer. The sewer will not be accepted until satisfactory results are obtained.

The actual groundwater level for sanitary sewers subject to air tests shall be determined by the Authority Engineer or Resident Project Representative.

The air test pressure shall be adjusted to compensate for the maximum probable groundwater level above the top of the sewer pipe that is being tested.

The method of testing and measurement shall be approved by the Authority Engineer. The Contractor shall provide the necessary equipment and labor for making tests and the cost of same shall be included in the unit price bid for completed sewer.

Chemical grouting will be considered an acceptable method of repairing leaking pipe joints. Before this type of repair is undertaken, the Contractor shall obtain approval of the Authority Engineer to hire a pipe grouting firm for making such repairs. Additionally, if chemical grouting of pipe joints is necessary, this operation must be performed under the observation of the Authority Engineer and a complete report of all grouting operations shall be furnished to the Authority Engineer upon completion.

2. Deflection Testing of Thermoplastic Sewer Pipe

Thermoplastic sewer pipe shall be tested for vertical deflection. ***Deflection tests shall be performed on 100 percent of the total footage of PVC sewer.***

This testing shall be carried out under the observation of the Authority Engineer using a Go-No-Go device approved by the Authority Engineer and furnished by the Contractor. The deflection testing shall be performed at least thirty (30) days after final backfill of the trench. The maximum allowable vertical deflection of the cross section of the pipe will be five percent (5%) of the actual internal pipe diameter. If the results show the deflection of any sewer to be in excess of allowable, then the Contractor shall make repairs by re-excavation and compaction or replacement prior to acceptance.

The deflection testing must be satisfactorily completed prior to final acceptance of the sewer. There will be no additional payment for deflection testing performed while the sanitary sewer is in service if the Authority executes their right to utilize the sewer upon Substantial Completion. The Authority Engineer shall be notified at least 24 hours prior to air testing of the sewer.

3. Television Inspection

New sewers connecting existing services may be inspected after installation by means of closed circuit television in lieu of air testing. Videotaping equipment shall have a running footage indication for aiding in locating all wyes, defects, etc. which is displayed and permanently recorded on the video tape of the section being filmed. The complete system shall be permanently recorded using video tape along with handwritten documentation indicating all information such as wye location, defects, infiltration and cleanliness. Immediately upon completion of the filming, the finished video tapes shall be turned over to the Authority Engineer in cassette style (VHS Format). Wyes and laterals shall be in place prior to the television inspection. This television inspection work will be done under the direction and observation of the Authority Engineer. The Contractor shall notify the Authority Engineer at least 24 hours prior to the television inspection.

The television inspection shall be completed prior to the final acceptance of the sewer section. The Authority may exercise their option to use the sewer upon substantial completion. No additional payment will be made for televising the sewer under live conditions.

Any defect in the sewer construction observed during the television inspection such as poor grade, cracked or leaking pipe sections or excessive amounts of debris shall be corrected by the Contractor immediately. Sections with defects will have to be re-televised after the repairs are made.

4. Force Main Pressure Testing

- A. General: All new sanitary force mains, service laterals, valves and fittings shall be pressure tested as described herein. Tests shall be made on all sections of pipe. All valves within the section of pipe being tested shall be pressure tested while closed. Caps or plugs shall be temporarily installed where necessary to perform the test. All parts of the piping must be braced and sufficiently backfilled to prevent movement of the pipe. PVC pressure pipe shall NOT be air tested due to the safety risks involved. The Contractor shall be responsible for providing all the labor, equipment, and materials necessary to satisfactorily complete the test.
- B. The Contractor may, at his option, test any or all of the sewer lines prior to backfilling. However, such tests shall be in addition to the required test following the backfilling of the trench.
- C. The Contractor shall make provisions for determining the ground water level prior to testing, and the level will be confirmed by the Engineer.
- D. All tests shall be made under the supervision of the Engineer. Testing

schedule and procedures will be submitted by the Contractor and approved by the Engineer prior to the start of the work. Schedule tests and inspections with Engineer and authorities having jurisdiction with at least 48 hours' advance notice. No testing shall be accepted unless witnessed by Engineer

E. The Contractor shall clean and flush the pipe prior to conducting acceptance tests.

F. All visible leakage shall be repaired even though acceptance tests have been satisfactory.

G. Tightness Hydrostatic Testing for force main sewers shall be performed in accordance with AWWA procedures for hydrostatic testing of watermain, which includes the following:

1. Test equipment shall include water supply, pump for pressurizing system, water hose, plugs, hose connections, shutoff valve, throttling valve, pressure relief valve, monitoring pressure gauge, testing pressure gauge in not more than 1 psi gradations (visible for monitoring at a safe location outside of any excavations or manholes) and stopwatch.
2. Safety precautions shall be carefully observed by the Contractor during testing, recognizing the danger from plugs blowing out. No person shall be allowed in manholes during testing.
3. Isolate Pipe to be Tested: The section of pipe to be tested shall be plugged at each end. The ends of all branches, laterals and wyes which are to be included and in the test are to be plugged. All plugs shall be carefully braced to prevent slippage and blowout due to the internal pressure.
4. Add Water: Supply water to the system at low point in the piping, forcing air out through valve or air release at high point. Monitor the line pressure so that the pressure inside the pipe does not exceed the pressure rating of the pipe.
5. Stabilize: When air trapped in the line has been purged and the pressure is brought up to the greater of either 1.5 times the maximum operating pressure as determined by the Engineer, or 100 psi, throttle the pump so the internal pressure is maintained within 5 psi of test pressure specified by Engineer, plus adjustment for groundwater, for at least 2 minutes. If plugs are found to leak, bleed off the pressure, tighten the plugs and repeat.
6. Determine Rate of Water Loss: The control equipment consists of delicate gradation pressure gauge, valves and a pocket stopwatch. After the pressure has been allowed to stabilize, the pump is turned off and the pressure is monitored for 120 minutes. Water is added to the system throughout the testing period to maintain the test pressure within 5 psi. Water added by the pump to maintain test pressure shall be drawn from a reservoir with volumetric gradations sufficient to determine the total volume of water added during the 120 minute test period. If at the end of the 120 minute test period the amount of

water added is less than the leakage rates below, then the pipe will be considered passing the tightness test :

1.25" Pipe : 0.08 gallons per hour per 1000 feet of pipe tested

2" Pipe : 0.12 gallons per hour per 1000 feet of pipe tested

2.5" Pipe : 0.13 gallons per hour per 1000 feet of pipe tested

3" Pipe : 0.15 gallons per hour per 1000 feet of pipe tested

4" Pipe : 0.33 gallons per hour per 1000 feet of pipe tested

6" Pipe : 0.50 gallons per hour per 1000 feet of pipe tested

8" Pipe : 0.66 gallons per hour per 1000 feet of pipe tested

10" Pipe : 0.83 gallons per hour per 1000 feet of pipe tested

12" Pipe : 0.99 gallons per hour per 1000 feet of pipe tested

7. Piping sections not passing the tightness test shall be repaired and retested at Contractor's expense, until a passing result is obtained.

5. Visual Observation

Any observed defects in the sewer or groundwater flowing in the sewer shall be repaired by the Contractor prior to final acceptance.

6. Tracer Wire

All new trace wire installations shall be located using typical low frequency (512Hz) line tracing equipment, witnessed by the Engineer, prior to acceptance. This verification shall be performed upon completion of rough grading and again prior to final acceptance of the project.

N. AIR RELEASE VALVES AND MANHOLES

Air release valves and manholes shall be constructed as detailed on the detail drawings.

O. FORCEMAIN CLEANOUTS

Forcemain cleanouts shall be constructed as shown on the detail drawings.

P. Certification

The manufacturer of pipe and fittings shall furnish a certification statement that all pipe and fittings furnished to the project have been inspected and tested in accordance with the applicable specifications. Pipe will be subject to inspection and approval upon delivery and no cracked, broken, damaged or defective pipe or fitting shall be laid in the work. Any piece that is found to be defective after it has been laid shall be removed by the Contractor and replaced by a sound and perfect piece. Material certifications must be received prior to final acceptance and/or final payment for the work.

Q. Well Isolation Encroachment

Unless otherwise indicated, it shall be assumed that sewer mains may encroach upon the standard 50-foot well isolation of adjacent private drinking water wells. Gravity sewers shall be constructed with watertight joints per Rule 122 per Part 127, 1978 PA 368 and must be at least 10 feet from wells.

Pressure sewers shall meet the following specifications:

- a. All sewer piping and fittings shall meet water main standards for materials and construction as detailed in Part 127, R 325.1613 Rule 113 (2) (b) (iii) (B) "ASTM specification D1785-91 or D2241-89" or (C) "has a wall thickness that is equivalent to, or thicker than, schedule 40 or SDR 21" or they may be HDPE SDR11 pipe, or acceptable equivalent, conforming to the appropriate ASTM standard. If HDPE SDR 11, or an acceptable equivalent will be used, all joints outside structures shall be watertight and connected in accordance with the manufacturer's requirements, and all taps shall be completed using branch saddles fused to the mainline pipe, or acceptable equivalent. Alternative designs such as watertight carrier pipe may also be considered. Sewer shall be clearly marked as sanitary, per applicable standards.
- b. All devices (intermediate flushing connections, terminal flushing connections, branch flushing connections, air/vacuum release valves, etc.) except for valves on leads, shall be placed in watertight vaults or structures, and shall be located no less than 50 feet from any existing private water well.
- c. Where the horizontal distance between any portion of the public sewer or individual service leads (see d below) and any existing private water well is less than 50 feet, the separation distance shall be maximized; but in no case shall the distance be less than 10 feet. This is referred to as "suitable isolation distance" in the remainder of this procedure.
- d. The sewer must pass a pressure test, equivalent to that required for water main, as described in Part 127, R 325.1613 [Rule 113(2)(B)(iii)(A)] "the sewer pipe and joints must be pressure tested, after installation, to not less than 100 pounds per square inch and determined to be watertight" or shall be tested using AWWA water main pressure testing procedures and standards.
- e. For nonmetallic low-pressure pipe (e.g., HDPE or PVC), a continuous tracer wire shall be provided and attached directly to all piping owned, operated, or maintained by the public system.

SECTION 7 – SANITARY SEWER APPURTENANCES

7.01 General

The work covered in this section of the specifications consists in the furnishing of all plant, labor, materials, equipment and performing all operations involved in the construction of sewer appurtenances as shown on the Project Plans or Standard Details. This work includes, but is not limited to, the following items:

1. Sewer Manholes & Structures
2. Connection to Existing Sewers
3. Gravity Sewer Wyes and Leads
4. Pressure Sewer Leads

A. General

The following provisions apply to this section of the specifications:

1. All materials, unless otherwise indicated on the plans or authorized in writing by the Authority Engineer, shall be new and unused materials of the size and type shown on the plans and standard details and shall conform to the requirements of the specifications.
2. All materials offered by the Contractor shall be the standard products of reputable manufacturers normally engaged in the manufacturing of such materials. Certifications shall be provided on all materials prior to final acceptances.
3. The foundations of all structures shall be rigidly supported by undisturbed earth or compacted backfill. The interiors of all appurtenances shall be thoroughly cleaned of all foreign materials.
4. Where appurtenances are shown to be constructed on private property, the location of the structure shall be as shown on the plans. All work done within private property shall have an easement provided to the Authority by the Owner prior to turnover.

7.02 MATERIALS

A. Sanitary Sewer Manholes & Structures

Sanitary Sewer Manholes, valve vaults, cleanout and/or air release structures shall be constructed of pre-cast manhole units in accordance with ASTM C478. Unless otherwise indicated, all manholes shall be four (4) feet in diameter. Manholes shall be delivered to the project in an un-damaged condition. Any manhole which shows visible signs of

damage will not be accepted. Manholes shall be constructed to meet the dimensions shown on the Standard Details.

1. Waterstops: All structure connections will be fitted with a waterstop assembly. The waterstop shall be of a design acceptable to the Engineer and the pipe manufacturer. Waterstops shall be KOR-N-SEAL as manufactured by National Pollution Control Systems; PRESS WEDGE II as manufactured by the Press-Seal Gasket Corporation; RES-SEAL as manufactured by Scales Manufacturing Corporation or equal.

The joint between the pipe and the structure wall shall be flexible. Mortar and grout shall not be used to fill the space between the structure wall and the pipe, except to form an adequate flow channel.

2. Waterproofing Material: All structures shall be waterproofed on the interior or the exterior.
 - a. Interior Manhole Waterproofing Material: The materials to be used for interior manhole waterproofing shall be "Drycon" as manufactured by IPA Systems, Inc., "Thoroseal" as manufactured by Standard Dry Wall Products Company or equal.
 - b. Exterior Manhole Waterproofing Material: The material to be used for exterior manhole waterproofing shall be a heavy fibered type waterproofing mastic conforming to Federal Specification SS-C-153 Type 1 or CS-206. The mastic shall be A.C. Horn (Grace), Flink Kote 710-23 or equal.
3. Manhole Steps: Manhole steps shall be cast iron or steel-reinforced plastic. Steps shall not be aligned over the pipe and shall be at a consistent 16" spacing.
 - a. Cast Iron: Cast iron manhole steps shall fulfill the requirements of the ASTM Standard Specifications for "Gray Iron Castings", A-48, Class No. 30, minimum width 13 inches. They shall be East Jordan Iron Works No. 8509, Neenah Foundry Co. R-1980 or equal.
 - b. Plastic: Polypropylene plastic, steel reinforced, manholes steps may also be furnished, minimum width 13". They shall be #PS2 manhole steps as manufactured by M.A. Industries, Inc., of Peachtree City, Georgia or equal.
4. Cast Iron Frames and Covers: Structure frames and covers shall be cast iron. Cast iron frames and covers for sanitary sewer manholes shall be a self-sealing lid with no holes extending all the way through the lid. The self- sealing lid shall fit into a precisely machined groove. A rubber gasket shall make contact with the frame to create a leak proof seal. The self-sealing lid shall include a concealed

pickhole to facilitate the removal of the lid, but not allow water to enter.

All structures shall have a 24" opening similar to an EJIW #1040 with Type A solid cover or equal. Manholes located within existing or proposed pavement areas shall also be installed with a 3" metal adjusting ring (EJIW #1000H) between the frame and cover. Metal adjustment rings shall be tack welded in at least 6 locations inside and out to secure the ring to the frame.

B. Gravity Sewer Wyes and Sewer Leads

All PVC sewer laterals shall be extra strength pipe, and unless otherwise specified, shall conform to the requirements of ASTM Designation D3034 with a standard dimension ratio of 23.5 (SDR 23.5), or conform to the requirements of ASTM Designation D-1785 Schedule 40. Any specified bends or curves shall be smooth, long-radius type curves. No mitered or segmental type bends will be approved.

The fitting between the SDR 35 wye and the SCH 40 PVC lead shall be a 35/40 adapter. SDR joint shall utilize a slip joint (no rigid glue joint will be allowed).

C. Clean-Outs

Clean-outs shall consist of pipe and fittings of the same type as the sewer main materials they connect to as required to provide a clean-out installation as shown in the standard details. The maximum distance between clean-outs is 75 lineal feet.

D. Pressure Sewer Services (HDPE)

Pipe shall be made from a material having a material designation code of PE 4710 or 3608. The material shall meet the requirements of ASTM D3350 and shall have a minimum cell classification of PE445474C for PE 4710 and PE345464C for PE 3608. Pipe wall thickness shall be in accordance with manufacturer specifications for SDR-11. Use adapters and transition fitting assemblies with combination of clamps, couplings, adapters, gaskets, and threaded or flanged parts; compatible with system pressures, piping, and system liquid; made for joining different piping materials.

Services shall be electrofusion tapping tee with butt fusion outlet of the size indicated, fused to the mainline pipe.

7.03 CONSTRUCTION METHODS

A. Excavation, Bedding and Backfilling

Excavation, bedding and backfilling for sewer manholes and clean-outs shall be in accordance with the Section 4, "Excavation, Trenching and Backfilling" of these specifications and applicable standard details.

B. Manholes and Pre-cast Structures

Manholes and precast structures shall be constructed only when the temperature is above 32° F. All work shall be protected against freezing.

Water shall be removed from the excavation during construction of the structure and during the time required for the concrete or mortar to develop sufficient strength to resist rupture by groundwater pressure.

Pre-cast O-ring sections shall be joined by first applying a lubricant as approved by the concrete manufacturer. The lubricant shall be placed on the O-ring and both faces of the sections to be joined. The pre-cast sections shall then be set evenly to provide a full seating of the O-ring within the grooves in the concrete sections. After the pre-cast sections have been placed, the interior joint surface shall be grouted smooth. Additional methods for joining two barrel sections must be approved by the Engineer.

C. Manhole Flow Channels

Manhole flow channels shall be formed as shown on the Standard Detail Plans by laying pipe through and cutting out the top portion before completion of the base of the manholes. Cut edges of pipe laid through the manhole shall be fully covered by concrete when the manhole invert is complete. The finished invert shall be smooth and true to grade. No mortar or broken pieces of pipe shall be allowed to enter the sewers.

D. Drop Structures

All sanitary manholes with an invert drop in excess of 24 inches shall have a drop structure. The drop structure shall be built as shown on the Standard Detail Plans.

E. Manhole Waterstops

The joint between the pipe and the manhole wall shall be flexible. Mortar and grout shall not be used to fill the space between the manhole wall and the pipe, except to form an adequate flow channel.

F. Placing Castings

Castings with adjustment rings, if applicable, shall be set to the required elevation in full mortar beds. No more than nine inches (9") of adjusting concrete rings or and mortar shall be used on any manhole between the pre-cast top section and the casting.

G. Connection to Existing Sanitary Sewer Systems

Connection to existing sanitary sewer systems shall be made in such a manner as to minimize the interruption of flow in those systems. The connection to an existing manhole shall be made by coring and the installation of a waterstop.

When a new manhole is to be installed over an existing line, it shall be initially placed without damaging the existing pipe. The existing pipe shall not be damaged until the new lines are ready to be placed in operation and the new flow channel is ready to be formed to connect with the existing flow lines.

H. Gravity Sewer Wyes and Leads

The wyes and sewer leads shall be constructed as shown on the Sanitary Sewer Standard Details in the plans.

The sewer lead is defined as the sewer pipe between the wye installation and 5 feet outside the building limits or to the property/easement line in the case of installation to an undeveloped parcel as indicated on the Standard Details for sewers. The sewer lead shall be brought to the property/easement line at a grade and location established before construction commences, based on a location document (provided by the Design Engineer) or as staked in the field by the Design Engineer or Resident Project Representative. If the proposed location of a sewer lead is not identified, it is the Contractor's responsibility to obtain the information from the Design Engineer/Resident Project Representative prior to the installation. If the lead location is not as per directed by the Resident Project Representative, or Engineer the relocation of the sewer lead shall be performed at the Contractor's expense.

After each sewer lead is installed, it shall be permanently marked at its termination (the property line or easement line) at the plug (see the Standard Detail) with a treated wood post 0.40 penetration for underground purposes. The post shall be installed vertically and cut and painted as directed by the Engineer, the post shall be installed from the bottom of the stub to 18" above grade. For leads deeper than 12 feet, use wood post that provides an 18 inch (+) projection above ground. Should the post location fall in a driveway or other area where its above ground projection might cause problems, the Contractor shall pre-cut the 12-foot post to some convenient full foot dimension below grade level and attach 3-1/2" x 3-1/2" x 1/4" metal plate to the top of the post. The Contractor shall immediately report same to the Resident Project Representative. The Contractor shall allow the Resident Project Representative to obtain necessary record measurements on the lead installation prior to backfilling. If the sewer leads are backfilled without notification to a Resident Project Representative, the sewer lead shall be excavated, clearly showing the newly placed pipe, at the Contractor's expense.

I. Pressure Sewer Services

Pressure sewer services shall be constructed as shown on the Sanitary Sewer Standard Details in the plans.

A pressure sewer service assembly is defined as the fused connection of the tapping tee

to the main, the butt fused service pipe from the main to the property line, and a curb stop assembly at the property line. The curb stop assembly consists of an isolation valve and valve box extending to the surface, with a cast iron cover marked "sewer" and a check valve.

J. Cleaning

All manholes, sewer leads and cleanouts shall be kept thoroughly clean of silt, debris and foreign matter and shall be free from such accumulations at the time of final acceptance.

K. Sanitary Structure Waterproofing

The Contractor shall apply a waterproofing system to the inside or outside of all manhole and structure walls. The material to be used for this operation shall be as specified in these specifications.

The waterproofing system shall be applied and allowed to dry in accordance with the manufacturer's directions. All steps, lids, frames and castings and sewer pipe entering or leaving the manhole shall be protected during application to prevent their being coated.

1. Interior Waterproofing

If any leaks in the manhole walls are detected twenty-four (24) hours after application of the first coat of the waterproofing system, they shall be sealed by application of a quick-set sealer. This sealer shall be a mixture of Portland Cement - Type One and "Ipanex R", "Waterplug", "Preco" or equal. The quick-set sealer shall be applied in accordance with the manufacturer's directions. After the patched areas dry, they shall be covered with another coat of the waterproofing and allowed to dry. If any leaks are apparent after that time, the Contractor shall repatch them. The above steps shall be repeated until all leaks are sealed.

After all leaks are stopped and there are no leaks apparent after twenty-four (24) hours upon application of the first coat of the waterproofing system or twelve (12) hours after application of a patch, the Contractor shall apply over the dry surface a finish coat.

2. Exterior Waterproofing

The Contractor may elect to provide an exterior rather than interior manhole waterproofing to the manhole sections before installation.

The exterior surfaces of all manholes shall be thoroughly covered with mastic at a rate of one (1) gallon per twenty-five (25) square feet. The exterior surfaces shall be thoroughly cleaned before application of the mastic. The

mastic shall be as specified in these specifications.

Should the exterior waterproofing fail to provide an adequate seal then the Contractor shall seal the interior of the manhole as specified above.

L. Defective Manholes

Any manhole that is defective, due to manufacturer or realignment of the pipe openings, should be returned to the manufacturer.

M. Acceptance Tests

1. Sanitary sewer manholes and structures shall be visually inspected for leaks prior to acceptance of the manhole. There shall be no visible leakage of groundwater into the manhole. Patching, if required, shall be accomplished via the methods indicated in 7.03K.
2. Sanitary sewer wyes and sewer leads shall be tested for leakage after completion of construction. The testing shall occur in conjunction with the overall main sewer testing. Should it be necessary to test sewer wyes and leads independently after the main sewer has been tested it shall be performed using air and following the procedure outlined in Section 6.03J of this specification.

SECTION 8 - FORCEMAINS

8.01 SCOPE OF WORK

The work covered by this section of the specifications consists in the furnishing of all plant, labor, materials, equipment and/or in performing all operations necessary for the installation of the forcemains, valves and fittings, complete, in accordance with these specifications and applicable drawings.

8.02 MATERIALS

A. Pipe Materials

1. Ductile Iron Pipe and Fittings shall be designed in accordance with the latest revision of ANSI specifications A 21.50 and A21.51. The pipe shall be designed to withstand a minimum working pressure of 150 psi and a minimum hydrostatic test pressure of 300 psi. The pipe shall also be designed for a minimum laying depth of six feet.

All ductile iron pipe and fittings shall be coated on the outside with a bituminous coating of either coal tar or asphalt base one mil thick at the point of manufacture in accordance with the specifications of the American Water Works Association. All ductile iron pipe shall be cement lined, standard thickness, in accordance with ANSI A 21.4. The spigot ends of all pipe lengths which have been cut in the field shall be ground to a smooth surface, tapered back about 1/8 inch at an angle of 30° with the pipe centerline, and painted with two coats of asphaltum metal protective paint.

Ductile iron pipe shall conform to the dimensions set forth in the table below. Tolerances permitted in ANSI specifications listed above will apply. Pipe classes shown on the plans shall control. Ductile iron pipe shall be utilized for all forcemains larger than 3"

Pipe Size Nominal Inside Diameter in Inches	Outside Diameter in Inches	Pipe Barrel Thickness in Inches	Thickness Class
4"	4.80	0.26	51
6"	6.90	0.25	50
8"	9.05	0.27	50
10"	11.10	0.29	50
12"	13.20	0.31	50
14"	15.30	0.36	51
16"	17.40	0.37	51
18"	19.50	0.41	52
20"	21.60	0.42	52

2. Polyvinyl chloride (PVC) pipe shall meet the requirements for Type 1, Grade 1 (PVC 1120) of ASTM Specification D-1784 and ASTM D-2241, Standard Specification for PVC pipe (SDR- PR). PVC pipe shall be a minimum rating of Class 200, SDR 21. PVC shall only be utilized for all forcemains 3" or less in diameter.

3. High Density Polyethylene Pipe (HDPE) shall be DR 11, Class 3408, for all directionally drilled installations, as supplied by Driscoplex PW 4000 by Performance Pipe or equal, and meet the following conditions.

Pipe Size Standard	Dimension Ratio (DR)	Working Pressure
IPS	11	160psi

All HDPE pipe shall be joined by heat fusion per manufacturer's requirements. This method and locations must be approved by the Authority Engineer. Refer to standard details for the connection of ductile iron pipe to HDPE.

Refer to MDOT specification BJ-2D, Special Provisions for Directionally Bored Pipe and Section 14.

HDPE pipe shall be inspected prior to installation by a qualified person or by the Authority Engineer. If damage is found to be unacceptable according to the manufacturer, then suitable efforts

shall be made to repair the damaged pipe or the pipe shall be rejected from use.

Connections to HDPE pipe shall not be made immediately upon installation. It is required that the contractor wait 24 hours so pipe can reach equilibrium temperatures.

B. Pipe Joints

1. Flanged joints shall be made with flanges, bolts, nuts, washers and gaskets, conforming to ANSI Standard B 16.1, Class 125.
2. Mechanical joints for cast and ductile iron pipe shall conform to ANSI Standard A21.11 and AWWA C111 or to Federal Specifications WW-P-421.
3. Rubber gasket joints for cast and ductile iron pipe shall be of a bell and spigot type conforming to ANSI Standard A21.11. These joints shall be similar to "TYTON" as manufactured by the U.S. Pipe and Foundry Co., "SUPER BELL TITE" as manufactured by James B. Clow & Sons, Inc. or equal.
4. Rubber gasket joints for PVC pipe shall be of bell and spigot type. The pipe shall be jointed by the means of rubber ring which shall be an integral and homogeneous part of the pipe barrel.

C. Valves and Appurtenances

1. Gate valves shall meet the requirements of AWWA C500 and/or C509 of the American Water Works Association. Valves shall be designed for not less than 150 psi working pressure and shall be tested for leakage and distortion under a hydraulic pressure of not less than 150 psi. Under such pressure, the valves shall show no leakage or distortion.

All gate valves shall be cast iron body, fully bronze mounted, bronze stem double disc gauge valves or resilient seated gate valves. Each valve shall have a clear waterway equivalent in area, when open, to that of the connecting pipe. Valves shall be made to close when turned to the right or clockwise. All valves shall be operated by non-rising stems and shall have square wrench nuts, or hand-wheel operators with an opening arrow cast in the metal.

2. Plug valves shall be lubricated round port valves. Valves shall be 100% port area type with semi-steel body. Valve bodies shall be suitably marked to indicate whether the valve is open or closed.

The seating surface of the rotating element shall be of material recommended by the manufacturer for sewage sludge service. Bearings at the top and bottom supporting the rotating element shall be permanently lubricated corrosion-resistant type, suitable for sewage plant service. Stem seals shall be O-ring type of the same material as the seating surface and designed so replacement can be accomplished without disassembly of the valve.

All plug valves shall be designed to operate with a pressure of 150 psi on either side of the valve without leakage.

3. Check valves shall be designed for a minimum working pressure of 150 pounds per square inch or as indicated. Valves shall have a clear waterway equal to the full nominal diameter of the valve. Valves shall open to permit flow when inlet pressure is greater than the discharge pressure and shall close tightly to prevent return flow when discharge pressure exceeds inlet pressure. Distinctly cast on the body of each valve shall be the manufacturer's name or initials or trademark by which he can be readily identified and the size of the valve, working pressure and the direction of flow.

Check valves larger than 2 inches shall be iron body, bronze mounted, shall have flanged ends and shall be the non-slam type. Flanges shall be the 125-pound type conforming to ANSI Standard B16.1. All check valves shall be supplied with an external lever and weight. Springs shall be applied to lever, if necessary, to create a non-slam condition.

4. Valve operators shall be provided for all sewage and sludge valves of a type as indicated on the plans. Valve operators shall be of sufficient size and strength to overcome expected maximum operating torque. Valve operators found to be inadequate strength will be replaced by the Contractor at no expense to the Owner or the Authority.

All valves 8 inches and larger to have crank, handwheel, chain wheel or square nut for buried service, totally enclosed, weatherproof worm gear or traveling screw-type operators with indicators.

For automatic (if required by the drawings) operation, cylinder, rotary or similar types of electric or pneumatic actuators may be used regardless of valve size. Various accessories shall be used, depending on the application, such as positioners, limit switches, solenoid valves, speed controls and failsafe assemblies.

5. Valve boxes shall be cast-iron, three piece, adjustable type with a 5-1/4 inch shaft. Covers shall be furnished with fingerholes and marked "SEWER". Valve boxes shall be similar to that as manufactured by the East Jordan Iron Works, Clow Corporation or equal.

6. Pipe supports, where required, shall be of the adjustable type made to support cast iron type pipe.

8.03 INSTALLATION OF PIPE AND FITTINGS FOR FORCEMAIN

All pipe and fittings shall be installed in strict accordance with the recommendations of the manufacturer. Piping and fittings for forcemains shall be of the types and materials hereinbefore specified. The pipe and accessories shall be new and unused.

The interior of the pipe and fittings shall be thoroughly cleaned of foreign matter before being lowered into the trench and shall be kept clean during laying operations by plugging the ends or other approved methods. When work is not in progress, open ends of pipe and fittings shall be securely closed so that no trench water, earth, animals or other substance will enter the pipes.

No pipe or fittings shall be laid in water or when the trench or weather conditions are unsuitable for work, except by permission of the Authority Engineer.

The full length of each section of pipe shall rest solidly upon the pipe bed with recesses provided to accommodate the bells and joints. Deflections from a straight line or grade, as required by vertical curves, horizontal curves or offsets, shall not exceed one inch per lineal foot of pipe for pipe less than 10 inches in diameter between the centerlines extended of any two connecting pipes. If the alignment requires deflections in excess of these limitations, special bends or a sufficient number of shorter lengths of pipe shall be furnished to provide the angular deflection required.

When pipe is cut in the field, the outside of the cut end shall be tapered back about 1/8 inch at an angle of 30° with the centerline of pipe to remove any sharp, rough edges and painted with two coats of asphaltum metal protective paint.

Fittings at bends in the pipeline shall be firmly wedged against the undisturbed, vertical face of the trench to prevent the fittings from being blown off the lines when under pressure. Concrete thrust blocks shall be installed at all deflections as shown on the drawings or as directed by the Authority Engineer.

Where pipe ends are left for future connections, they shall be valved, plugged or capped as called for on the drawings. Where connections are made between new work and existing mains, the connections shall be made by using specials and fittings required to suit the actual conditions.

8.04 HYDROSTATIC TESTS FOR FORCEMAIN

The forcemain or sections thereof shall be tested by the Contractor in the presence of the Authority Resident Project Representative and all leaks shall be made tight to meet the requirements below. The Contractor shall furnish all piping, bulkheads, pumps, gauges and other equipment required to carry out the testing.

The section of main to be tested shall be filled with water at least 24 hours prior to starting the test.

At the start of testing, the main shall be pumped up to a pressure of 150 psi and the test period shall start immediately thereafter. The line shall then be maintained under this test pressure for a continuous period of two hours by pumping water into the line at frequent intervals. The volume of water so added shall be measured and considered to represent the leakage from the line under test during the interval. In calculating leakage, the Authority Engineer will make allowance for added joints in the line over the normal for unit lengths of pipe. The leakage per hour under the conditions of test shall not exceed the values shown in the following table

Size of Pipe	Maximum Leakage Gallons Per Hr Per 1,000 Linear Feet
2"	0.17
3"	0.25
4"	0.33
6"	0.50
8"	0.66
10"	0.83
12"	0.99
14"	1.16
16"	1.32
18"	1.49
20"	1.66

In the event that the leakage exceeds the specified amount, the joints in the line shall be carefully inspected for leaks and repaired where necessary. Any pipes or special casting found to be cracked shall be removed and replaced by new pieces by the Contractor. After this work has been done, the test shall be repeated. Final acceptance of the lines will not be made until satisfactory tests have been passed.

8.05 MARKING PIPE

Each piece of cast iron pipe and each cast iron fitting shall have its weight and class designation conspicuously painted or cast on it. All other pipe materials shall have the class designation painted thereon. Where required, other designation marks shall be painted on the pipe or fittings to indicate correct location of the pipe section in conformity to a detailed layout plan.

8.06 PAINTING

All pipe, valves, bolts and any other portions of forcemain exposed inside manholes and other structures shall be painted per the table below. If necessary, heat shall be provided to maintain good drying conditions. All items to be painted shall be dry and clean before application of the paint. Any rust or scale shall be removed by wire brushing or scraping. All piping must be painted prior to operating the system.

- 1 Coat - "Kopper's Plug Primer" or equal (350 S.F./Gal.)
- 2 Coats - "Kopper's Rustamor 500" or equal (500 SF/Gal)

8.07 THRUST BLOCKS

Concrete thrust blocks shall be poured on hand excavated, undisturbed soil bearing surfaces, of a minimum size as shown on the Standard Details, or increased in size according to the actual bearing values of the soil in each location, or as directed by the Authority Engineer.

Thrust blocks shall be made of 3,000 psi concrete, wet mix. Concrete thrust blocks shall be placed at all 22-1/2 degree bends or greater, dead ends, tees, reducers, hydrants, and crosses as required. Pre-cast thrust blocks may be utilized for certain applications if approved by the Authority Engineer. Retainer glands shall be utilized on all mechanical joint fittings.

8.08 EXCAVATION, TRENCHING AND BACKFILLING

Excavation, trenching and backfilling shall conform to these specifications.

8.09 PIPE LOCATOR

A continuous $\frac{1}{4}$ -inch diameter stainless steel cable shall be installed along with the pipe for use as a locator wire on all plastic (SDR and/or HDPE) projects. Contractor shall verify continuity of the locator wire prior to acceptance by the engineer. The $\frac{1}{4}$ -inch stainless steel cable locator wire shall be looped at 400' intervals and installed within a tracer wire access box. This tracer wire box shall be made of cast iron with a permanently attached 3"x12" ABS tube with a flared end to secure it in the ground. It shall be tamper resistant, with a cast iron locking lid and stainless steel terminal connections on the bottom side to which the tracer wires/cables are attached. Lid will open using a

standard AWWA pentagon key. Tracer wire access box as distributed by USA Blue Book shall be utilized or equal. Located at each tracer wire access box a flexible rebounding marking post must be installed. This marking post must be able to snap back to its normal position when hit. It must extend at least 3' above ground for visibility and have a width of 4". This flexible blue rebounding marking post must have a permanent decal applied indicating "Warning Water Main Pipeline". This marker size and type must be approved by the Authority Engineer.

A 2" wide metallic lined marking tape, which meets the latest APWA specifications, similar to Seton Detection Tape Type 2 SEW, will be installed in addition to the magnetic markers described above, as applicable for pipe installed by means of open excavation. The detection tape shall be buried for the full length of the forcemain at a depth prescribed by the manufacturer.

8.10 AIR RELEASE VALVES AND MANHOLES

Air release valves and manholes shall be constructed as detailed on the detail drawings.

8.11 FORCEMAIN CLEANOUTS

Forcemain cleanouts shall be constructed as shown on the detail drawings.

8.12 CERTIFICATION

The manufacturer of pipe and fittings shall furnish a certified statement that all pipe and fittings furnished by him have been inspected and tested in accordance with the applicable specifications. Pipe will be subject to inspection and approval upon delivery and no cracked, broken, damaged or defective pipe or fittings shall be laid in the work. Any piece that is found to be defective after it has been laid shall be removed by the Contractor and replaced by a sound and perfect piece at no additional cost to the Owner or Authority.

SECTION 12 – SUBMERSIBLE SEWAGE PUMPING STATION

12.01 SCOPE OF WORK

The work covered by this section of the specifications consists of furnishing all parts, labor, materials and appliances and performing all operations for the installation of submersible sewage pumping station(s), the details of which are shown on the Standard Plans.

12.02 GENERAL

The Contractor shall furnish a duplex heavy duty submersible sewage pumping system as manufactured by Liberty Pump, or an approved equal. The principal items of equipment shall include submersible grinder pumps, valves & valve chamber, internal piping, central control panel with circuit breakers, standby generator connection, liquid level control with explosion proof relays, all internal and external wiring, alarm/telemetry controls, concrete pad and electric/gas service as necessary.

12.03 SUBMERSIBLE GRINDER PUMPS

Each pump shall be supplied in accordance with the specifications indicated on the plans. Each pump shall have the necessary characteristics and be properly selected to perform under the duty point indicated for the specific pumping station.

A. Impeller

The impeller is to be corrosion resistant and of the enclosed type. The impeller is to be made of close-grained cast iron and be dynamically and hydraulically balanced before assembling in the pump. A wear ring shall be installed at the inlet of the pump to provide protection against wear to the impeller.

B. Casing

The casing shall be made of high strength cast iron and shall be large enough at all points to pass any size of solid which can pass through the impeller. Wear rings shall be installed.

C. Shaft

The pump shaft shall be constructed of solid 316SS or 17-4 PH (high grade stainless steel). Shaft sleeves are not acceptable.

D. Seals

Each pump shall be provided with a tandem double mechanical seal. The seals shall require neither maintenance nor adjustment and shall be easily replaceable. The lower mechanical

seal shall be protected by a minimal shaft over-hang and pressure reducing vanes on the back of the impeller.

E. Finish

The pump shall have a painted or enamel finish as standard with the manufacturer.

F. Nameplates

Each pump shall have a standard nameplate securely affixed thereto in a conspicuous place and also mounted in the electrical panel showing the serial number and the name of the manufacturer. In addition, the nameplate for each pump shall show the model or figure number, the capacity in gallons per minute at rates of speed in revolutions per minute and total dynamic head in feet. Care shall be taken to be legible at all times.

G. Guiding Rail Connection System

A guiding bracket shall be an integral part of the pump itself. This bracket will slide along a guide rail(s). The guide rails will be furnished and shall be of standard weight Sch 40 stainless steel pipe. The pump shall have a machined connecting flange which will connect to a discharge flange mounted on the wet well floor. The sealing of the connecting flange to the discharge flange is to be accomplished by a guided downward motion, without the use of nuts or bolts.

I. Motor

The pump motor shall be Class 1 Division 1 explosion proof construction. Pump motors shall have a cooling system capable of allowing for continuous operation in even non-submerged conditions. The motor cable shall be properly sealed at its entry into the motor so as to allow no moisture into the motor housing. The pump motor shall be capable of at least 10 starts per hour on average. The pump motor shall be supplied with a moisture sensing device capable of relaying its signal to the control panel.

J. Tools

For the pumps, special tools necessary for maintenance and repair of pumps shall be furnished by the Contractor.

K. Pump Characteristic Curves

Pump characteristic curves shall be furnished showing capacities, heads, efficiencies, and brake horsepower throughout the entire range of pumping. These shall be submitted as part of the shop drawing submitted to the Engineer.

12.04 PUMPING STATION PIPING, VALVES AND FITTINGS

A. The piping shall conform to the sizes and configurations shown on the plans and the following materials specifications.

1. Cast Iron Fittings

Cast iron fittings shall be designed in accordance with the standards set forth in ASA Specifications A21.2, A21.6, A21.8 or to Federal Specification WW-P-421.a. The pipe shall be designed to withstand a minimum working pressure of 150 psi and a minimum hydrostatic test pressure of 300 psi. The pipe shall also be designed for a laying depth of six feet.

2. Ductile Iron Pipe and Fittings

Ductile iron pipe shall be in accordance with the latest revision of ASA Specifications A21.50 and A21.51. The pipe and fittings shall be designed to withstand a minimum working pressure of 150 psi and a minimum hydrostatic test pressure of 300 psi.

3. Galvanized Steel Pipe

Galvanized steel pipe shall meet the requirements of ASTM Specification A120. Standard weight galvanized pipe and standard weight malleable iron fittings or American Standard 125 pound cast iron fittings shall be furnished unless otherwise specified.

4. Valves

The specification for gate valves, knife valves, plug valves, ball valves, butterfly valves, pinch valves and standard check valves is as noted on the plans.

5. Pipe Supports

Pipe supports shall be used to support all piping and valves. Pipe supports shall be of the adjustable type designed to support cast iron pipe.

B. Installation of Piping, Valves and Fittings

1. Cast Iron or Ductile Iron Piping, Valves and Fittings

Cast iron or ductile iron piping, valves and fittings shall be used for all piping 4-inch diameter and larger from the pumps until the pipe exits the valve chamber. Cast iron flanged piping, valves, and fittings shall be used for all interior exposed piping unless otherwise approved by the Engineer. Pipe, valves and fittings shall be carefully laid to line and grade. Care shall be

taken to keep the pipe clean and free from dirt and other foreign materials. Piping laid in the ground shall have bearing over its entire length. Piping along floors, walls or ceilings shall be adequately supported by saddles, posts, wall brackets, pipe hangars or other approved devices. The exact location, number and design thereof shall be subject to the approval of the Engineer.

2. Galvanized, PVC or HDPE Piping

Galvanized steel, PVC, or HDPE pipe and fittings shall be used for all interior piping less than 4 inches in diameter.

3. Pipe Taps

Wherever indicated or required, pipe or fittings shall be tapped to receive small pipe or special fittings.

12.05 SEWAGE FLOW MEASURING DEVICE

A. Flow Meter Equipment

Not Applicable

12.06 ELECTRICAL WORK

A. Factory Wiring and Equipment

1. General

The pumping station control panel shall be completely wired at the factory except for the power feeder lines in accordance with National Electrical Code and carry an Underwriters Laboratory certification (UL 698A) upon delivery. It shall be adjusted and ready for operation. All wiring in the station shall be color coded and numbers as indicated on the wiring diagram portion of the shop drawings. All wiring outside the panel shall be in rigid conduit. It is the Contractor's responsibility to ensure that electrical equipment complies with all federal, state, and local requirements.

(A large, clear, color coded and numbered wiring diagram shall be provided in triplicate with each unit. Wiring diagram shall comply with the latest Authority requirements).

All conduit ends are to be sealed to eliminate water and/or gases moving from one section of the pump station system to another; i.e., wet well to pump control panel, per NEC 500 requirements.

2. Pump Motors

Pump motors shall be supplied with the pump by the pump manufacturer as an integral part

of the pump assembly. The horsepower shall be such that the motor will be non-overloading throughout the entire pump range. All motors shall be oil-filled, Class F insulated NEMA B design, rated for continuous duty. Single-phase pump motors shall be capacitor start/capacitor run and have an integral thermal/current overload switch in the windings protecting the motor. A start capacitor, run capacitor, and motor start relay are required and shall be mounted in the control panel.

3. Pump Controls and Alarms

- A. Unless otherwise noted, provide UL listed controller/starter assembly with the following features for each pump.
 1. Level Transmitter: Provide submersible level transmitter that is intrinsically safe, made from stainless steel. Suitable for wastewater and sludge applications.
 2. Float Switches: Provide multiple tethered style non-mercury mechanical style float switches to turn the pump on and off and to detect high level, with waterproof cables of length required. Provide float rod/pipe, tether clamps, and hardware, to secure the floats at the required elevations, all of stainless steel construction.
 3. Control Panel: Minimum NEMA 4x rated. Hinged, lockable.
 4. Controls: Provide UL listed controller/starter assembly. Provide a magnetic starter with adjustable overload protection (three phase pumps) that starts and stops the pump via level transmitter switch separately wired to the control panel.
 - a. Automatic Alternator (duplex pump arrangements): Electrical alternator that starts pumps on successive cycles and starts multiple pumps if one cannot handle load.
 - b. Control circuitry shall be 120VAC. A multi-tap transformer (208/240/480VAC Primary/120VAC Secondary) shall provide 120VAC control circuit for three-phase models. A 24VDC power supply shall provide power to additional low-voltage control circuitry.
 - c. High-Water Alarm: mechanical-float switch.
 - d. Panel features (all mounted on panel face): control on/off switch, hand-off-auto switch and pump run light for each pump, high water alarm light, high water alarm test switch, seal failure light.
 - e. Provide an audible alarm that activates upon high water or seal failure condition.
 - f. Provide a latching dry auxiliary alarm contact for monitoring by the Owner's building monitoring system, that energizes upon either a high water or seal failure condition.
 - g. Provide an alarm silence button which deactivates the audible alarm but does not deactivate the local alarm lights or auxiliary alarm contact until the alarm condition clears.
 - h. Provide motor disconnect for each motor, control transformer, control panel circuit breaker or fuse, numbered terminal strip(s) for all electrical connections, a project specific wiring diagram in a plastic pouch inside the panel, and all required accessories.

- i. Label all components on the exterior of the control panel with engraved plastic labels screwed to the panel face. Label all wiring, terminal strips, and electrical components inside the panels using labels made for that purpose.

4. Alarm Contacts for Remote Telemetry (and Alarm Monitoring) and Exterior Alarm Light

The pump station shall be provided with alarm contacts terminal board control panel by the pump station manufacturer for energizing of the telemetering and alarm light relays.

- a. Telemetering shall be provided for the following conditions:

High Water Alarm Level
Low Water Alarm Level
Water in the Pump Motor
Pump General Fault
Pump Seal Failure
Power Failure
Sewage Pump No. 1 On
Sewage Pump No. 2 On
Security

- b. Exterior alarm light and horn contacts shall be provided, and the light and horn energized for the following conditions:

High Water Alarm
Level Low Water Alarm Level
Seal Failure

5. Electric Heater

A single-phase electric strip heater shall be provided in the pump panel with an adjustable thermostat.

6. Telemetry Equipment

Telemetry equipment will be supplied and installed by the company providing the lift station package, included in the Control Panel. This shall include an autodialer (sized to accommodate all alarm inputs specified in Section 120.7.A.4.a and dial out numbers as coordinated with Owner) OPTO control system and 12 hour battery backup as approved by Authority Engineer. All programming of telemetry equipment shall be coordinated with the Owner for approval.

B. Site Electrical Requirements

1. General

The Contractor shall supply and install all site electrical and telephone wiring and equipment and utility meter sized appropriately to operate the facilities of the sewage pumping station in accordance with all federal, state, and local requirements and as described in these specifications and shown on the plans.

It shall be the Contractor's responsibility to have utility installations and hookups for electrical and telephone service. Contractor shall also be responsible for providing & installing Manual Transfer Switch & Generator Set Receptacle compatible with requirements.

2. Exterior Station Alarm

An exterior station alarm shall be supplied to provide a visual alarm indication activated by contacts in the lift station control panel. It shall be mounted within the exterior electrical enclosure. A vapor tight, 100-watt light fixture with red globe and guard shall be mounted on the top of the exterior electrical enclosure to indicate visually when an alarm condition exists.

12.07 FACTORY TESTS

The submersible sewage pumps shall be given running tests to check for proper motor and pump operation, correct shaft and impeller rotation and watertightness. Pump shall be run submerged for 30 minutes, simulating actual service conditions after which the motor housing will be checked for moisture either visually if plugs are present, or through the use of a moisture probe, if plugs are not present.

12.10 SHOP DRAWINGS

The Contractor shall submit, as prescribed under Section "General Requirements", six (6) copies of complete shop drawings including the shop drawing for the control panel and color coded electrical schematic drawings (ladder diagrams) for all electrical components and details of all equipment to be furnished under this section. These shop drawings shall be submitted and approved by concurrence of Authority Engineer before installation of these items.

12.11 OPERATION AND MAINTENANCE INSTRUCTIONS

Written instructions for the operation and maintenance of the pump station equipment shall be furnished in quadruplicate for each piece of equipment in this section. The instructions shall be easy to understand with directions specifically written for this project describing the various possible methods of operating the equipment.

The instructions shall include procedures for tests required, pump curves, adjustments to be made, and trouble and safety precautions to be taken with the equipment.

Maintenance instructions shall include test and calibration charts, exploded views of assembled components, spare parts lists and wiring diagrams.

These instructions shall be submitted to the Design Engineer and Authority Engineer for approval at the same time the shop drawings are submitted.

12.12 RECORD DRAWINGS

Any changes that are made in equipment, controls, wiring, etc. from that shown in the plans and specifications shall be made only by approved shop drawings. After such changes are made, the Contractor shall submit to the Authority Engineer record drawings which show these changes in equipment installation.

12.13 AS-BUILT WIRINGDIAGRAM

A large, clear, color coded and numbered wiring diagram shall be prepared showing the as-built wiring of the complete pump station installation including all control and alarm wiring. Provide four (4) copies for each pump station.

12.14 EQUIPMENT INSTALLATION AND START UP FOR SEWAGE PUMP STATIONS

A. General

All equipment shall be installed in a neat, workmanlike manner, acceptable to the Design Engineer with concurrence of the Authority Engineer and in conformance with all applicable local, State and Federal codes and requirements.

B. Factory Trained Start-Up Personnel

The Contractor shall furnish the services of an experienced factory trained field engineer representing the pump station supplier to start up all equipment. He shall be employed by the Contractor in such capacity to interpret the manufacturer's installation guide and instructions, to supervise the installation and start-up of such equipment and to instruct the operating and maintenance personnel for a reasonable period of time. (A minimum of four (4) hours of instruction per pump station.)

The representative of the pump station supplier shall be responsible to insure that all pumps, motors, equipment, controls, alarms, wiring, flow meter and all associated components are properly installed and functioning properly.

C. Systems Start Up

It shall be the Contractor's responsibility to coordinate work between his subcontractors, equipment suppliers and utility companies to ensure that all components of the system function properly as described herein. When the system or a major component of the system is entirely installed and ready for testing, the Contractor shall notify the Authority Engineer and operating/maintenance personnel, in writing, of the time and date the start-up testing will be done. The Contractor, subcontractor, and equipment supplier's representatives shall be present for final start-up testing. During the start-up test, the Contractor shall operate all equipment in such a manner to demonstrate that all components are functioning properly.

If the equipment fails to perform, it will be the responsibility of the Contractor to arrange for repair or replacement of the defective parts and scheduling of a new start-up session.

Should the equipment pass its initial start-up testing but fails during the one year guarantee period, the Contractor shall coordinate the necessary repairs or replacements with the subcontractors and suppliers.

12.15 GUARANTEE

In addition to the Contractor's guarantee, the Contractor shall also furnish the manufacturer's guarantee(s) covering all material and equipment furnished. Such guarantees shall be in written form and furnished to the Owner. The guarantees shall be for a one-year period commencing on the date of acceptance of the completed sewage pumping station(s) as determined by the Design Engineer with concurrence of the Authority Engineer. The guarantee(s) shall cover the structure and all equipment, materials and workmanship of the pump station and all associated components as specified herein. The guarantee shall provide for the replacement of defective materials and/or workmanship, together with the restoration of any related materials or workmanship that are disturbed as a result of such imperfections in the work. All guarantees shall be submitted in triplicate.

SECTION 13 - REPLACEMENT AND CLEANUP

13.01 SCOPE OF WORK

Under this item, the Contractor will restore all lawns, trees, gardens, landscape plantings, sidewalks, ramps, trails, fences, commercial signs, water courses and sand, gravel, dirt, asphalt and concrete roads, catch basins, storm sewers, building sewers, water services, water valve boxes, meter vaults, property markers (such as concrete monuments, irons, stakes, pipes, etc.), mailboxes and other items which may be damaged during the course of construction. All replacement and cleanup work will be incidental to the project except those items of work that are delineated in the bid proposal.

All restoration work shall attempt to return the existing facilities to their original condition. Substitutions, such as gravel instead of grass, will not be allowable.

The Contractor shall pay special attention to the requirements of Act 347, "Soil Erosion and Sedimentation Control". In all construction work the Contractor shall take all precautions necessary to prevent erosion and to conform to the requirements of Act 347. Should erosion occur within the guarantee period, the Contractor shall regrade and reseed the disturbed area at no additional cost to the Owner.

Replacement and cleanup operations shall follow immediately behind the construction work. The Contractor shall make every effort to keep the job site clean and free of trash and miscellaneous building materials. The Contractor shall pay special attention to restore commercial signs, fences, etc. and to patch and repair pavement, driveways and sidewalks immediately after the construction work. In the event that replacement and cleanup work does not proceed in a satisfactory manner, the Owner may withhold periodic payments or close the construction area until such time as the replacement and cleanup is satisfactory. An exception may be made if there are physical limitations which do not allow for immediate replacement and cleanup.

13.02 PAVEMENT RESTORATION

A. General

All permanent pavement restoration shall be done over compacted backfill and a minimum six (6) inches thick compacted MDOT 22A gravel base. The gravel base shall be placed and maintained in accordance with the MDOT Standard Specifications. All patches shall have square, neat, saw cut edges regardless of the final surfacing method planned for that section of the pavement restoration.

No patching work shall be started until the subgrade has been properly prepared. Prior to laying the bituminous patch, the adjacent road surfaces shall be swept clean of all foreign materials and the patch area and pavement primed with Michigan Department of Transportation's approved prime coat.

A bituminous bond coat shall be placed between successive lifts of the bituminous patch and bituminous surfacing. Each lift shall be thoroughly compacted before adding the next lift. This includes running the compaction roller longitudinally along the entire length of the joints between the patch and the existing pavement.

The bituminous mixture to be furnished under these specifications shall be delivered to the paver at a temperature no lower than 285 F. Any mixture that has a temperature below 285 F at the time of "laying" shall be rejected and hauled from the project.

Temporary road patches shall be gravel or bituminous cold patch. The patches shall be maintained in a smooth condition until final repairs are made.

The Authority Engineer and the County Road Commission shall be notified at least two (2) working days prior to the placement of any and all final pavement overlays.

B. Bituminous Patching

Existing asphalt roads and driveways shall be patched using the current Road Commission standards. All patches shall be placed in accordance with the surrounding pavement section thickness and for sections over 2-inches, it shall be placed in two lifts. A bituminous prime coat of 0.25 gallons per square yard and a tack coat of 0.10 gallons per square yard shall be used for all bituminous patches.

Shoulders shall be restored to their original width and depth in accordance with MDOT Standard Specifications using MDOT 23A gravel.

C. Gravel Roads, Driveways, and Shoulders

All gravel roads shall be restored in accordance with MDOT Standard Specifications using six (6) inches of MDOT 23A gravel. Shoulders shall be restored to their original width and depth in accordance with 2012 MDOT Standard Specification Section 307 using MDOT 23A gravel. Shoulders shall be raised on side opposite sewer construction to match new pavement surfaces.

D. Concrete Pavement, Sidewalk and Driveways

Concrete for restoring pavement, sidewalks, and driveways shall attain a 28-day strength of 3,500 pounds per square inch. Neat edges of patch areas shall be obtained by the use of a concrete saw. Concrete mixing aggregates and curing methods shall conform to Concrete section. Concrete patches shall match the original width and depth and in no case, a depth less than four (4) inches. Sidewalks shall have contraction joints a distance apart equal to the width of the slab.

13.03 GRASS AREA

Grass areas shall be considered as two types: A) Type 1, areas which had lawns before construction, and B) Type 2, open fields or ditches not adjacent to established lawns. The plans

may specifically call for Type 1 mixtures in which case the plans will govern. If there is a question as to which mixture to use, the Engineer shall make the final decision.

Terraces, lawns, ditches, open fields and other grassy areas shall be topsoiled, fertilized, seeded and mulched in such a manner that a grass approximately equal in type and density of the original is obtained. Slopes between 1:3 and 1:2 shall be sodded and staked or receive seed with mulch blankets.

A. Topsoil

Topsoil furnished shall consist of dark brown or black loam, clay loam, silt loam, or sandy loam surface of fertile, friable humus soil of mineral original, not including peat or muck. Soil shall be screened topsoil, free of stones, roots, sticks and any other extraneous materials. All topsoil furnished shall be approved by the Engineer. Type 1 areas shall be, topsoiled to a depth of four (4) inches and Type 2 areas to a depth of two (2) inches.

B. Seeding and Fertilizing

Areas to be seeded and fertilized shall be carefully raked to even surfaces and all stones, sticks and other debris removed. The area to be seeded shall be fertilized with agricultural fertilizer 12-12-12 analysis, Davco or Agrico or equal, applied on the prepared surface at the rate of 20 pounds per 1,000 square feet. Fertilizer shall be harrowed or raked into the soil to a depth of not less than one (1) inch.

Seeds shall be furnished in durable bags. On each bag of seed, the vendor shall attach a tag giving name, lot number, net weight of contents, and purity and germination. All seed shall be thoroughly mixed and sown in a method which will ensure uniform distribution. Seeding during high winds or inclement weather will not be permitted. All seed is to be raked in and compacted. The seed shall be sown at the rate of five (5) pounds per 1,000 feet. The seeding mixtures shall be composed of certified seed of the purity, germination and proportions by weight as specified in the following table:

Kind of Grass	Seeds		Mixtures	
	Minimum Purity	Minimum Germination	Type 1	Type 2
Perennial Rye	98%	90%	20%	50%
Kentucky Blue	90%	75%	60%	15%
Creeping Red Fescue	98%	80%	20%	35%

C. Mulching

Immediately after seeding all seeded areas, Type 1 and Type 2 shall be mulched with unweathered small grain straw or hay spread uniformly at a rate of 100 pounds per 100 square feet (two tons per acre). Hydroseeding method with similar application rate will be allowed.

D. Mulching Anchoring

All mulch shall be anchored using one of the following methods. The Contractor may use either method unless otherwise shown on the plans.

1. Method "A": The straw mulch shall be anchored by applying one of the following asphalt products at the rate shown. The asphalt may be blown on with the mulch or sprayed on immediately after the mulch is spread.

<u>Asphalt Product</u>	<u>Application Rate</u>
Liquid Asphalt	
R.C. 1, 2 or 3; M.C. 2 or 3	0.10 gal. per S.Y.
Emulsified Asphalt	
R.S. 1 or 2; M.S. 2; or S.S. 1	0.04 gal. per SY.

2. Method "B": A "Terra-Tak" mulch binder may be used in lieu of asphalt. Mixing and application shall be done in accordance with the manufacturer's recommendations.
3. Method "C": In areas with slopes greater than 10% or where shown on the plans, the Contractor shall place mulch netting or excelsior blanket mulch.
 - a. Mulch Netting: Mulch shall be anchored by the use of mulch netting. The light weight fibrous netting shall be properly placed over the mulch and secured to the ground using wire staples, spaced per manufacturer's recommendations.
 - b. Excelsior Blanket Mulch: An excelsior blanket shall be used in lieu of other mulch. The excelsior blanket shall be a consistent thickness of evenly distributed wood excelsior fibers, 80% of which are six (6) inches or more in length. The top side of the blanket shall be covered with a coarse net of twisted Kraft paper or biodegradable extruded plastic mesh. Ends and sides shall be securely butted and stapled with U-shaped wire staples of a size and length suited to the soil conditions.

13.04 DITCHES

Ditches which have been grassed and maintained by the abutting property owner shall be restored to the current Antrim County specifications.

Ditches in which culverts or drain tile have been installed shall have the same tile replaced, if in good condition, or a tile satisfactory to the Design Engineer installed in its place at the original line and grade.

Catch basins shall be reconstructed, if removed or damaged.

13.05 FENCE REPLACEMENT

- A. Chain Link Fence shall be replaced according to MDOT specifications.
- B. Other Fences shall be replaced equal to and of the same type as existing.
- C. Salvaged material, if approved by the Engineer, may be used for replacement.

13.06 COMMERCIAL SIGNS

Commercial signs, which must be removed by the Contractor in order for work to proceed, shall be replaced and reconstructed to their original condition. It is very important that replacements follow immediately after the construction work.

13.07 BUILDING SEWERS

Building sewers shall include any and all parts of private residential, commercial or industrial sewage disposal system such as sewer pipe, septic tanks, drainfield, etc. Whenever the service of any such facility is interrupted because of the Contractor's operations, he shall provide such interim methods of sewage disposal as are required to maintain a safe, nuisance free, non-polluting construction operation.

13.08 OTHER DEBRIS

The Contractor shall remove, at his own expense from the site, any and all broken pipe, bricks, blocks, lumps of concrete, broken machinery, cans, containers, and other trash and debris.

13.09 TREES

The Contractor shall endeavor to save as many trees as possible. Cut trees, including stumps, shall be disposed of by the Contractor. Any elm tree which is removed must be burned. Tree branches which become broken shall be removed by cutting off flush with trunk and the cut on the trunk shall be painted with an approved tree paint. Where removal of a stump would result in damage to existing utilities, the stump may be removed by chipping to a depth of at least one foot below the finished ground surface.